OPTIMIZATION OF HYBRID EVAPORATIVE COOLING AND AIRCONDITIONING SYSTEMS - AN ECONOMIC APPROACH

by

K. SEKAR

DEPARTMENT OF MECHANICAL ENGINEERING

INDIAN INSTITUTE OF TECHNOLOGY KANPUR

MAY, 1986

OPTIMIZATION OF HYBRID EVAPORATIVE COOLING AND AIRCONDITIONING SYSTEMS - AN ECONOMIC APPROACH

A Thesis Submitted

in Partial Fulfilment of the Requirements
for the Degree of

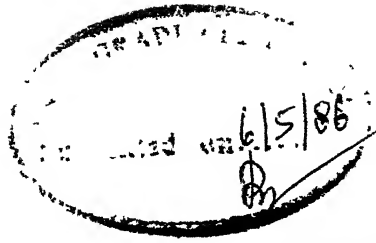MASTER OF TECHNOLOGY

by

K. SEKAR

to the

DEPARTMENT OF MECHANICAL ENGINEERING

INDIAN INSTITUTE OF TECHNOLOGY KANPUR

MAY, 1986

CERTIFICATE

Certified that this work on 'Optimization of Hybrid Evaporative Cooling and Airconditioning Systems - An Economic Approach' by K. Sekar has been carried out under my supervision and that this has not been submitted elsewhere for a degree.

May, 1986

(Dr. Manohar Prasad)
Assistant Professor
Department of Mechanical Engineering
Indian Institute of Technology, Kanpur

ACKNOWLEDGEMENTS

The author wishes to express deep gratitude and veneration to Dr. Manohar Prasad for his meticulous guidance and constant encouragement. His interesting suggestions and constructive criticisms have been of great value, throughout the course of this work. It has been a great privilege to work under him.

The author would also like to thank Dr. K.K. Saxena for his valuable advices and moral encouragement during the tenure of this work.

In the same breathe, the author wishes to extend his gratitude to Mr.P.N. Mishra for his technical help, rendered during this period.

The author wishes to thank his friends and all others for their cooperation and assistance, throughout his stay at I.I.T., Kanpur.

Finally, the author would like to thank Mr.U.S.Misra for his neat, speedy, flawless typing and Mr. B.K. Jain for his meticulous drawings.

-K. SEKAR

CONTENTS

LIST OF FIGURES

NOMENCLATURE

A	Cross-sectional area of the structures, m^2
a_g	Absorptivity of the glass
a_t	Absorptivity of the structures
C	Costs, Rs/year
c_p	Specific heat capacity, kJ/kg.°C
c_{th}	Thermal capacity of the wall, kJ/kg.°C
d	Declination angle
F_s	Sunlit fraction
F_{ss}	Angle factor between the surface and sky
h	Enthalpy, kJ/kg
h_a	Enthalpy of air, kJ/kg
$h_{i,a}$	Enthalpy of inside room air, kJ/kg
h_i	Inside convection heat transfer coefficient of the wall, kW/m^2°C
h_o	Outside convection heat transfer coefficient of the wall, kW/m^2°C
$h_{i,g}$	Inside convective heat transfer coefficient of the glass, kJ/m^2°C-k
$h_{o,g}$	Outside heat transfer coefficient of the glass, kJ/m^2°C-S
I_{DN}	Incident direct solar radiation, kW/m^2
I_R	Reflected radiation, kW/m^2
I_d	Diffused radiation, kW/m^2
I_t	Total intensity of solar radiation, kW/m^2
K	Thermal conductivity of the material, kW/m°C

L	Life of the machineries, years
L_d	Life of the desert cooler, years
L_s	Life of the airconditioning system, years
l	Latitude angle
m	Mass of the wall, kg
$\dot{m}_{air}$	Mass flow rate of air, kg/s
$\dot{m}_{ref}$	Mass flow rate of the refrigerant, kg/s
P	Power, kW
$\dot{Q}_c$	Design cooling load, kW
$\dot{Q}$	Total heat transfer, kW
q	Heat transfer through walls, kW/m^2
RH	Relative humidity
r_g	Reflectivity of the glass
r_k	Penalty parameter
T_{adp}	Apparatus dew point temperature, °C
T_{db}	Dry bulb temperature, °C
T_{dg}	Dry bulb temperature of the air leaving the desert cooler, °C
$T_{g,i}$	Temperature of the inside surface of the glass, °C
T_h	Condensing temperature, °C
T_i	Inside room temperature, °C
T_l	Evaporator temperature, °C
T_o	Outside air temperature, °C
T_{om}	Mean outside air temperature, °C
T_{sol}	Sol-air temperature, °C
T_{wb}	Wet bulb temperature, °C
$T_{w,o}$	Temperature of outside surface of the wall, °C

t	Time, hours
t_r	Transmittivity
U	Overall heat transfer coefficient, $kJ/m^2-h-{}^\circ C$
V_{room}	Volume of the room, m^3
V	Velocity of inside air, m/s
V_w	Design velocity of outside air, km/h
Vol_{air}	Volume of the air, m^3/min
v	Specific volume, m^3/kg
W_{adp}	Specific humidity at apparatus dew point temperature, kg/kg of dry air
W_i	Specific humidity at inside condition, kg/kg of dry air
$\vec{X}$	Design vector
x	Thickness, m
$\ominus$	Incidence angle
$\emptyset$	Relative humidity
$\emptyset_t$	Angle of tilt
α	Wall solar azimuth angle
α_h	Hour angle
β	Altitude angle
Ψ	Sun's Zenith angle
γ	Azimuth angle
δ_p	Profile angle
ρ	Density, kg/m^3
λ	Decrement factor

τ	Timelag factor
η	Efficiency
η_c	Compressor efficiency
η_D	Efficiency of the desert cooler
η_m	Mechanical efficiency

.

ABSTRACT

OPTIMIZATION OF HYBRID EVAPORATIVE COOLING AND
AIRCONDITIONING SYSTEMS - AN ECONOMIC APPROACH

A Thesis Submitted
In Partial Fulfilment of the Requirements
for the Degree of

MASTER OF TECHNOLOGY

by

K. SEKAR

to the

Department of Mechanical Engineering
Indian Institute of Technology Kanpur

May, 1986

A generalised computer programme has been developed

for the cooling load calculations on hourly basis and the

sol-air temperature variation for different orientation of

walls. The effect of heat capacity and timelag factor of

the structures on the cooling load estimation has also

been studied.

The single-stage vapour-compression airconditioning

system has been optimised to get the minimum total cost,

for refrigerants R-12 and R-22. This is compared with a

hybrid system of evaporative cooling and airconditioning as to what extent, the latter is more economical than the former. The optimum results have been found out for the inside design conditions of 24°C, 65%; 27.5°C, 56% and 30°C, 60% (dry bulb temperature and relative humidity) being obtained on the basis of Fanger's comfort equation [6].
Various combinations of the operating parameters are also studied.

CHAPTER 1

INTRODUCTION

1 1 AIRCONDITIONING SYSTEM.

Airconditioning is constantly absorbing and apply-
ing the latest discoveries of science and engineering
in an effort to ease man's environmental problems on
earth and in space. The term, airconditioning means the
act of putting the air in the proper condition for the
desired use. This may mean cleanliness, the temperature
and humidity of the air. Airconditioning for human
comfort is becoming almost a prerequisite for success in
the merchandising field in all except the cooler regions
of the country. The gain in customer's good-will is
reflected by such an increase in business that the air-
conditioning pays more than for itself. As any other
engineering system, the airconditioning system is controlled
by various system parameters. To achieve maximum utilisation
and effective implementation, an airconditioning system
has to be economical. In view of this, the operating
parameters of the system are optimised on the basis of
cost as well as functional energy constraints whichever
is contemplated. To carry out this objective, there are
alternatives available, namely modification of an existing
system and design of a new system. The present work is

done on the basis of the former.

1.2   SELECTION OF ENVIRONMENTAL ZONES AND OUTDOOR
       TEMPERATURES

Eventhough, there are many applications, the
primary function of an airconditioner unit is considered
to create temperatures artificially which will be comfor-
table for human beings. Many investigators have done
extensive work on temperature zones for human comfort.
Fanger [6] elaborated the methods of getting comfort
conditions and also suggested a comfort equation after
carrying out extensive field studies. In India, Ramamoorthi
[15] has analysed the equation for the Indian weather
conditions after taking into account of several variables
and suggested the comfort conditions, namely inside dry-
bulb temperature, relative humidity and velocity of air.
Singh and Prakash [14] presented a new ASHRAE comfort chart and
recommended a region of design conditions for the comfort
environment. The result of the field studies carried
out by Malhotra [10] for the conducive atmosphere pertain-
ing to Indian environment has also been taken into consi-
deration. Based on the energy cost, Whitner [18] has got
the higher comfort conditions. Several investigators [1]
assumed the daily to outdoor temperature variation as a
sinusoidal function which results in Fourier series. In
India, Ramamoorthi [15] suggested that the airconditioning

system can be substituted by evaporative cooling system, whenever feasible.

The design of an airconditioning plant is mainly dependent on the cooling load, a function of indoor and outdoor temperatures and internal energy release. The indoor temperatures are chosen on the basis of comfort industrial requirement. The size of the building and various capacities of the equipments are also the primary factors influencing the cooling load calculations. So, great care should be taken in proper selection of the equipments to get the total cost as minimum. It has been a common practice to use air-cooled condensing unit for both residential and commercial applications. This dispenses with water piping, cooling water tower and water treatment, thereby eliminating their costs. But the head pressure of the air-cooled system is usually 10% to 20% higher than that of the water cooled system. Hence the air-cooled system is not used in case of large cooling requirement. For smaller units, the cost and conveniences dominate over other factors. Hence, the air-cooled system is considered in the present analysis.

1.2.1 ANALYSIS OF COOLING LOAD CALCULATIONS

There are number of parameters affecting cooling load calculations, often difficult to define precisely, and always intricately interrelated. Most of these parameters

can be assembled under the classification of space heat
gain. This is necessary because different fundamental
principles and equations are used to calculate different
modes of energy transfer. The major parts of the space
heat gain are (a) heat transfer through the structure of
the building, (b) heat generated within space by occupants,
lights and appliances and (c) ventilation and infiltration
of outdoor air . For the evaluation of structural heat
gain, there are different techniques available, namely
(a) sol-air temperature method, (b) cooling load temper-
ature difference method, (c) finite difference method and
(d) finite element method. Among these, sol-air temper-
ature technique is mostly preferred due to its simple
algorithm. The cooling load temperature difference
method [3] is implemented by using the transfer function
method to compute the one-dimensional transient heat
flow through the building structure. Kadambi and
Hutchinson [9]have described the finite difference method
applied for the heat transfer through the walls. Huebner [7]
has elaborated the finite element method in the applica-
tion of heat flow through structures. The thermal capacity
and thickness of the structure are interrelated and
presented in the graphical form [2] . The relation between
the infiltration load and the volume of the conditioned
space is explained in [3,4,12] . Woods et al [19] have
modified the ventilation standards by giving emphasis on

energy saving   The heat generation within the conditioned space has been elaborately given in [12] taking into account of metabolic ratings.   The procedure for hourly cooling load calculation is elaborated in [3] .

1.2.2   METHOD OF OPTIMISATION

In general,optimisation can be defined as the act of obtaining the best result under the given circumstances. In design, construction and maintenance of any engineering system, engineers have to take many technological decisions. The ultimate goal of all such decisions is to either minimize the effort required or maximise the desired benefit.   Since the required effort or desirable benefit in any practical situation can be expressed as a function of certain design variables, optimisation, in particular, may be considered as the process of finding the conditions that results in the maximum or minimum value of the function, known as objective function.   It is very rare that a practical design problem to be unconstrained. Considering this fact, if the expression for the objective function and the constraints are fairly simple in terms of design variables, the classical methods of optimisation technique can be used to solve the problem.   On the other hand, if the problem involves the objective function and the constraints which are not stated as explicit functions of design variables or which are too complicated to

manipulate, we should go in for some specialised numerical methods of optimisation. The basic philosophy of these methods to produce a sequence of improved approximations to the optimum value. In the present work, one of such methods called as 'Penalty Function Method' [16] is adopted to obtain the optimum design variables of the airconditioning system for the minimum total cost. The application of this iterative procedure is made possible due to the availability of the computer. These methods are clearly elaborated in [16] .

1.3 PRESENT STUDY

In the present study, a generalised computer programme has been developed for the accurate evaluation of the cooling load considering daily outdoor temperature variation based on actual as well as approximate. In this regard, the effect of timelag factor and heat capacity of the structures on the structural load has also been found out. The cooling loads have been calculated on the basis of actual hourly daily temperature variations and the sinusoidal temperature variation based on maximum and minimum temperatures. The multiplier has been developed to facilitate the utilisation of the suggested sinusoidal temperature variation; because these data are available for most of Indian cities [11].

For the iterative optimisation technique, a versatile computer programme has been developed which takes care of various factors involved in the total cost of a vapour compression system. Even though there are large number of operating variables present in an air conditioning system, the most important factors have been selected as design variables, giving emphasis on the feasibility of control. For these variables, the constraints are formulated on the basis of practical consideration. A comparative study has also been carried out between the airconditioning systems operating with and without evaporative cooling, for the duration, April to June, in terms of total cost. This aspect is studied for both R-12 and R-22 refrigerants.

CHAPTER 2

COOLING LOAD ESTIMATION

2.1 INTRODUCTION

The design of an airconditioning plant for a building depends on the use of the building. The cooling load calculation needs the size of the building, its structural details and orientation. In addition, the following quantities are considered.

    i) Design conditions· Indoor and outdoor conditions,

    ii) Instantaneous heat load· Sensible and latent.

For the given inside design condition, the cooling loads are calculated as follows.

Sensible cooling load It comprises the heat transfer through structure including solar heat gain. The sensible heat part of the infiltration and ventilation is calculated from the known amount of the air and subsequent difference between enthalpies of the inside and outside air. The sensible heat part of the heat release from the occupants is calculated from the standard data available giving heat release from human beings, ratings of fans, lights, etc.

The latent heat part of the cooling load has been calculated from the infiltration and ventilation air, latent heat release from the occupants inside the room.

2.2 SELECTION OF INDOOR CONDITIONS:

The variation in the weather, building occupancy, and other factors, affecting the load, necessitate carefully coordinated controls to regulate simultaneously the components and equipments to maintain the desired inside conditions. The design indoor conditions play a key role in the design of any comfort airconditioning system. The field studies [10], reveal that in India, for hot humid climates, the comfort zone is between 22°C and 24.5°C, effective temperatures. The analysis [15] carried out on the basis of Fanger's comfort equation recommends the comfort conditions for Indian people as T_{db} = 24°C, RH = 0.65, V = 0.8 m/min, T_{db} = 27.5°C, RH = 0.56, V = 1.1 m/s, and T_{db} = 30°C, RH = 0.60, V = 0.7 m/s. Since, these results lie in the comfort zones recommended in [5,6,14], in the present analysis the same combinations are taken into consideration.

2.3 HOURLY COOLING LOAD.

Most of the factors of the cooling load vary in magnitude over a wide range during a twenty four hour period. As the cyclic changes in the load components are not usually in phase with each other, the analysis is required to establish the resultant maximum cooling load for a building.

2.4 HOURLY VARIATION OF OUTDOOR CONDITIONS

Hourly variation in the outdoor conditions is available for the limited cities. But the cooling load depends greatly on the ambient temperature variations as compared to that obtained on the basis of design conditions. So a mathematic model [1] has been adopted which gives a close approximation to an average value equal to the mean daily temperature plus an oscillating component with an amplitude equal to one half the mean daily range. For most practical applications, this can further be approximated by a constant with a superimposed sine wave having a 24-hour period. So, the final form of the expression comes out to be a harmonic series of first order

$$T_o = A + B \cos (15 t - C) \qquad (2.1)$$

where T_o = outside air temperature at any time, $^\circ C$

t = time in hours

A, B, C = the constants being obtained by applying the boundary conditions,

$$\frac{dT_o}{dt} = 0 \text{ when } \begin{cases} T_o = T_{max} \\ T_o = T_{min} \end{cases} \qquad (2.2)$$

T_{min} occurs at (Sunrise-1) hrs; T_{max} occurs 12 hrs thereafter. So, the above model is solved for the outdoor air temperature variation by knowing the minimum and maximum temperatures with their corresponding timings, in a day. The result of

this equation has also been verified with actual variation
of the temperature and the comparative study has been
done in a graphical form, Fig.4.1, for Kanpur. For this
purpose, the data for the actual variation of the temper-
ature and relative humidity for the period 1982, 1983
and 1985 have been procured [8] and given in tabular form
in Appendix-A.

2.5 SOLAR RADIATION.

The solar radiation is the sole factor for the
summer airconditioning system. The total incident solar
radiation is given by

$$I_t = I_{DN} \, Cos\Theta + I_d, \quad k \, W/m^2 \qquad (2.3)$$

where the product of I_{DN}, direct normal radiation and the
cosine of the incident angle Θ, stands for the irradiation
on a surface from the sun and I_d refers to the diffused
radiation. Simplified general relations for I_{DN} and I_d
for a clear sky are given approximately by,

$$I_{DN} = A_1/exp \, (B_1/Sin\beta), \quad k \, W/m^2 \qquad 2.4(a)$$

$$I_d = C_1 \cdot I_{DN} \cdot F_{ss} \quad , \quad k \, W/m^2 \qquad 2.4(b)$$

where,

$\quad A_1 \quad = \quad$ apparant solar irradiation at an air
$\qquad\qquad$ mass $= 0$, $k \, W/m^2$

$$B_1 = \text{atmospheric extinction coefficient,}$$

$$C_1 = \text{diffuse radiation factor,}$$

$$F_{ss} = \text{the angle factor between the surface and the sky,}$$

$$= 0.5 \text{ for vertical surfaces,}$$

$$= 1.0 \text{ for horizontal surfaces,}$$

$$= (1 + \cos\phi_t)/2 \text{ for any other inclined surfaces}$$

and β = the altitude angle.

The values of A_1, B_1 and C_1 of [3] are given in the Appendix-B.

2.5.1 ESTIMATION OF SOL-AIR TEMPERATURE

For heat transmission calculations, it is convenient to combine the effects of outside air temperature and solar radiation clustered into a single fictitious quantity called sol-air temperature (T_{sol}). The rate of heat transfer, q, from outside to inside surfaces of a sunlit structure may be written as,

$$q = h_o (T_o - T_{w,o}) + a_t \cdot I_t \qquad (2.5)$$

where,

$$h_o = \text{outside air convective heat transfer coefficient, k W/m}^2 - {}^\circ C$$

$$T_o = \text{outside air temperature, }{}^\circ C$$

$$T_{w,o} = \text{temperature of the outside surface, }{}^\circ C$$

$$a_t \quad = \quad \text{absorptivity of the structure,}$$

and $\quad I_t \quad = \quad$ total intensity oi solar radiation, k W/m^2.

The total intensity of radiation is calculated by the primary angles namely, the latitude (1), hour angle (α_h) and the sun's declination, d. Besides this, there are several other angles as the sun's zenith angle Ψ , altitude angle β , and azimuth angle γ . In Appendix-C, the equations for the estimation of these angles are given.

The equation (2.5) can be modified as

$$q = h_o \left(T_{sol} - T_{w,o} \right) \tag{2.6}$$

where,

$$T_{sol} = T_o + a_t \cdot I_t / h_o$$

The outside air convection heat transfer coefficient, h_o is calculated as follows

$$h_o = 14.278 + 3.559 . V_w \qquad \text{for very smooth surfaces,} \qquad 2.7(a)$$

$$= 18.423 + 3.81 . V_w \qquad \text{for smooth surfaces,} \qquad 2.7(b)$$

$$= 26.55 + 5.0663 . V_w \qquad \text{for rough surfaces,} \qquad 2.7(c)$$

$$= 28.64 + 6.364 . V_w \qquad \text{for very rough surfaces,} \qquad 2.7(d)$$

where V_w is the design velocity of the outside air in Km/h. In the present study, the variations in the sol-air temperature for a day, on different orientation of the

surfaces presented in a graphical form, Fig.4.2.

2.6 HEAT TRANSFER THROUGH STRUCTURES.

A fraction of the total heat energy is absorbed by the structural material and there is also a timelag for the heat transfer from the outside surface to the inside surface of the structure. The thermal capacity of the walls and ceilings, c_{th}, is taken as,

$$c_{th} = m.c_p = \rho.A.x.c_p \qquad (2.8)$$

where m, c_p, ρ, A and x are mass, specific heat, density, cross-sectional area and thickness of the structure, respectively.

Taking into account of timelag and decrement factor,[2] the actual heat transfer through the structure at any time 't' is given by

$$\dot{Q}_t = \sum_{j=1}^{5} [\ U_j\ A_j\ (T_{om} - T_1) + U_j A_j.\lambda_j(T_{o(t-\tau)} - T_{om})\ ] \qquad (2.9)$$

where T_{om}, λ and τ are the mean sol-air temperature, decrement factor and timelag factor, respectively. In the above expression, U, A, and $T_{o(t-\tau)}$ refer to the overall heat transfer coefficient, cross sectional area and temperature at time (t-τ), respectively. Here summation symbol stands for four walls and the ceiling.

$$K_1 = 0\ 00072\ kW/m\,^\circ C$$
$$K_2 = 0\ 00130\ kW/m\,^\circ C$$
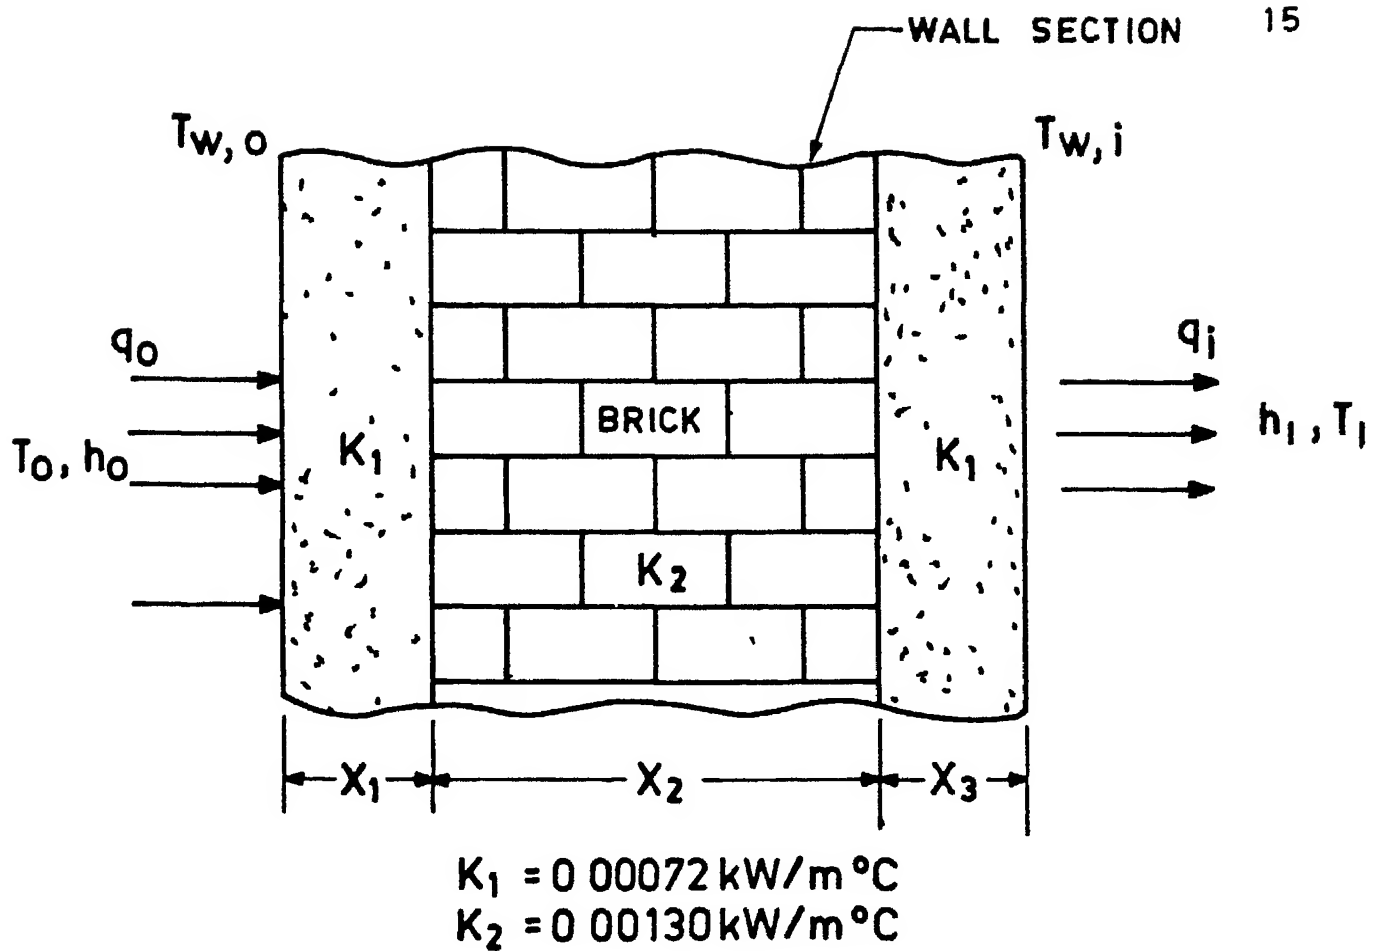
Fig 2 1(a) Structural details of the wall

$$K_3 = 0\ 00072\ kW/m\,^\circ C$$
$$K_4 = 0\ 00173\ kW/m\,^\circ C$$
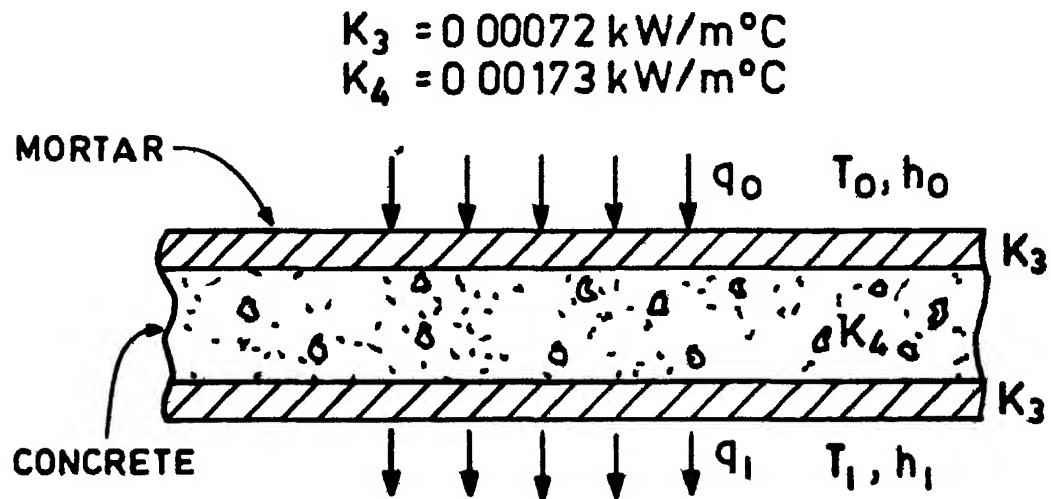
Fig 2 1(b) Structural details of the ceiling.

Referring to the Fig.2.1, the heat conduction through structure can be written as,

$$q_{st} = h_o (T_o - T_{w,o}) = \frac{(T_{w,o} - T_{w,i})}{\sum\limits_{i=1}^{i=3} (x_i/K_i)} = h_i(T_{w,i} - T_i)$$

(2.10)

The above equation can also be written as,

$$q_{st} = U \cdot (T_o - T_i)$$

(2.11)

with

$$U = \frac{1}{(\frac{1}{h_o} + \sum\limits_{i=1}^{i=3} \frac{x_i}{K_i} + \frac{1}{h_i})}$$

T_o = outside air temperature, °C

T_i = indoor temperature, °C

x_i and K_i = thickness and thermal conductivity of the 'i' th layer of the structural material

h_i = inside convective heat transfer coefficient, $kJ/m^2 - h - °C$

U = overall heat transfer coefficient, $kJ/m^2-h-°C$.

In the present study, the values of K_i's are taken from [3]. The inside convective heat transfer coefficient is found to be function of temperature difference ($\Delta T = T_{w,i} - T_i$).

For walls:

$$h_1 = 4.25 \ (\Delta \ T)^{1/4}, \ kJ/h - m^2 - {}^\circ C \qquad 2.12(a)$$

For ceiling

$$h_1 = 3.48 \ (\Delta T)^{1/4}, \ kJ/h - m^2 - {}^\circ C \qquad 2.12(b)$$

The Newton-Raphson iterative procedure has been used to get the values of 'h_1'. Equation 2.9 is used to calculate the heat transfer through the structure after considering time lag and decrement factors [2]. The effect of these factors on the cooling loads has been discussed, in Chapter 4.

2.7 HEAT TRANSMISSION THROUGH GLASS WINDOWS

The incident radiation may be reflected, partly absorbed and the remainder transmitted through the glass materials. Thus, in general, it may be written as

$$r_g + a_g + t_r = 1 \qquad (2.13)$$

where r_g, a_g and t_r are the reflectivity, absorptivity and transmittivity, respectively. The equations for calculating these thermal properties for the glass windows are given in Appendix-D.

From the basic concept of heat transfer, the rate of heat gain through the glass is given by,
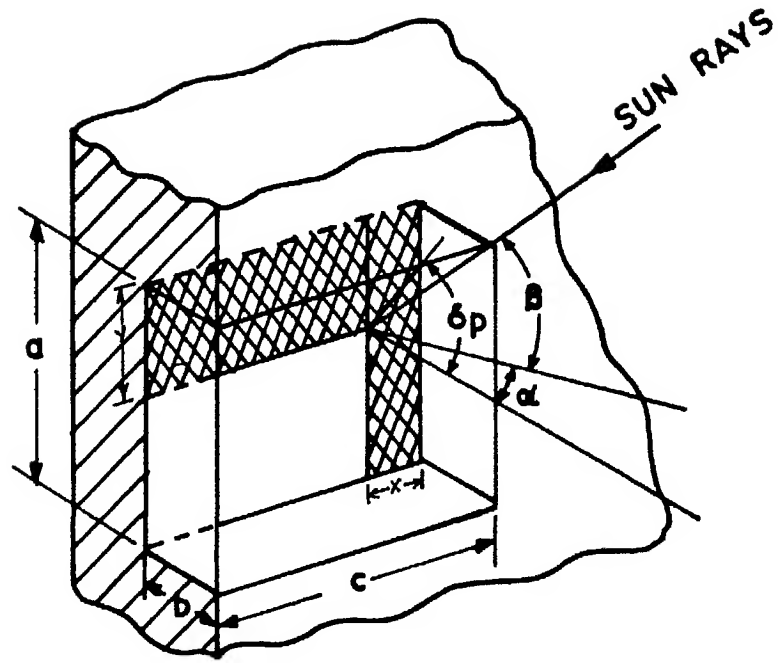
Fig 2 2(a) Shading of window for a building
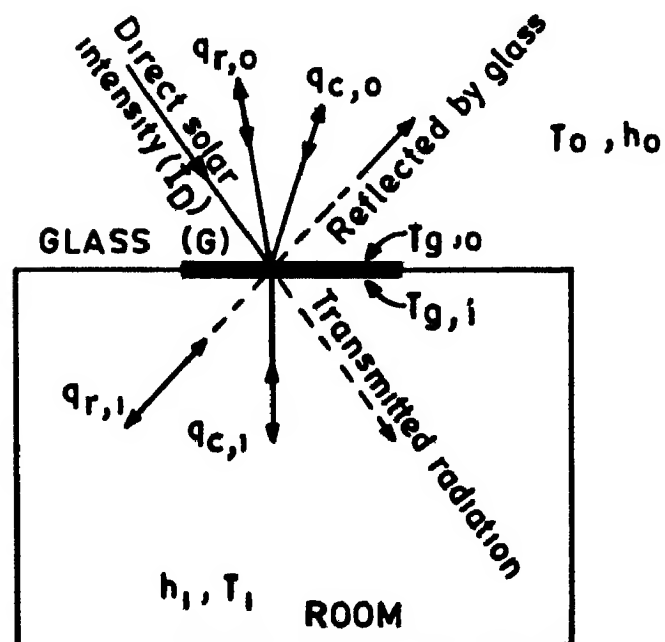
Fig. 2 2(b) Heat transfer through the glass window.

$$q_{glass} = F_s \cdot t_{rD} \cdot I_D + t_{rd} \cdot I_d + t_{rR} \cdot I_R + h_{1,g}(T_{g,1} - T_1) \qquad (2.14)$$

where F_s is the sunlit fraction of the window surface, t_{rD}, t_{rd}, and t_{rR} are the transmittivities of the direct, diffused and reflected radiations, respectively. I_D, I_d, and I_R are the intensities of direct, diffused and reflected radiation. $T_{g,1}$ and T_1 are the temperatures of inside surface of the glass and indoor conditions, respectively.

In reality, a glass window is not fully exposed to direct sunlight, but partially shaded. Referring to Fig.2.2(a), it can be written as .

$$X = b \cdot \tan \alpha \qquad\qquad 2.15(a)$$

$$Y = b \cdot \tan \delta_p \qquad\qquad 2.15(b)$$

where the profile angle δ_p is related to the sun's altitude angle β and wall solar azimuth angle α by,

$$\tan \delta_p = \frac{\tan \beta}{\cos \alpha} \qquad (2.16)$$

Finally, the value of sunlit fraction, F_s, is given by,

$$F_s = 1 - P_1 \cdot \tan \delta_p - P_2 \cdot \tan \alpha + P_1 \cdot P_2 \cdot \tan \delta_p \tan \alpha \qquad (2.17)$$

where,

$$P_1 = b/a \quad \text{and} \quad P_2 = b/c.$$

Referring to Fig.2.2(b), the energy balance for the glass sheet can be written as,

$$F_s \cdot I_D \cdot a_{gD} + I_d \cdot a_{gd} + I_R \cdot a_{gR} = h_{i,g}(T_{g,i} - T_i) + h_{o,g}(T_{g,o} - T_o)$$

$$(2.18)$$

where $h_{i,g}$ and $h_{o,g}$ are the surface coefficients given by

$$h_{o,g} = 3.96 \times 10^{-3} + 9.892 \times 10^{-4} \cdot V_o, \quad kJ/m^2 - °C - s \qquad 2.19(a)$$

$$h_{i,g} = 0.237 + (V_i/Height)^{0.5}, \quad kJ/m^2 - °C - h \qquad 2.19(b)$$

where V_o is the outside air velocity in Km/h and V_i is the indoor air velocity in m/h.

Combining the equations (2.14) and (2.18), the heat transfer through windows and doors including solar heat gain is calculated as

$$\overset{\bullet}{Q}_g = \sum_{k=1}^{N} \left[(F_s \cdot t_{rD} \cdot I_D + t_{rd} \cdot I_d + t_{rR} I_R) + \right.$$

$$\left. \frac{(F_s \cdot a_{gD} \cdot I_D + a_{gd} \cdot I_d + a_{gR} I_R)}{(1 + h_{o,g}/h_{i,g})} + U(T_o - T_i) \right]_k \qquad (2.20)$$

where,

$$U = \frac{1}{\left(\dfrac{1}{h_{i,g}} + \dfrac{1}{h_{o,g}}\right)}$$

$$N = \text{number of windows and doors.}$$

The details of windows and doors are given in Appendix-E.
The total heat transfer through the structure is given
by the sum of equations (2 9) and (2.20) as:

$$\dot{Q}_{st} = \dot{Q}_t + \dot{Q}_g \qquad (2.21)$$

2.8 INFILTRATION LOAD

Infiltration is the leakage of outdoor air into
a building through cracks and opening caused by pressure
difference across the boundary surfaces. The net exchange
of air may lead to both heat and moisture gain for the
space   The volume of infiltration is related in terms of
the room volume and tabular values are available in [3].
The expression for the infiltration load is

$$\dot{Q}_{infil} = \frac{V_{room}}{V_{air}} \times N_{ACH} (h_a - h_{i,a})/24, k\ W \qquad (2.22)$$

where V_{room} is the volume of the room, V_{air}, is the
specific volume of air at outside temperature, N_{ACH} is
the number of air changes/day, h_a and h_i, are the enthalpies
of outside and inside air, respectively.

2.9 VENTILATION LOAD.

The introduction of outside air into the conditioned
space is an important factor, which is necessary to maintain
oxygen and odour levels as per standard practice. Ventilation

codes and standards recommend a minimum rate of 30 cfm/ person. But the recent analysis shows that it is more efficient at 5 cfm/person [19] on the basis of economic consideration. Since the present problem deals with economic aspect, this value has been adopted for the ventilation load calculation, which is given by

$$\dot{Q}_{ventil} = \frac{N_{occupants}}{v_{air}} \times (Ventil/person) \times (h_a - h_{i,a})$$

(2.23)

where v_{air} is the specific volume of air and h_a, $h_{i,a}$ are the enthalpies of outside and inside air.

2.10 MISCELLANEOUS LOAD:

Apart from transmission, there is a considerable amount of heat energy generated inside the conditioned space from the occupants, lights, electrical equipments and appliances. The thermal energy release from human body at different degree of activities is taken from [12,17] In the present analysis, the degree of activity is taken as the average of all activities and the corresponding heat release has been calculated. The instant rate of heat gain from lights and other electrical appliances are calculated as,
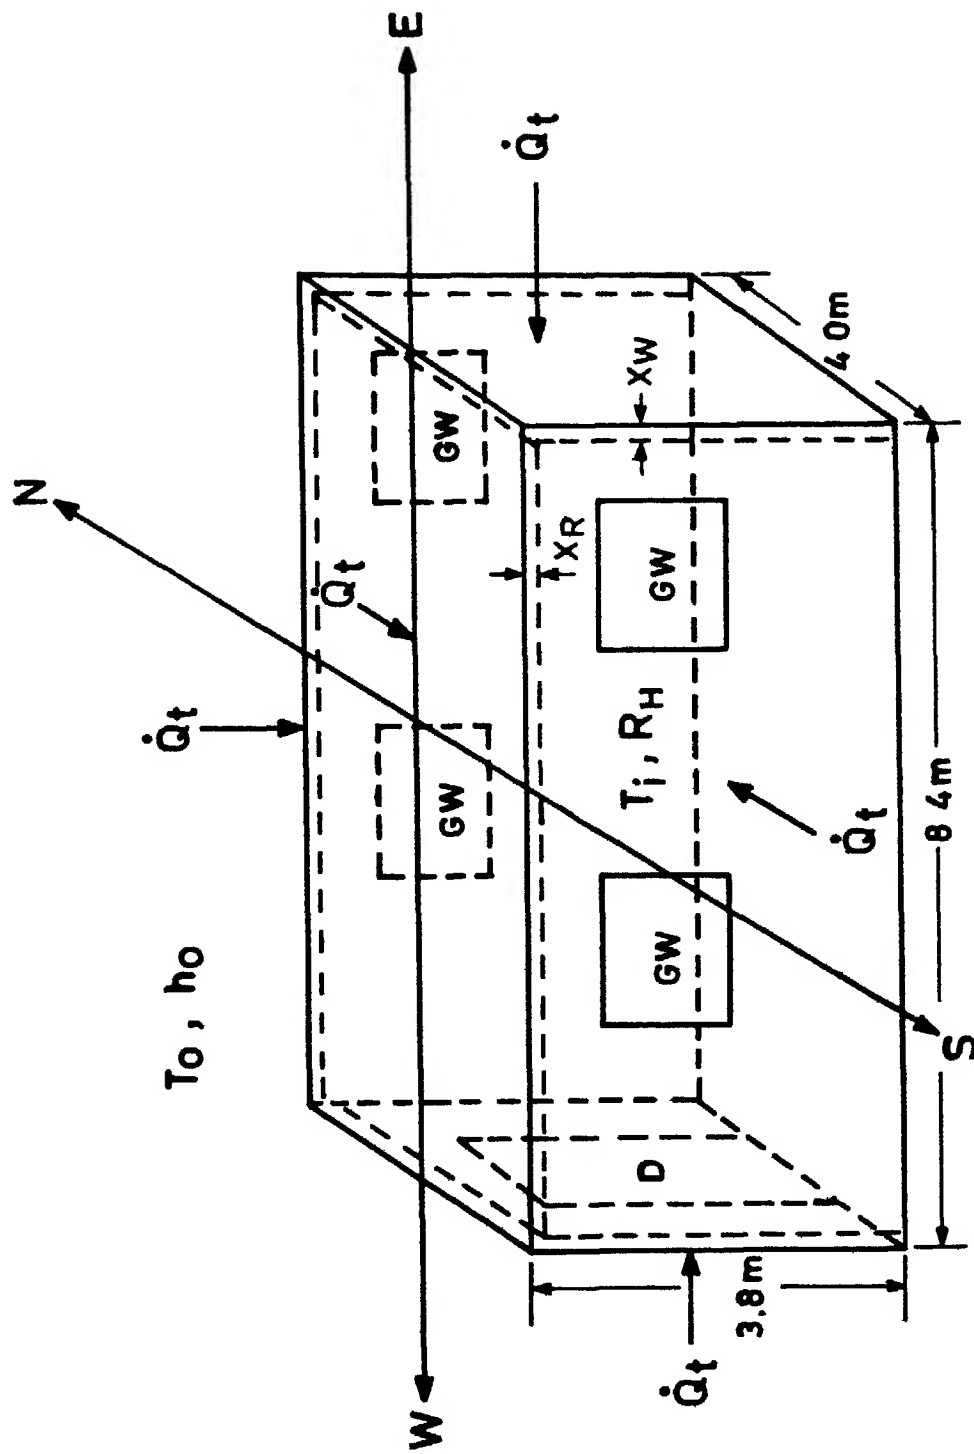
D - DOOR, GW - GLASS WINDOW, x_W - 0 4 m , x_R - 0 2 m

Fig 2 3 Building model for cooling load estimation

$$Q_{elec} = \text{(Number of electrical appliances x rating of the appliances)} + \text{(Number of lights x ratings) x cooling load factor}$$

(2.24)

In the present work, the cooling load factor is taken as 0.88 [15] . So the miscellaneous load is calculated as

$$\dot{Q}_{misc} = \dot{Q}_{elec} + \dot{Q}_{occupants}$$

(2.25)

The total cooling load is calculated from

$$\dot{Q}_{total} = \dot{Q}_{st} + \dot{Q}_{infil} + \dot{Q}_{ventil} + \dot{Q}_{misc}$$

(2.26)

Using this procedure, in the present analysis, hourly cooling load calculations have been carried out for a building model, Fig.2.3, for Kanpur. For this estimation, a generalized computer programme has been developed with great care and is given in Appendix-G.

CHAPTER 3

PROBLEM FORMULATION AND OPTIMIZATION

3.1 INTRODUCTION

The problem formulation for optimization is done on the basis of total cooling load based on the design condition for the equipment selection. The total cost calculated on the basis of fixed and running costs for comfort airconditioning constitutes the objective function in terms of the operating variables having a set of constraints. The optimization problem can be stated as

$$\vec{X} = \begin{bmatrix} X_1 \\ X_2 \\ \bullet \\ \bullet \\ X_n \end{bmatrix}$$ which maximizes or minimizes $f(\vec{X})$ subject to

the constraints $g_m(\vec{X}) \leq 0$, $m = 1,2,\ldots n_1$, where $\vec{X}$ is an n-dimensional vector called as the design vector, $f(\vec{X})$ is the objective function and $g_m(\vec{X})$ are the constraints .

3.2 DESIGN VARIABLES.

Any engineering system is described by a set of quantities some of which are viewed as variables during the design process. In general, certain quantities are usually fixed at the outset, known as preassigned parameters and all the other quantities are treated as variables in the design process and collectively represented by the vector $\vec{X}$. Even though there are many variables which control
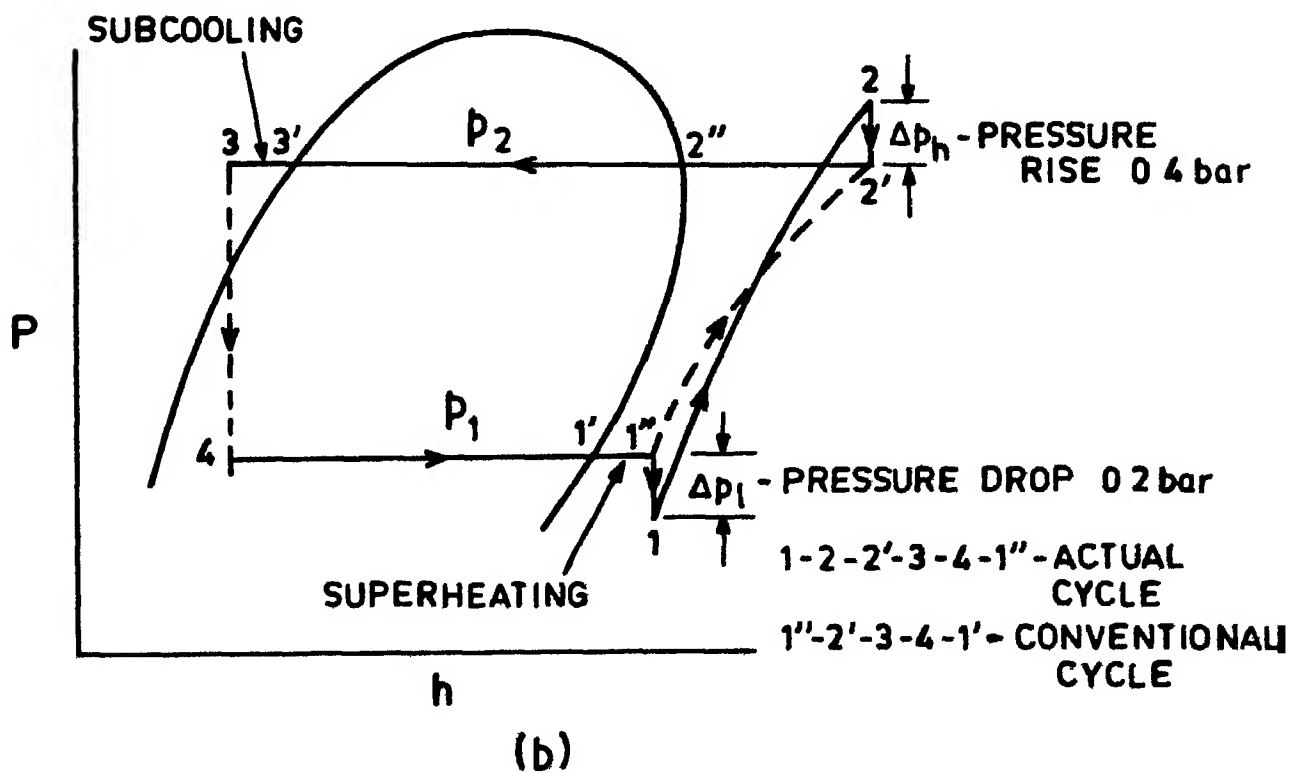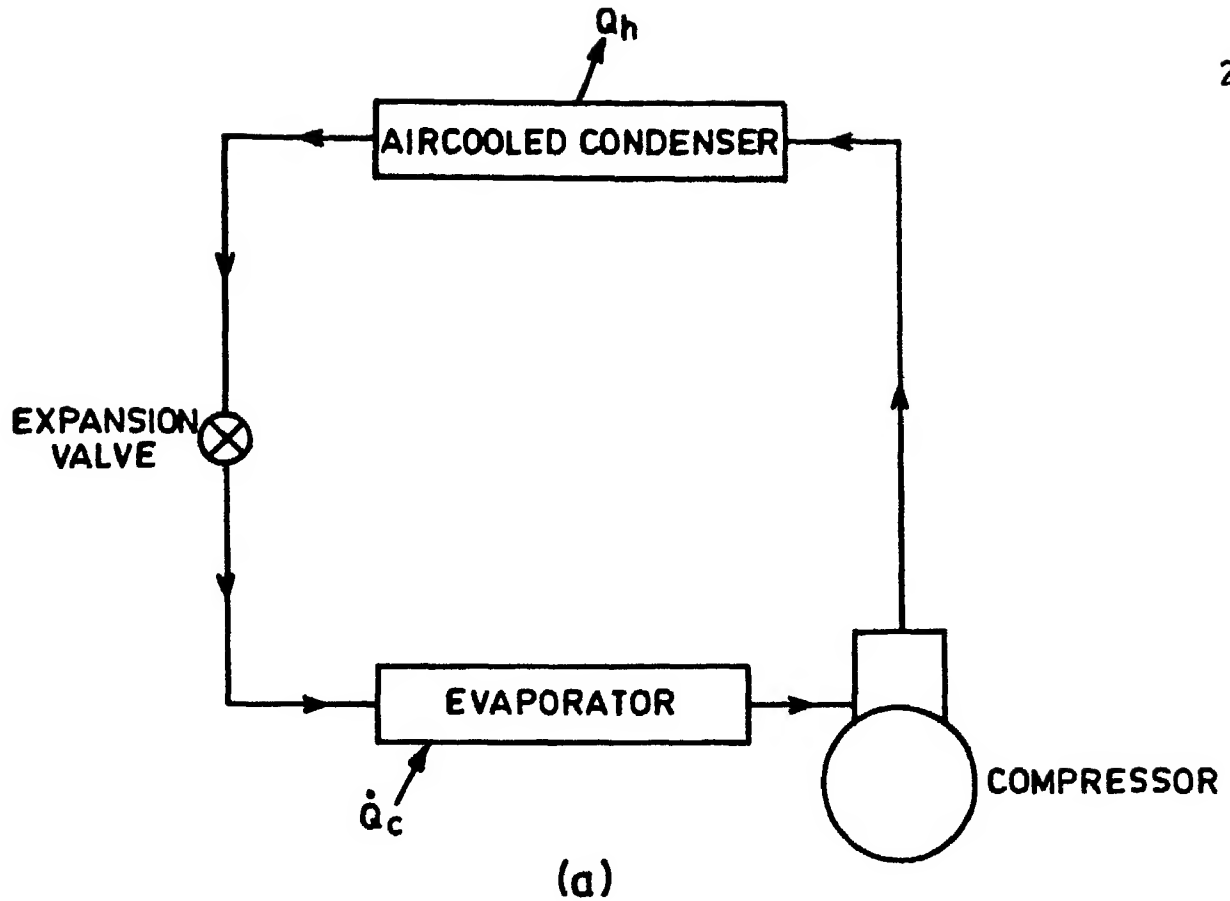
Fig 3 1 (a) Single-stage vapour-compression system
(b) P-h diagram for single-stage vapour-compression cycle

the airconditioning performance, inclusion of all these
variables will lead to enormous computational effort.
Here, an optimal prediction effort has been made to
select the variables judiciously.

3.3   SYSTEM DESCRIPTION

In the present study, a single-stage vapour
compression refrigeration system is taken for the
analysis having refrigerants R-12 and R-22. The cycle
is shown schematically in Fig.3 1. To simulate the cycle
close to represent actual processes, a pressure drop in
the compressor valves, heat rejection in the compression
discharge line and the degrees of subcooling of condensate
and superheating of evaporator vapour are considered.
The pressure drops in the condenser, evaporator and
piping are ignored. In the present analysis, air-cooled
condenser has been incorporated in the system.

In the design of the cycle, the pressure drop at
the suction line is assumed as 0.2 bar   [17]. The
increase in pressure at the delivery of the compressor
is taken as 0.4 bar   [17] . In the present optimization
analysis, four variables are considered. They are ,

$X(1)$:   Degrees of rise in the condensing temperature,
T_h, °C

$X(2)$:   Degrees of fall in evaporator temperature,
T_1, °C

X(3)   Degree of superheating, T_s, °C

X(4)   Degree of subcooling, T_c, °C.

3.4 ESTIMATION OF OBJECTIVE FUNCTION.

In the present study, the objective function is taken as the total cost for the comfort airconditioning system, which combines the initial and running costs of the system. If C_I and C_R are the initial and running costs per year respectively, then the total cost/year (C_T) is given by

$$C_T = C_I + C_R, \text{ Rs/year} \qquad (3.1)$$

where $C_I = C_{comp} + C_{evap} + C_{cond} + C_{blower}$ 3.1(a)

C_{comp} = Cost of the compressor, Rs/year

C_{evap} = Cost of the evaporator, Rs/year

C_{cond} = Cost of the condenser, Rs/year

C_{blower} = Cost of the blower   , Rs/year

and $C_R = C_1 + C_2 + C_3 + C_4$ 3.1(b)

C_1 = Cost of the compressor power, Rs/year

C_2 = Cost of the blower power,   Rs/year

C_3 = Cost of the fan power,   Rs/year

C_4 = Maintenance cost,   Rs/year.

The 'Present Worth Method' is used for the analysis of the economic model.

3.5   OPTIMIZATION TECHNIQUE

The presence of constraints in a nonlinear progra-
mming problem creates more problems while finding the
minimum. Several situations can be identified depending
on the effect of constraints on the objective function.
The simplest situation is when the constraints do not
have any influence on the minimum point. From the
application point of view on the real problems, there is
a possibility of having two or more local minima for
the minimisation of the problem. This situation is entirely
due to the nature of the objective function contours. By
taking into account of all these possibilities, in the
present analysis, one of the indirect methods of non-linear
programming constrained optimization technique, known as
'Interior Penalty Function' [16] is used.

3.5.1   THE PENALTY FUNCTION APPROACH :

Penalty Function Methods transform the basic
optimization problem into alternative formulations such
that numerical solutions are sought by solving a sequence
of unconstrained minimization problem. For analysis
purposes, a basic optimization problem is taken such that
$\vec{X}$ minimizes the objective function, $f(\vec{X})$ subject to the
constraints $g_m(\vec{X}) \leq 0$, $m = 1,2,\ldots n_1$. This problem
is converted into a unconstrained minimization problem by:

$$\emptyset_k = \emptyset(\vec{X}, r_k) = f(\vec{X}) + r_k \sum_{j=1}^{n_1} G_j [g(\vec{X})] \qquad (3.2)$$

where G_j is the function the constraints, $g(\vec{X})$, and r_k is the positive constant known as the 'Penalty Parameter'. The function, $\emptyset(\vec{X}, r_k)$, is optimised for a decreasing sequence values of the penalty parameter, r_k. Evidently, if the 'r_k' is very small, the optimization of $\emptyset(\vec{X}, r_k)$ amounts to optimization of the objective function, $f(\vec{X})$.

3.5.2 INTERIOR PENALTY FUNCTION METHOD:

In this method, the function $G_j[g(\vec{X})]$ of the equation (3.2), is substituted by $- \dfrac{1}{g_m(\vec{X})}$. The unconstrained minima of $\emptyset(\vec{X}, r_k)$, all lie in the feasible region and converge to the solution of $f(\vec{X})$ as r_k is varied in the decreasing sequence. So the function $\emptyset(\vec{X}, r_k)$ is defined as,

$$\emptyset(\vec{X}, r_k) = f(\vec{X}) - r_k \sum_{m=1}^{n_1} \frac{1}{g_m(\vec{X})} \qquad (3.3)$$

Here, the values of function $\emptyset$ will always be greater than f, since $g_m(\vec{X})$ is negative for all feasible points, $\vec{X}$. Since the unconstrained minimization of $\emptyset(\vec{X}, r_k)$ is to be achieved by changing the sequence of penalty parameter, r_k, in the decreasing order, its initial value should be chosen such that quick convergence is obtained.

Thus, for any feasible starting point, $\vec{X}_1$, the value of r_1 can be taken as,

$$\frac{0.1 \ f \ (\vec{X}_1)}{- \overset{n_1}{\underset{m=1}{\Sigma}} \ \frac{1}{g_m \ (\vec{X}_1)}} \ \leq \ r_1 \ \leq \ \frac{f \ (\vec{X}_1)}{- \overset{n_1}{\underset{m=1}{\Sigma}} \ \frac{1}{g_m(\vec{X}_1)}} \qquad (3.4)$$

Once, the initial value of r_k is chosen, the subsequent values of r_k have to chosen such that

$$r_{k+1} \ < \ r_k \qquad\qquad\qquad 3.5(a)$$

In this regard, for convenience purposes, it is taken as,

$$r_{k+1} \ = \ D \ r_k, \ \ \text{where} \ 0 < D < 1 \qquad\qquad 3.5(b)$$

where in the present analysis, D has been taken to be 0.1.

In the present analysis, the unconstrained minimization of the penalty function $\emptyset(\vec{X}, \ r_k)$ is done by 'Davidon-Fletcher-Powell's Method' [16]. This is the best general purpose optimization technique making use of the derivatives that is currently available. The algorithm for this iterative technique is as follows:

(a) Start with an initial feasible point $\vec{X}_1$ and a nxn positive definite symmetric matrix, $[H_1]$ which is taken as $[I]$.

(b) Compute the gradient of the function, $\nabla \emptyset_1$ at the point $\vec{X}_1$ and set $S_1 = - [H_1] \cdot \nabla \emptyset_1$. Normalising this, we obtain, $S_{N1} = \dfrac{S_1}{\sum\limits_{1=1}^{n}[(\nabla \emptyset_1)^2]^{1/2}}$, where 'n' is the number of variables.

In the present formulation, central difference scheme has been adopted for gradient evaluation.

(c) Find the optimal step length T_1^* in the direction of S_{N1} and set $\vec{X}_{1+1} = (\vec{X}_1 + T_1^* S_{N1})$. In the present study, the determination of T_1^* is done by 'Cubic Interpolation Method' [16].

(d) Test the new point $\vec{X}_{1+1}$ for optimality using the condition $\dfrac{(\nabla \emptyset_{1+1} - \nabla \emptyset_1)}{\nabla \emptyset_1} \leq \varepsilon_1$, where ε_1 is very small. In the present case, the termination criteria is $\varepsilon_1 \leq 10^{-3}$. If this criteria is not satisfied [H] is updated as follows

$$[H_{1+1}] = [H_1]+[M_1]+[N_1]$$

where,

$$M_1 = \frac{T_1^* \cdot S_{N1} \cdot S_{N1}^T}{(S_{N1}^T \cdot Q_1)}$$

$$N_1 = \frac{-(H_1 Q_1)(H_1 \cdot Q_1)^T}{(Q_1^T \cdot H_1 \cdot Q_1)}$$

$$Q_1 = \nabla \emptyset (X_{1+1}) - \nabla \emptyset(X_1) .$$

Fig 3 2 Flow chart for the interior penalty function method
using Davidon-Fletcher-Powell's unconstrained
optimisation technique

START WITH AN INTERIOR FEASIBLE POINT $\vec{X_i}$

SET $I=1$, $K=1$

CALCULATE THE VALUES OF OBJECTIVE FUNCTION AND CONSTRAINTS GG (M)

CALCULATE $\phi(X, R_K) = f(\vec{X}) - R_K \sum_{M=1}^{M} 1/GG(M)$ HERE, R_1 IS TAKEN AS $-CX$ OBJ FUN/GG(M) WHERE, $0 < C < 1$

FIND $\phi(\nabla X_1) = \nabla\phi(\vec{X_1})$ SET $S_1 = -[H_1] \times \nabla\phi(\vec{X_1})$ WHEN $I=1$, $[H]=[I]$

SET $\vec{X}_{I+1} = \vec{X}_I + (T_I)S_I$ WHEN $I=1$, $T=1$

FIND $\nabla\phi_{I+1} = \phi(\vec{X}_{I+1})$

IS $\dfrac{\nabla\phi_{I+1} - \nabla\phi_I}{\nabla\phi_I} \leqslant \epsilon_I$ YES

NO

$Q_I = \nabla\phi_{I+1} - \nabla\phi_I$

FIND T_I^* BY CUBIC INTERPOLATION METHOD

CALCULATE $[M_I] = T_I^* (S_I)(S_I^T)/(S_I^T)(Q_I)$ $[N_I] = -(H_I Q_I)(H_I Q_I)^T/ H_I Q_I^T$

SET $[H_{I+1}] = [H_I] + [M_I] + [N_I]$

SET $\vec{X}_I^* = \vec{X}_{I+1}$ $[H_I] = [H_{I+1}]$ $\nabla\phi_I^* = \nabla\phi_{I+1}$

IS $I \leqslant N$ WHERE N IS THE ITERATION LIMIT   YES

NO

SET $R_{K+1} = (C)(R_K)$ WHERE $0 < C < 1.0$

$\vec{X}_{OPTIMUM} = \vec{X}_{I+1}$ $f_{optimum} = f_{I+1}$

SET $R_K = R_{K+1}$

Fig 3 2 Flow chart for the interior penalty function method
using Davidon-Fletcher-Powell's unconstrained
optimisation technique

ENTER WITH $\vec{X}$, S AND T_0
HERE $T_0 = 1.0$

SET $f_A = f(0)$, $f(0)$, $f'_A = f'(0)$ AND $A = 0$

SET $f_B = f(T_0)$ AND $f'_B = f'(T_0)$

SET $T_0 = 2T_0$

IS $f'_B > 0$

YES

NO

SET $I = 0$
$B = T_0$

SET $f_A = f_B$; $f'_A = f'_B$,
$A = T_0$

CALCULATE

$$Z = 3(f_A - f_B)/(B - A) + f'_A + f'_B$$

$$Q = \sqrt{(Z^2 - f'_A f'_B)}$$

$$T^* = A + (f'_A + Z - Q)(B - A)/f'_A + f'_B + 2Z$$

SET $I = i + 1$

IS $\left| \dfrac{H(\tilde{T}^*) - f(\tilde{T}^*)}{f(\tilde{T}^*)} \right| \leqslant \epsilon_1$

NO

YES

IS $\left| \dfrac{S^T \cdot \nabla f}{|S| \cdot |\nabla f|} \right|_{\tilde{T}^*} \leqslant \epsilon_2$

NO

YES

$T^* = \tilde{T}^*$
STOP

IS $I \geqslant I_{MAX}$

YES

NO

IS $S^T \cdot \nabla f |_{\tilde{T}^*} < 0$

YES

NO

SET $A = \tilde{T}^*$
$f_A = f(\tilde{T}^*)$
$f_A = f'(\tilde{T}^*)$

SET $B = \tilde{T}^*$
$f_B = f(\tilde{T}^*)$
$f_B = f'(\tilde{T}^*)$

Fig 3.3 Flow chart for cubic interpolation

(e) Set the iteration number as i = i+1 and
repeat the procedure from the step 'b', until convergence
is achieved. Flow charts for 'Interior Penalty Function
Method' and 'Cubic Interpolation' are schematically presented
in Figs. 3.2 and 3.3, respectively.

3.6 ESTIMATION OF LOADS ON EACH COMPONENT OF THE SYSTEM.

The components of a refrigeration system have to
be selected on the basis of the design conditions. The
power requirements of the apparatus are evaluated for
the design conditions and a factor of safety is multiplied
to ensure the capacities of various components from
the safety point of view. The condensing and evaporator
temperatures of the vapour-compression systems are considered
to be the sole factors which influence effectively the
design of the airconditioning system. The evaporator
temperature is selected on the basis of the indoor conditions
whereas the condensing temperature is selected on the
basis of design temperature.

So the condenser temperature is taken as,

$$T_h = T_o + \Delta T_a + X(1) \qquad\qquad (3.6)$$

where,

T_o = the design outside air temperature, °C

ΔT_a = the approach temperature of the condenser, °C

$X(1)$ = degrees of rise in condensing temperature,
taken as a variable, °C.

CONDENSER

HOT AIR

TUBE CROSS-SECTION

EVAPORATOR

CONDITIONED AIR

AMBIENT AIR

P_d

P_s

B_2

B_1

C

E_1

S_1

S_2

E_2

E_3

H_1

F

B_1 - AXIAL-FLOW FAN B_2 - CONDENSER FAN

C - COMPRESSOR   F - FILTER

E_1, E_2, E_3 - CAPILLARY TUBES S_1, S_2 - SOLENOID VALVES

P_d - DISCHARGE PRESSURE GAUGE P_s - SUCTION PRESSURE GAUGE

H_1 - HOKE VALVE
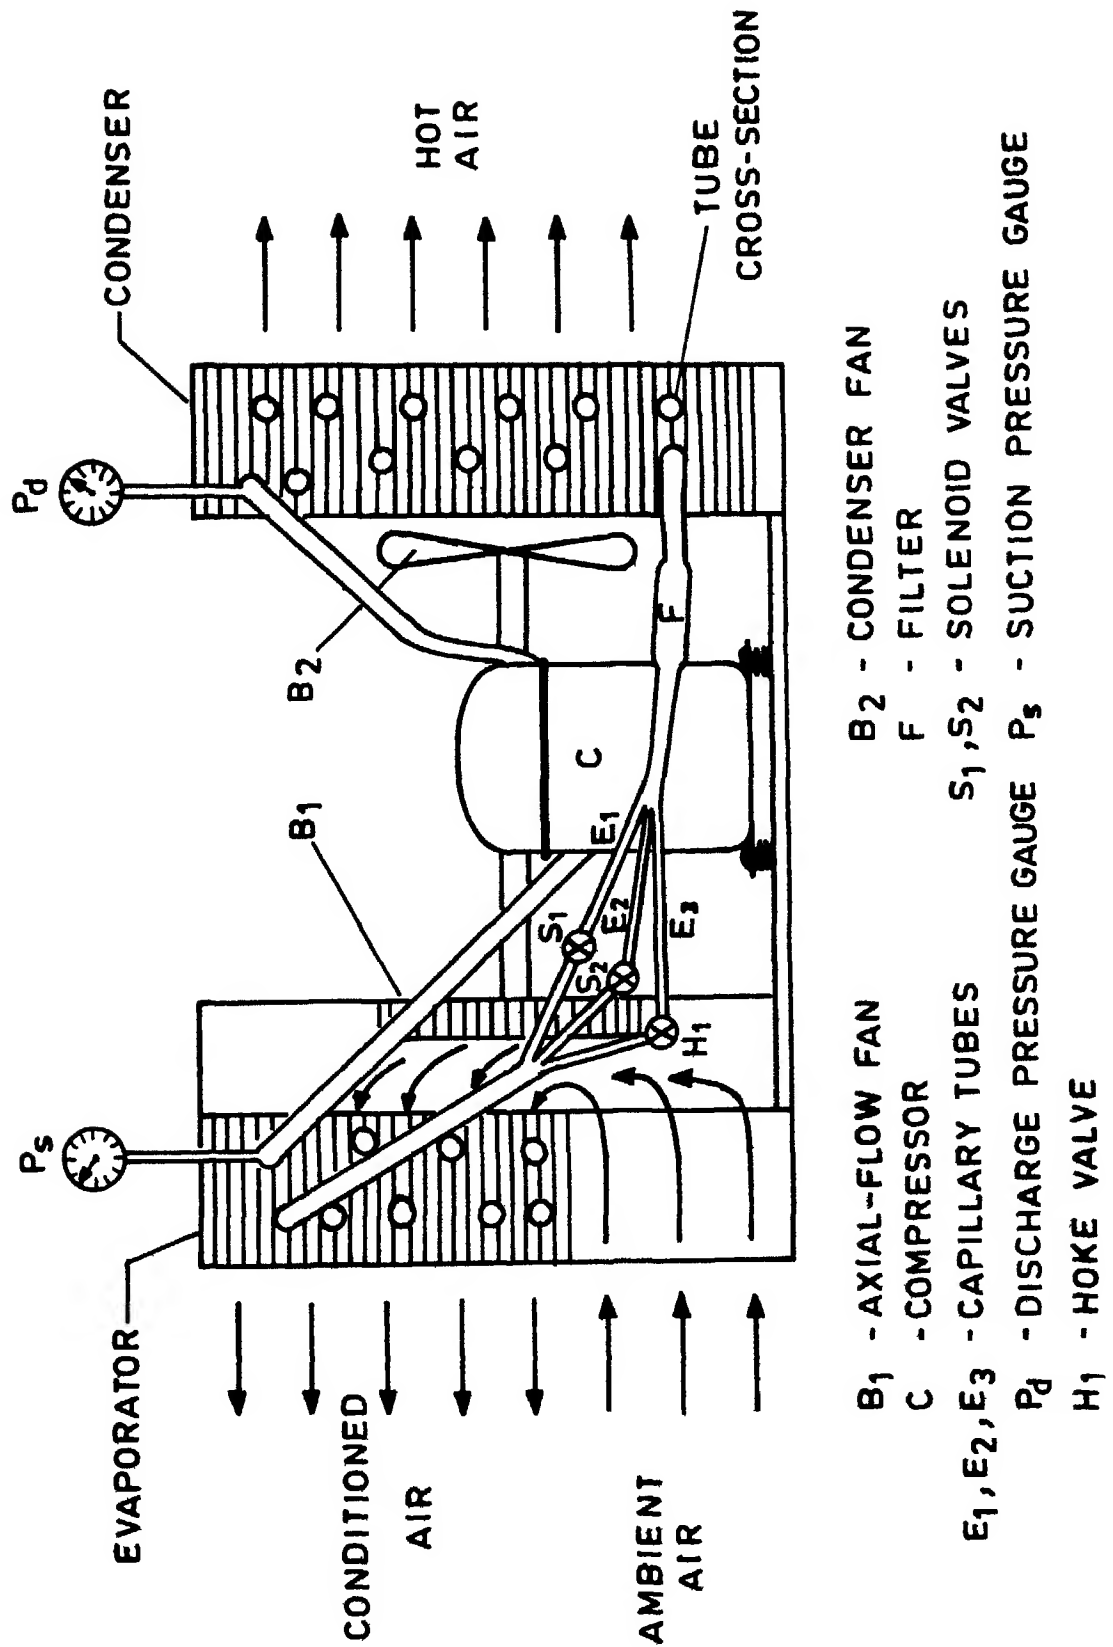
Fig 3.4 Experimental set-up of an airconditioner.

The evaporator temperature is chosen on the basis of inside room temperature. So it is taken as,

$$T_1 = T_1 - \Delta T_a - X(2) \qquad\qquad (3.7)$$

where,

T_1 = the inside room temperature, °C

ΔT_a = the approach temperature, °C

$X(2)$ = the variation in the lower temperature which is taken as a variable, °C.

In the present analysis, the values of the approach temperature have been as 6°C, 10°C and 14°C. To justify these values, experiment has been done on an airconditioner. The pressure gauges were fitted in the suction and discharge line, Fig. 3.4. The airconditioner has been operated and temperatures of air leaving the condenser and evaporator were taken. The air was supplied to both at about 30°C. The average approach temperatures for the condenser and evaporator sides were found to be about 10°C.

The value of T_1 is also checked up in the basis of the apparatus dew point temperature, T_{adp}. Because the lower temperature, T_1, should always be less than T_{adp}. The T_{adp} is calculated in terms of effective sensible heat factor, ESHF, which is given by

$$ESHF = \frac{1\ 026\ (T_1 - T_{adp})}{1\ 026\ (T_1 - T_{adp}) + 2410\ (W_1 - W_{adp})}$$

(3.8)

where,

$$ESHF = \frac{ERSH}{(ERSH + ERLH)}$$

$$ERSH = RSH + (BPF) \cdot OASH$$

$$ERLH = RLH + (BPF) \cdot OALH$$

W_1 = Specific humidity inside the room,kg/kg of dry air

W_{adp} = Specific humidity at apparatus dew point temperature, kg/kg of dry air.

RSH and RLH represent the room sensible and latent heats respectively. OASH and OALH denote the outside air sensible and latent heats, respectively. The effect of the bypass factor (BPF) on the performance of the cooling apparatus is discussed in [4] and 0.15 is the value recommended for row coil. By using Newton-Raphson iterative procedure, the value of T_{adp}, is obtained,for the known values of ESHF.

Referring to the Fig.3.1, after taking the degree of superheat X(3), the temperature at the state point '1' is given by,

$$T_1 = T_1 + X(3) - \Delta T_1$$

(3.9)

where ΔT_1 is the decrease in the lower temperature befo_e compression, °C.

$$\text{Similarly,} \quad T_2 = T_h + \Delta T_h \tag{3.10}$$

where ΔT_h is the increase in the condensing temperature after compression, °C.

The enthalpy values, h of the refrigerants, R-12 and R-22, have been computed from the functional relations of the temperature of the state. These relations are given in the Appendix-F.

$$\text{From the Fig. 3.1,} \quad T_3 = T_3' - X(4) \tag{3.11}$$

where $X(4)$ is the degree of subcooling, °C.

The mass flow rate of the refrigerants, $\dot{m}_{ref}$, is found from

$$\dot{m}_{ref} = \frac{\dot{Q}_c \times SF}{(h_1 - h_4)} \tag{3.12}$$

where $\dot{Q}_c$ is the cooling load as given in Sec.2.10 and SF is the factor of safety taken as 1.25 [4].

The compressor power is given by.

$$P_{comp} = \frac{\dot{m}_{ref} (h_2 - h_1)}{\eta_m} \quad , \text{kW} \tag{3.13}$$

where η_m is the mechanical efficiency of the compressor taken as 0.85 [12].

For the air-cooled condenser, the load is

$$\dot{Q}_{cond} = \dot{m}_{ref} (h_2 - h_3), \text{kW} \tag{3.14}$$

having $h_2 = h_1 + (\Delta h)_{isentropic} / \eta_c$.

The equation (3.13) can also be equated to the heat gain by the cooling air as

$$\dot{Q}_{cond} = \dot{m}_{air} \times c_{p_{air}} (T_{o,c} - T_{air,1}) , kW \qquad 3.15(a)$$

where,

$\dot{m}_{air}$ mass flow rate of cooling air, kg/s

$c_{p_{air}}$ specific heat of air, kJ/kg.°C

$T_{o,c}$ the outlet temperature of the air,°C

$T_{air,1}$ the inlet temperature of the air,°C.

In the above equation, the temperature differential is also equal to the variation in the condensing temperature (T_h) denoted by X(1). So the equation 3.15(a) can be rewritten as,

$$\dot{Q}_{cond} = \dot{m}_{air} \times c_{p_{air}} \times X(1), kW \qquad 3.15(b)$$

By combining equations 3.14 and 3.15b,

$$\dot{m}_{air} = \frac{\dot{m}_{ref} (h_2 - h_3)}{c_{p_{air}} \times X(1)} , kg/s \qquad (3.16)$$

From equation (3.16), the volume of the air handled by the fan for the condenser is calculated as,

$$Vol_{air} = \frac{\dot{m}_{air} \times 60}{\rho_{air}} , m^3/min \qquad (3.17)$$

The fan power is correlated with its capacity (m^3/min) in the form of a quadratic equation. For the purpose, a
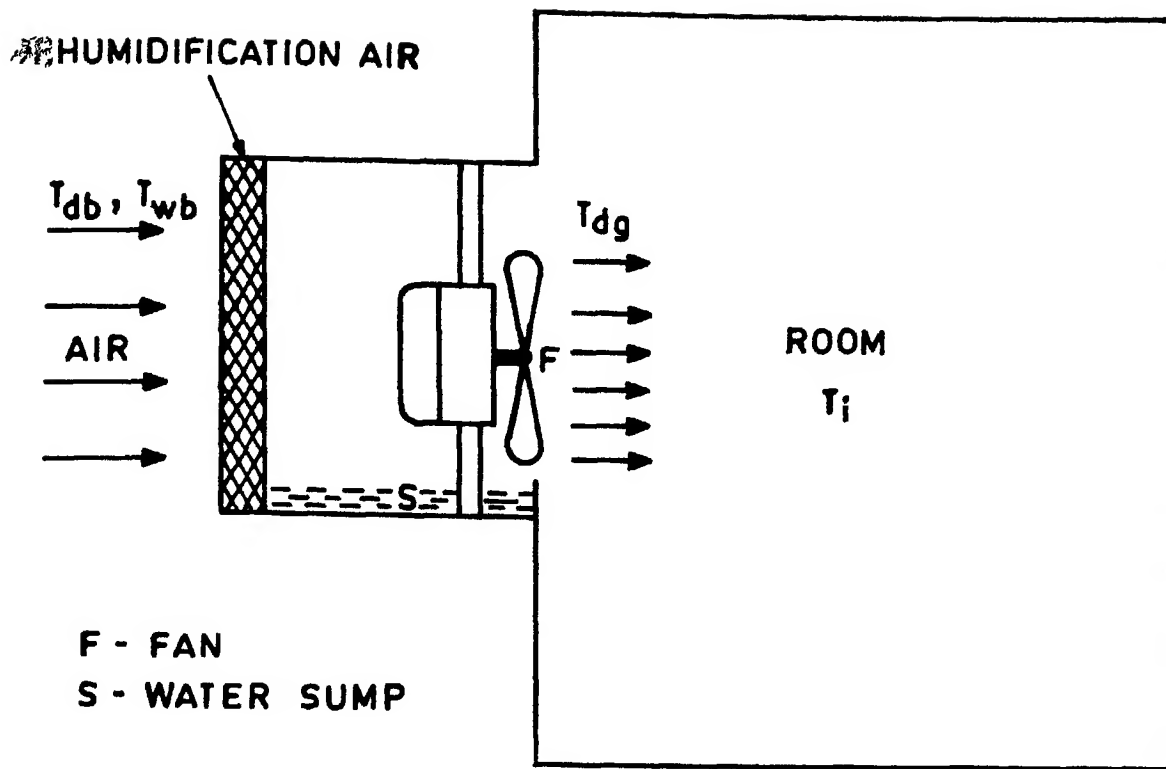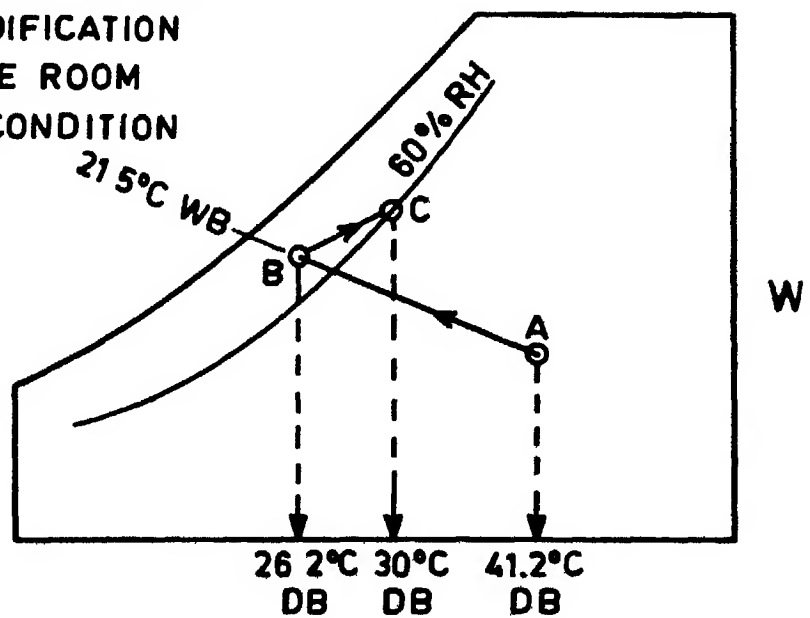
Fig 3.5 (a) Evaporative cooling arrangement in room
     (b) Evaporative cooling process.

set of volume flow rate and power consumption readings
have been taken for three blowers, experimentally.
These readings are plugged in the quadratic equation
and they have been solved for the constants. So this
procedure finally results in the form

$$P_{blower} = \frac{3.429 \, (Vol_{air})^2 + 1.143 \, (Vol_{air}) + 37.67}{1000 \times \eta_m} \, , \, kW$$

$$(3.18)$$

where,

Vol_{air} = The volume flow rate of air, m^3/s

η_m = The mechanical efficiency of the fan (0.85)

3.7 EVAPORATIVE COOLING PROCESS

Figure 3.5(a) exhibits the evaporative cooling
arrangement for the room. The unsaturated outside air
comes in contact with the wetted surface where the evapo-
ration of the water lowers the humidified air temperature.
This process is schematically represented by process AB
in 3.5 (b). The temperature of the humidified air is
related to the desert cooler efficiency (η_D) as

$$T_{dg} = T_{db} - \eta_D \, (T_{db} - T_{wb}) \qquad\qquad (3.19)$$

where,

T_{db} = dry bulb temperature of the outside air, $^\circ C$

T_{wb} = wet bulb temperature of the outside air, $^\circ C$

T_{dg} = dry bulb temperature of the air leaving the desert cooler, $^\circ C$.

The volume of humidified air for the airconditioning is calculated from:

$$V_{d,air} = \frac{\dot{Q}_c}{\rho_{air} (h_{a,o} - h_{a,i})}$$

$$= \frac{\dot{Q}_c}{\rho_{air} \cdot 1.026 \cdot (T_i - T_{dg})} \qquad (3.20)$$

where ρ_{air} is the density of the humid air.

3.8 CONSTRAINTS FOR THE PROBLEM.

As mentioned earlier, four variables, being restricted between some practical values, are taken into consideration for the optimization. So, these constraints are mathematically expressed as follows:

$$4.0 \leq X(1) \leq 15.0 \qquad 3.21(a)$$

$$2.0 \leq X(2) \leq 5.0 \qquad 3.21(b)$$

$$1.0 \leq X(3) \leq 4.0 \qquad 3.21(c)$$

$$1.0 \leq X(4) \leq 4.0 \qquad 3.21(d)$$

The constraints are transformed into equality constraints by taking the lower and upper limits, separately. As a result, they are transformed in the following form.

$$GG(1) = 4.0 - X(1) \qquad 3.22(a)$$

$$GG(2) = X(1) - 15.0 \qquad 3.22(b)$$

$$GG(3) = 2.0 - X(2) \qquad 3.22(c)$$

$$GG(4) = X(2) - 5.0 \qquad 3.22(d)$$

$$GG(5) = 1.0 - X(3) \qquad 3.22(e)$$

$$GG(6) = X(3) - 4.0 \qquad 3.22(f)$$

$$GG(7) = 1 0 - X(4) \qquad 3.22(g)$$

$$GG(8) = X(4) - 4.0 \qquad 3.22(h)$$

After normalising the equations, the constraints are considered for the optimization of the problem.

3.9 ESTIMATION OF INITIAL COST

As mentioned in Sec. 3.6, the design cooling load is calculated for Kanpur, in May as in [9] . After evaluating these loads, the equipments are selected on the basis of their capacities. In this regard, a due consideration has been given to purchase the equipments on the basis of recommended capacity ranges available in the market. A stepwise variation is adopted for the costs and capacities of the various equipments. This feature is very well incorporated in the computer programme.

Thus, the total initial cost for the system is expressed as

$$CI = (C_{comp} + C_{evap} + C_{cond} + C_{blower}) \times MF/L_s$$

$$(3.23)$$

where,

C_{comp} = cost of the compressor, Rs

C_{evap} = cost of the evaporator, Rs

C_{cond} = cost of the condenser, Rs

C_{blower} = cost of the blower, Rs

MF = Multiplication factor to take care of the miscellaneous cost (1.2)

L_s = life of the system, years.

When a hybrid system $\overset{of}{\diagup}$ airconditioning and desert cooler

is adopted between the months April and June, if feasible,

the initial cost, C_I', is considered to be higher and

given by,

$$C_I' = C_I + C_{Desert}/L_d \qquad\qquad (3.24)$$

where,

C_I = initial cost of the airconditioning system, Rs/year

C_{Desert} = cost of the desert cooler, Rs

L_d = life of the desert cooler , years.

In the present work, both these cases are studied

separately and results are compared.

3.10 ESTIMATION OF RUNNING COST.

For the running cost, the electricity cost is the

primary factor to be considered. Keeping in view, the

variation in electricity cost, a futuristic statistical

approach has been adopted to make the whole formulation

as a generalised algorithm [13] . Proceeding as in [13],

the electric charge,(C_e),is found to be:

$$C_e = \frac{1.293}{0.97986 + \exp\,(-0.09338\ I)} \tag{3.25}$$

where, I refers to the duration of the years from the present one.

The effective electricity cost is given by [15]

$$C_E = \frac{1}{L} \sum_{i=1}^{L} \frac{C_e}{(1+R)^{i-1}} \tag{3.26}$$

where,

C_e = cost of electricity in the ith year ,Rs/kWh

R = interest rate

L = life of the machineries, years

So, the running cost for compressor (C_1) is given by,

$$C_1 = P_{comp} \times C_E, \text{ Rs/h} \tag{3.27}$$

For the evaporator fan,

$$C_2 = P_{fan} \times C_E, \text{ Rs/h} \tag{3.28}$$

For the condenser fan,

$$C_3 = P_{fan} \times C_E, \text{ Rs/h} \tag{3.29}$$

The running cost of all these accessories is calculated on the hourly basis by taking into account by sinusoidal variation of outside air temperature and summed upto get the running cost/year. The maintenance cost is taken to be 10% of the initial investment [15].

Mathematically, it can be expressed as[*],

$$C_4 = (\text{4.1}) \quad C_I \quad \frac{(1+P)^L - 1}{R(1+R)^L - 1} \qquad (3.30)$$

The total running cost is given by

$$C_R = C_1 + C_2 + C_3 + C_4, \text{ Rs/year} \qquad (3.31)$$

In the case of combined operation of airconditioning and desert cooler the running cost includes for the desert cooler only for the feasible period during April to June. Then the total running cost becomes,

$$C_R = C_E \times D.C_{rating} + (C_1+C_2+C_3)^{**} + C_4 \qquad (3.32)$$

where C_E the effective electricity cost, Rs/kwh

$D.C_{rating}$ The desert cooler rating, kW.

Thus, the total cost of the system, C_T, is given by

$$C_T = C_R + C_I, \text{ Rs/year} \qquad (3.33)$$

---

[*] In Eq.(3.30) when desert cooler is also used, C_I is replaced by C_I^i of Eq.(3.24).

[**] This operative cost is for the period during which it operates alone.

In the case of hybrid system, it is

$$C_T = C_R + C_I' \quad , \ Rs/year \qquad\qquad (3.34)$$

For generalisation purpose, the equations 3.33 and 3.34 are modified as,

$$\frac{C_T}{C_E} = \frac{(C_R + C_I)}{C_E} \quad , \ kWh/year \qquad\qquad 3.35(a)$$

$$\frac{C_T}{C_E} = \frac{(C_R + C_I')}{C_E} \quad , \ kWh/year \qquad\qquad 3.35(b)$$

Thus the ratio C_T/C_E can be written in functional form as, $C_T/C_E = f(X_1, X_2, X_3, X_4)$, where X_i's are the variables taken for the present study to get the optimum values for the minimum of the ratio C_T/C_E.

In the present analysis, all these possible combinations are incorporated in a generalised computer programme for optimization and the same is incorporated in Appendix-G.

CHAPTER 4

RESULTS AND DISCUSSION

This chapter deals with the calculation of cooling loads on the basis of the theoretical and actual temperature variations having the effect of heat capacity and timelag factor of the structures The economic criterion has been adopted for the optimum choice of the airconditioning systems using R-12 and R-22 refrigerants. A comparison of a hybrid system (evaporative cooling and airconditioning systems) with a conventional airconditioning system is discussed under optimum conditions. For estimation of the optimum cost, C_T/C_E, the life of the airconditioner and the desert cooler are taken as 20 years and 10 years, respectively. The following are the results obtained in the present work.

4.1 THEORETICAL AND ACTUAL TEMPERATURE VARIATION:

Figure 4.1 gives the actual temperature variation with time as well as the suggested sinusoidal variation in temperature based on maximum and minimum temperatures of the day. The actual temperature is slightly higher from 8 A.M. to 3 P M. than the theoretical value before the peak hour. Thereafter, the actual temperature is lower than that of the theoretical value. The areas under both curves reveal small difference (about 4 to 7%). For the airconditioning

TABLE : 4.1(a) : INSIDE CONDITIONS OF 24°C DB AND 65% RH

Year	Outside air temperature variation	Total Running Loads for 10 hours (In kW)						
		April	May	June	July	August	September	October
1982	Actual	88.66	96.29	86.68	69.09	65.17	64.66	47.28
	Theoretical	84.44	88.72	79.64	63.96	64.26	58.19	44.35
	% difference	4.76	7.86	8.12	7.43	1.39	10.01	6.19
1983	Actual	75.34	85.80	79.51	66.20	62.75	58.29	30.29
	Theoretical	70.95	82.39	76.50	60.94	54.01	57.36	29.23
	% difference	5.83	3.97	3.78	7.95	13.92	1.59	3.49
1985	Actual	59.75	84.21	82.32	69.88	71.32	74.01	41.32
	Theoretical	58.29	82.90	78.91	68.32	69.09	71.86	38.10
	% difference	2.48	1.55	4.14	2.23	3.13	2.88	7.79

TABLE:4.1(b) . FOR INSIDE CONDITIONS OF 27.5°C DB AND 56% RH

Year	Outside air temperature variation	Total Running Loads for 10 Hours (In kw)						
		April	May	June	July	August	September	October
1982	Actual	77.05	82.20	75.89	57.24	52.57	51.68	35.78
	Theoretical	72.33	75.68	66.92	51.13	49.65	55.75	33.25
	% difference	6.13	7.93	11.82	10.67	5.55	11.47	7.07
1983	Actual	68.52	78.35	68.91	59.06	55.09	51.64	28.40
	Theoretical	65.71	74.29	63.90	54.66	50.44	49.32	25.36
	% difference	4.10	5.18	7.42	7.45	8.44	4.49	10.7
1985	Actual	55.78	78.92	74.65	66.89	69.19	71.22	38.57
	Theoretical	53.37	76.01	71.92	64.09	67.72	68.82	35.09
	% difference	4.32	3.68	3 66	4.19	2.17	3.49	9.02

TABLE : 4.1(c) : FOR INSIDE CONDITIONS 30°C DB AND 60% RH

Year	Outside air temperature variation	Total Running Loads for 10 Hours (In kW)						
		April	May	June	July	August	September	October
1982	Actual	68.68	73.71	67.68	48.65	43.77	41.47	28.36
	Theoretical	63.58	68.91	58.29	42.27	38.05	36.82	24.64
	% difference	7.43	6.51	13.82	13.11	13.07	11.21	13.12
1983	Actual	55.89	65.88	56.31	46.08	40.5	41.88	18.17
	Theoretical	50.18	61.63	55.34	40.52	35.90	37.58	15.71
	% difference	10.08	6.45	1.70	12.06	11.4	10.26	13.54
1985	Actual	51.02	78.43	72 61	67.45	66.33	69.02	38.11
	Theoretical	49.81	73.92	68.88	62.21	64.66	67.11	37.31
	% difference	2.37	75	5.13	7.77	5.38	2.84	2.10

system, the working hours have been taken to be 8 A.M. to
5 P M [*]   An underestimation of cooling loads by using
sinusoidal variation is found in this.   This deviation is
calculated for three years, 1982, 1983, 1985 and the same
are tabulated in Tables 4.1a to c, for different indoor
conditions.   From these values, the average deviation is
calculated as 6%.   So a multiplier 1.06 can be used to
get the actual total running loads for 10 hours.

The variation in the sol-air temperatures for
different directions is shown in Fig. 4.2.   It indicates
that the maximum sol-air temperature occurs on the western
facing wall at 3 P.M.

4.2   EFFECT OF HEAT CAPACITY AND TIMELAG FACTOR ON THE COOLING LOADS.

Figures 4.3(a) and 4.3(b) represent the effect of
the heat capacity and timelag of the structures on the
hourly cooling load estimation.   From this, it is found out
that the estimation of the cooling load without taking into
account of heat capacity of the structures leads to an
overestimation of 20.29% than that of the cooling load

---

[*]   The computer programme is quite general and can be used
for any duration.
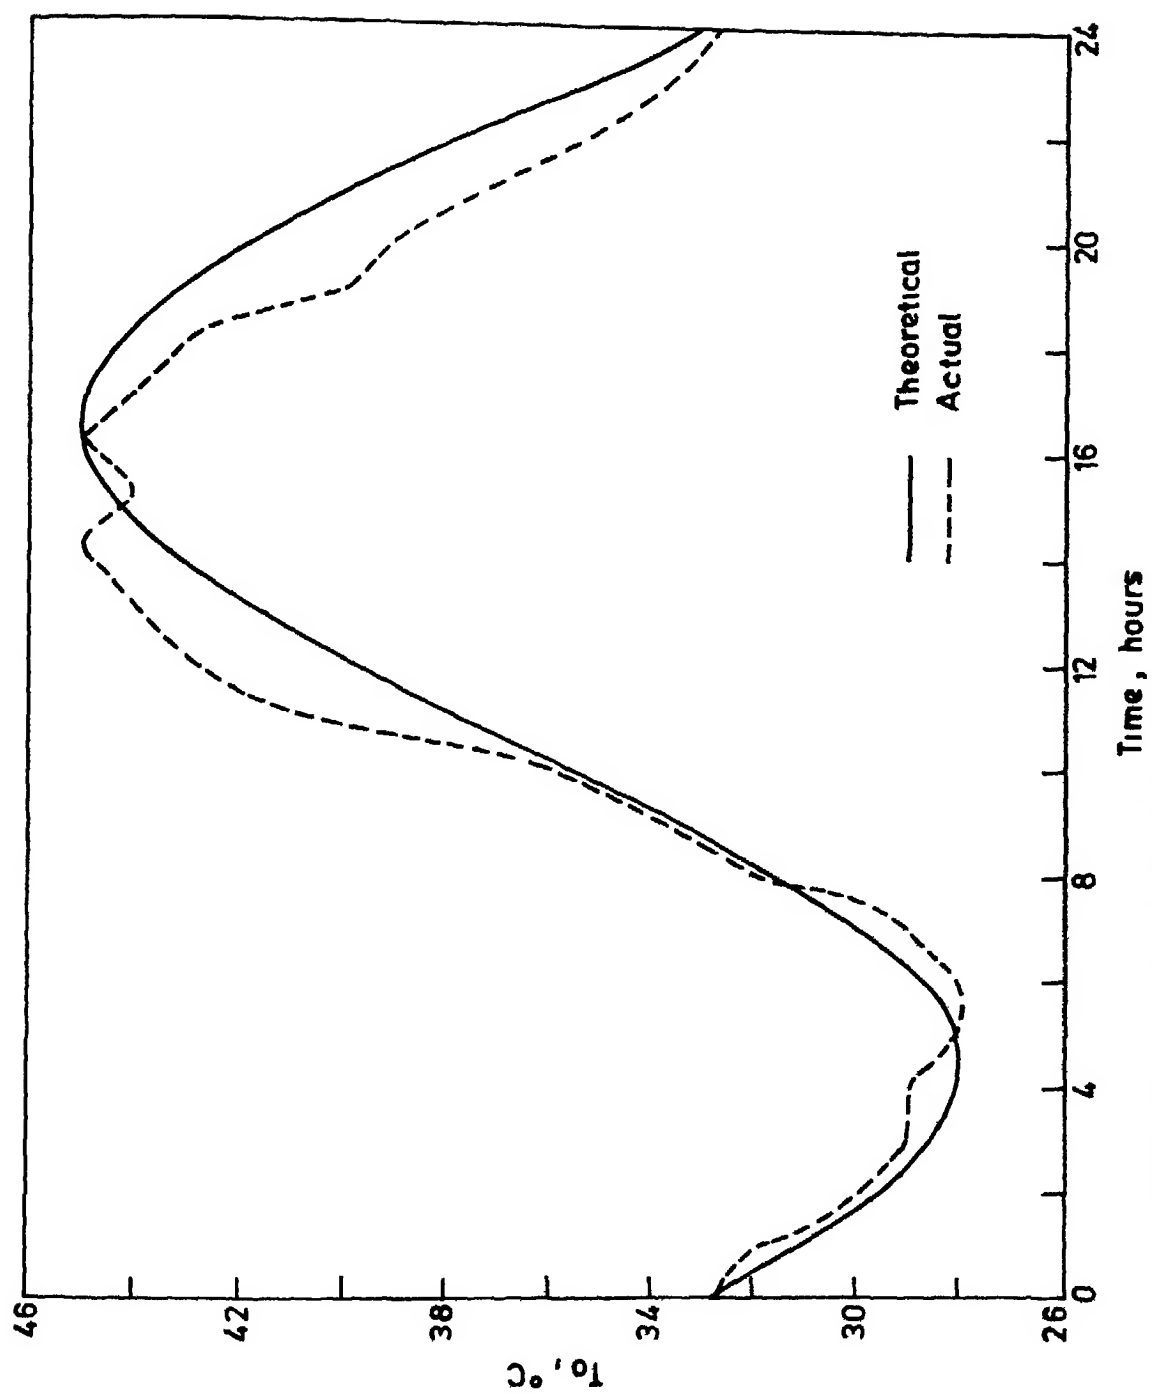
Fig 4 1 Variation in outside air temperature with respect to time in May at Kanpur
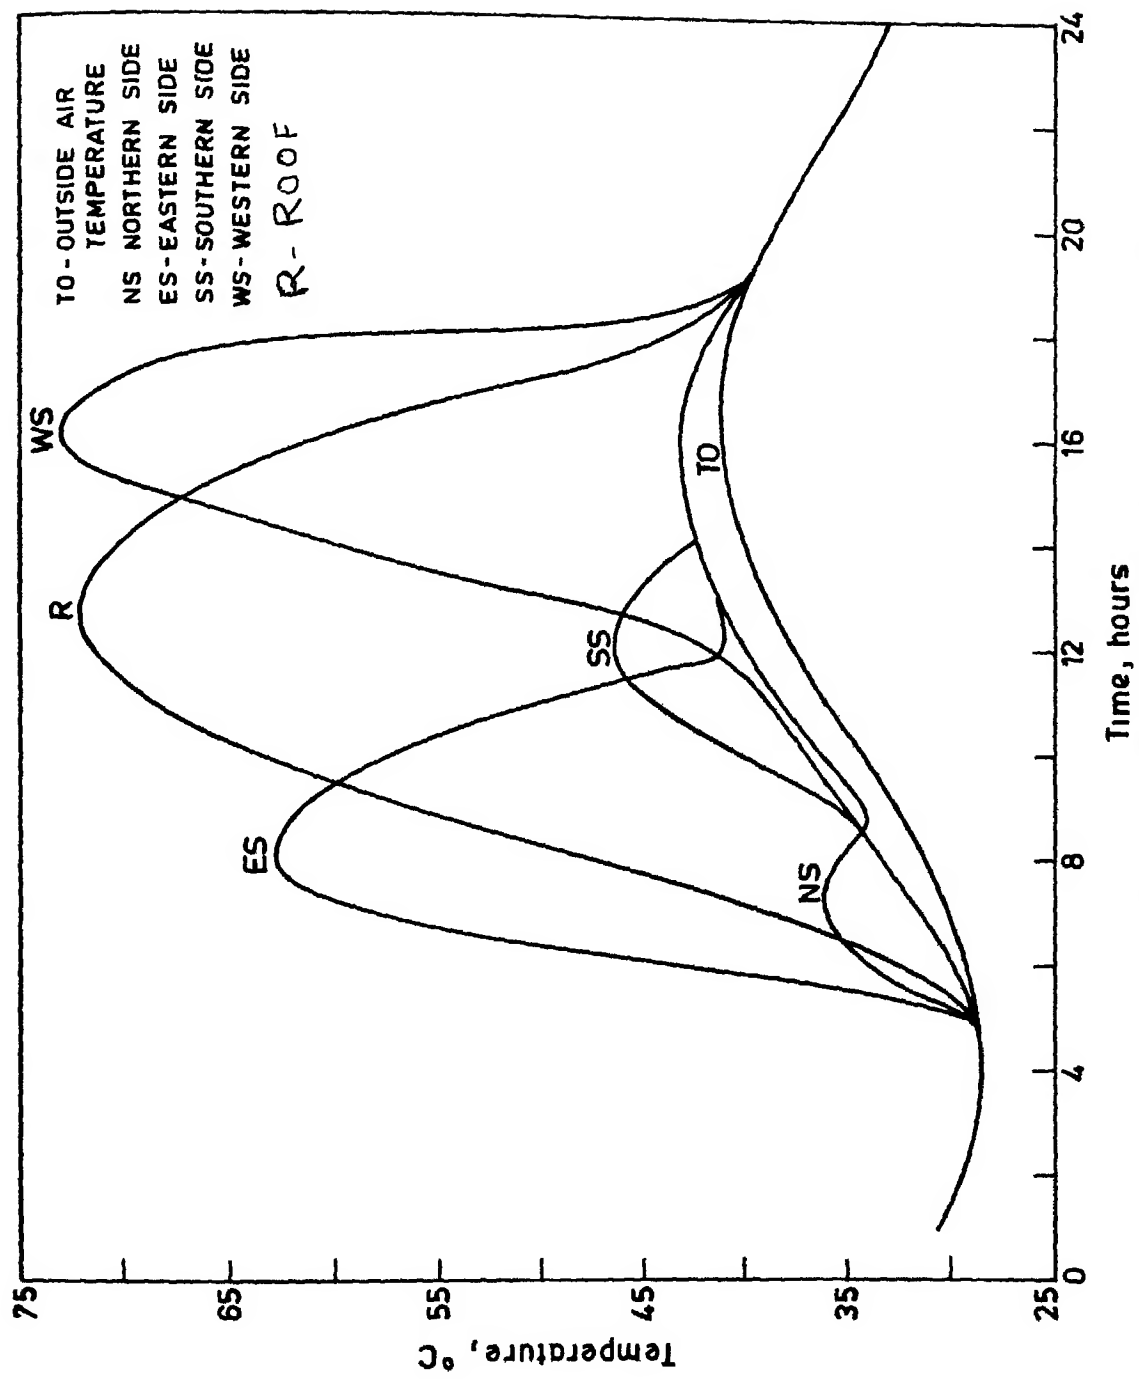
Fig 4 2 Variation in sol-air temperature and outside air temperature w r t time at Kanpur
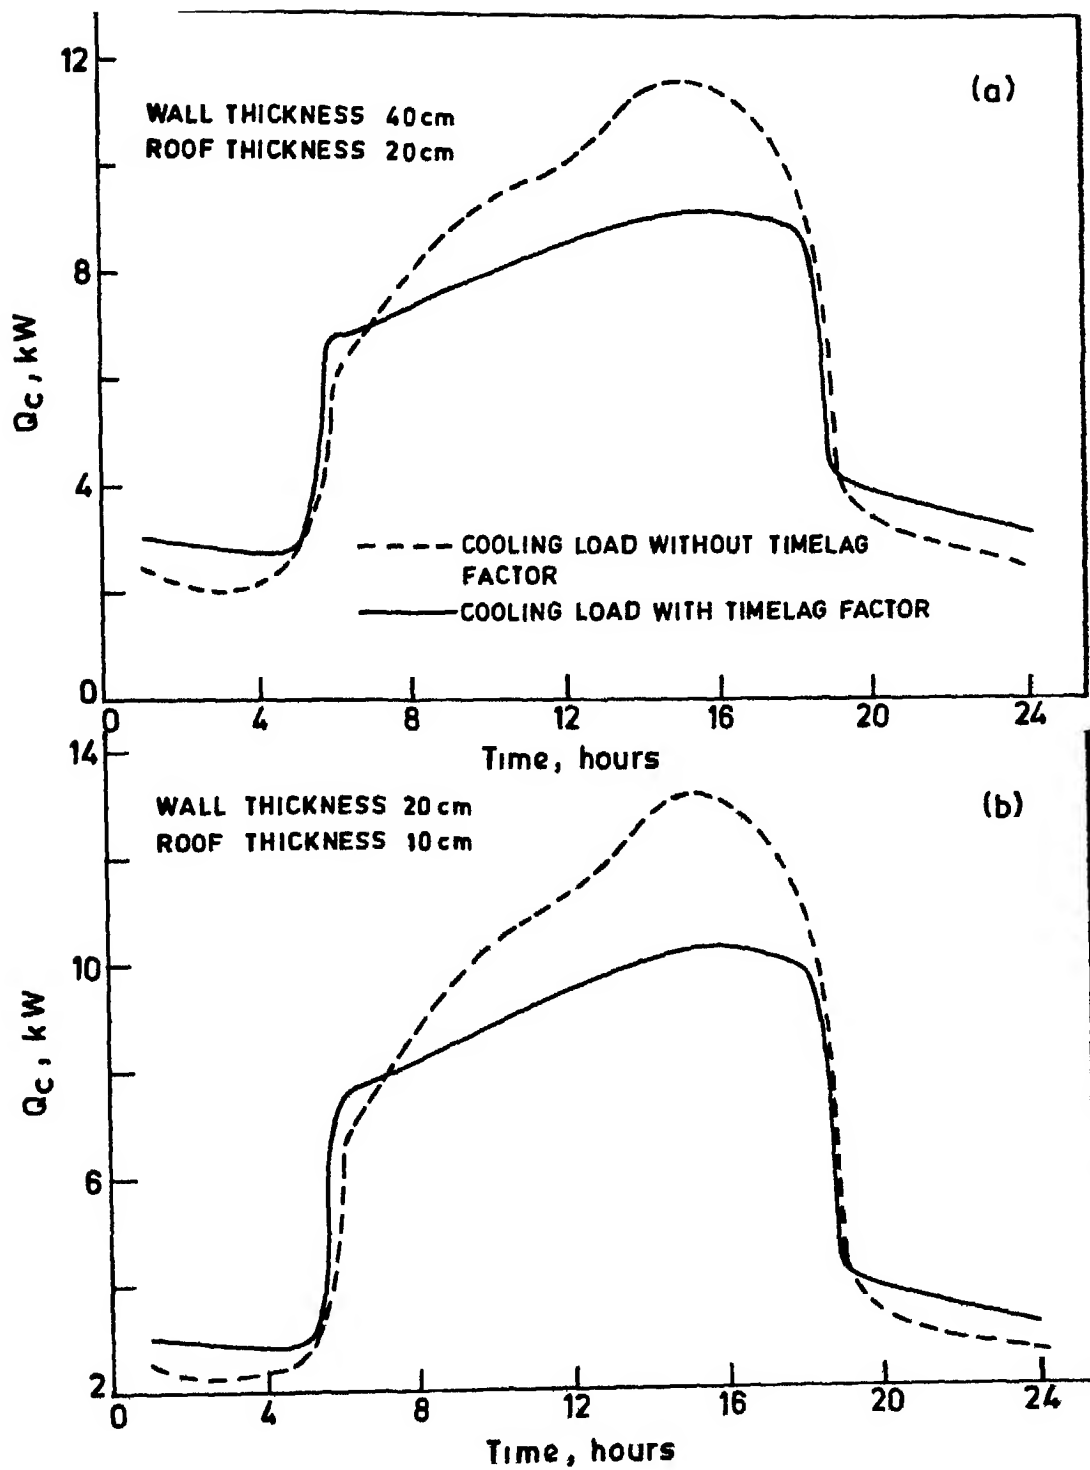
Fig 4 3 (a) &(b) Variation in cooling load with respect to time

calculated for the structure with the heat capacity. This difference is quite pronounce. When the wall thickness was halved, the above is found to be 18.02%.

4 3 OPTIMUM RESULTS FOR VARIOUS INDOOR CONDITIONS:

For the indoor conditions of 24°C DB and 65% RH, the design cooling load is 9.8% and 24.5% higher than that for the indoor conditions of 27.5°C DB, 56% RH and 30°C DB, 60% RH, respectively. Figures 4.4 and 4.5 represent the variations in initial, running and total costs with respect to the rise in condensing temperature (T_h) of the system, for R-22 and R-12 refrigerants, respectively. In this case, the approach temperature is taken as 10°C, while the other design variables, the fall in lower temperature ΔT_1, the degree of superheat ΔT_{sup}, and the degree of subcooling ΔT_{sub} are maintained at the optimum values. The optimum total cost, C_T/C_E, for R-12 refrigerant system is 4.752% less than that of R-22 refrigerant system for the same operating variables.

Figure 4.6 shows that the optimum total cost, (C_T/C_E), for a hybrid system of evaporative cooling and R-12 airconditioning system yields 4% gain over the conventional airconditioner used from April to October, every year. This is applicable for the indoor conduction of 27.5°C dry-bulb temperature and 56% RH, with approach temperature as 10°C.

Figure 4.7 depigts the comparison of the optimum total cost between a conventional airconditioning system and the system with evaporative cooling. The optimum total cost for the conventional airconditioning system is 5.562% higher than that the system used with evaporative cooling facility. The variation in the optimum total cost (C_T/C_E) with respect to the fall in the lower temperature of the system, ΔT_l is displayed in Fig.4.8. The effect of ΔT_l on the optimum total cost is less than that of ΔT_h. Figures 4.9(a) and (b) snow that the degrees of superheat and subcooling have relatively little effect on the optimum total cost of the system.

Figure 4.10 represents the variation in the optimum total cost with respect to the approach temperature of the systems for various indoor conditions. The approach temperature is almost proportional to the optimum total cost or vice versa. The various values of optimum variables for R-12 and R-22 refrigerant systems are given in the Table 4.2, along with the optimum total cost, penalty function values and the penalty parameters.

TABLE · 4.2 · OPTIMUM QUANTITIES FOR R-12 AND R-22 AIRCONDITIONING SYSTEMS

Inside condition	Refrigerant used	System usage	Approach temperature °C	Optimal values				Optimum ratio C_T/C_E	Penalty function value	Penalty parameter (r_k)
				ΔT_h °C	ΔT_l °C	ΔT_{sup} °C	ΔT_{sub} °C			
24°C DB 65% RH	R-12	Without D.C.	4	4.6851	2.0012	1.0154	2.4445	7456.88	7456.38	0.75713315 E-3
	R-12	Without D.C.	6	4.2686	2.1681	1.3740	2.0965	7837.30	7836.96	0.77488146 E-3
	R-12	Without D.C.	10	5.3756	2.1658	1.3011	1.8798	8149.68	8149.09	0.81142484 E-3
	R-12	Without D.C.	14	5.8004	2.1595	1.7935	2.4925	8318.55	8318.12	0.84640565 E-3
	R-22	Without D.C	10	4.6015	2.5301	2.0103	2.6841	8556.29	8555.89	0.84401342 E-3
27.5°C DB 56% RH	R-12	Without D C	6	4.4252	2.0345	1.0098	1.6621	7571.74	7571.30	0.71192785 E-3
	R-12	Without D C	14	4.4801	2.0418	1.0092	1.7339	8000.28	7999.93	0.79684238 E-3
	R-12	Without D C	10	5.5781	2.1485	1.0021	2.4295	7801.22	7801.12	0.74332218 E-3
	R-12	With D C	10	4.5720	1.8991	2.0154	1.9901	7510.78	7510.70	0.73155271 E-3
	R-22	Without D.C.	10	4.2888	2.0462	1.0154	2.4433	8234.25	8234.13	0.92393118 E-3
	R-22	With D C.	10	4.1410	2.0175	1.1411	1.7911	7768.50	7768.25	0.84332185 E-3

CONTINUED......

TABLE . 4.2 . (CONTINUED)

Inside condition	Refrigerant used	System usage	Approach temperature °C	Optimal Values				Optimum ratio C_T/C_E	Penalty function value	Penalty parameter (r_k)
				ΔT_h °C	ΔT_1 °C	ΔT_{sup} °C	ΔT_{sub} °C			
	R-12	Without D.C.	6	5.0153	2.4381	2.1101	2.3499	6671.19	6670.86	0.79561375 E-4
	R-12	Without D.C.	10	5.8265	2.5198	2.5217	2.1589	6930.44	6930.31	0.62257716 E-3
30°C DB 60% RH	R-12	With D.C.	10	5.1702	2.1132	2.0113	1.7245	6565.21	6565.15	0.60137661 E-3
	R-12	Without D.C.	14	4.0503	2.0159	1.1352	1.6303	7347.08	7346.80	0.83321457 E-3
	R-22	With D C.	10	4.3707	2.5105	1.5361	1.8311	7150.71	7150.48	0.79541379 E-3
	R-22	Without D C.	10	4.0336	2.0077	1.0607	1.6987	7550.78	7550.56	0.76484276 E-3

D.C. refers to desert cooler.
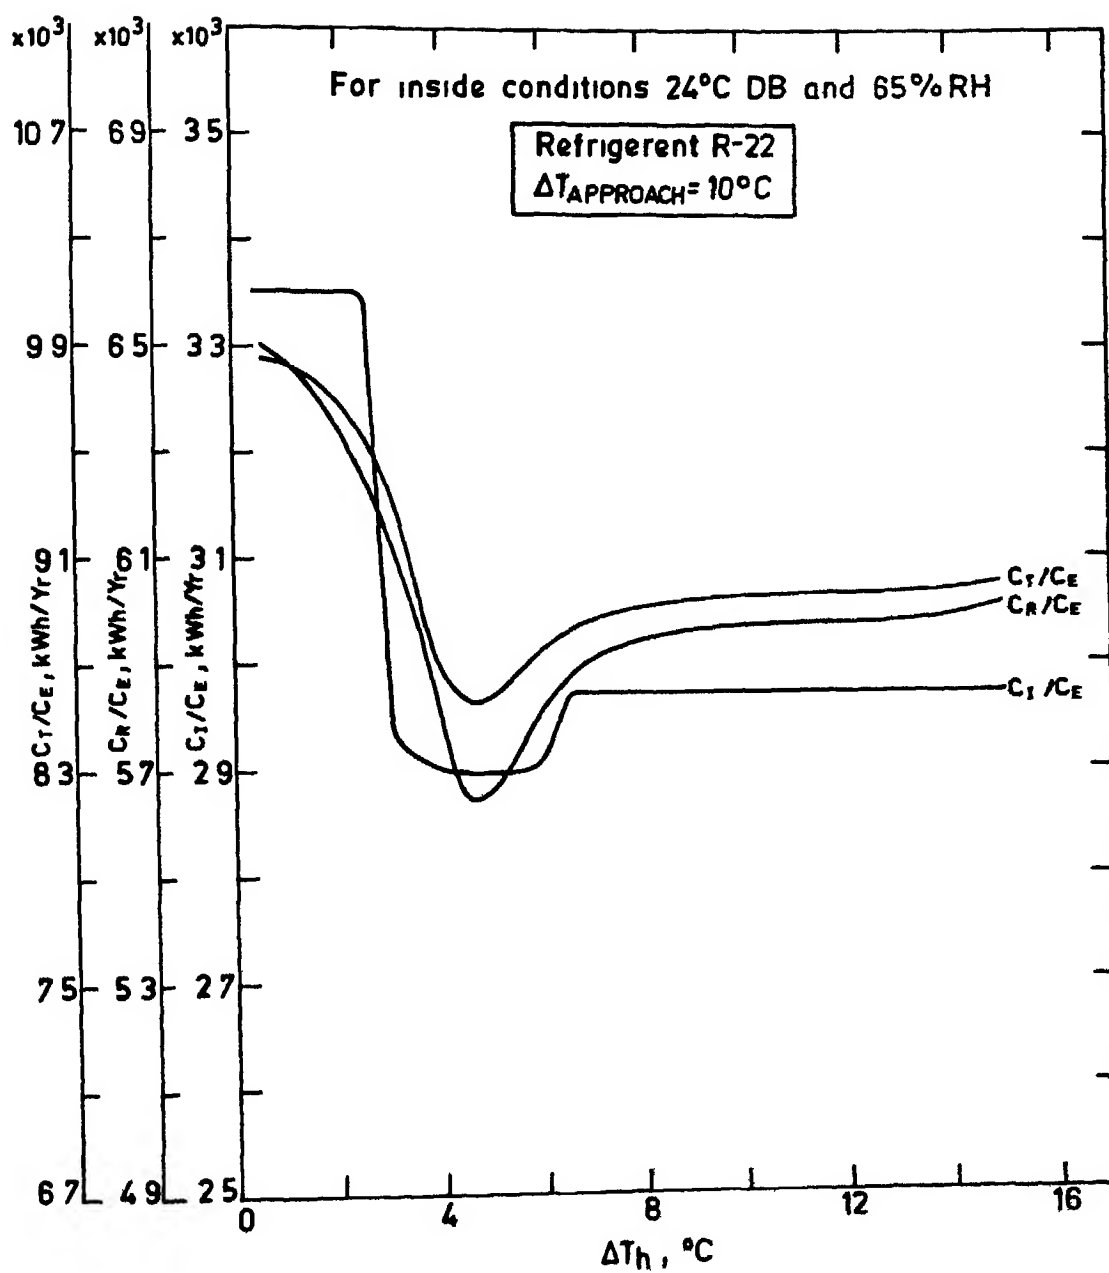
Fig 4 4 Variation in cost with rise in condensing temperature
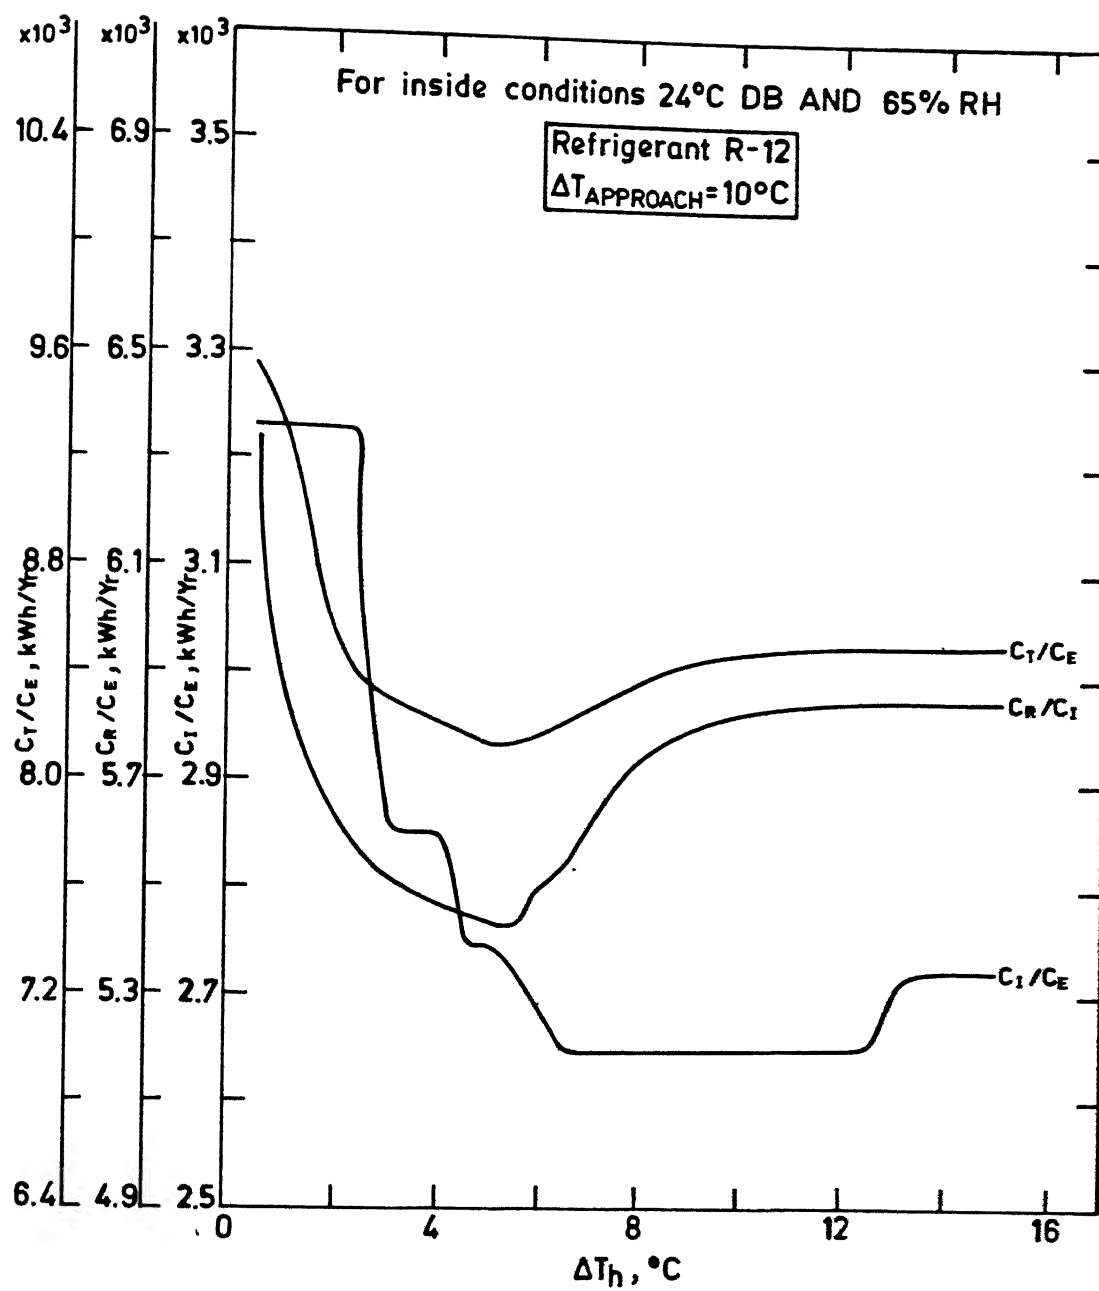
Fig. 4.5 Variation in cost with rise in condensing temperature.

Fig. 4.6 Variation in cost with rise in condensing temperature.

For indoor conditions of 30°C DB and 60% RH

Refrigerant R-12
$\Delta T_{APPROACH} = 10°C$

C_T/C_E

C_R/C_E

——— SYSTEM WITHOUT DESERTCOOLER
– – – SYSTEM WITH DESERTCOOLER

C_T/C_E

C_R/C_E
C_I/C_E
C_I/C_E

C_T/C_E, kWh/Yr

C_R/C_E, kWh/Yr

C_T/C_E, kWh/Yr

$\times 10^3$ $\times 10^3$ $\times 10^3$

7.4   4.4

7.1   4.1

6.8   3.8

6.5   3.5

6.2   3.2

4.1

3.9

3.6

3.4

3.2

3.0

0   4   8   12   16

ΔT_h, °C
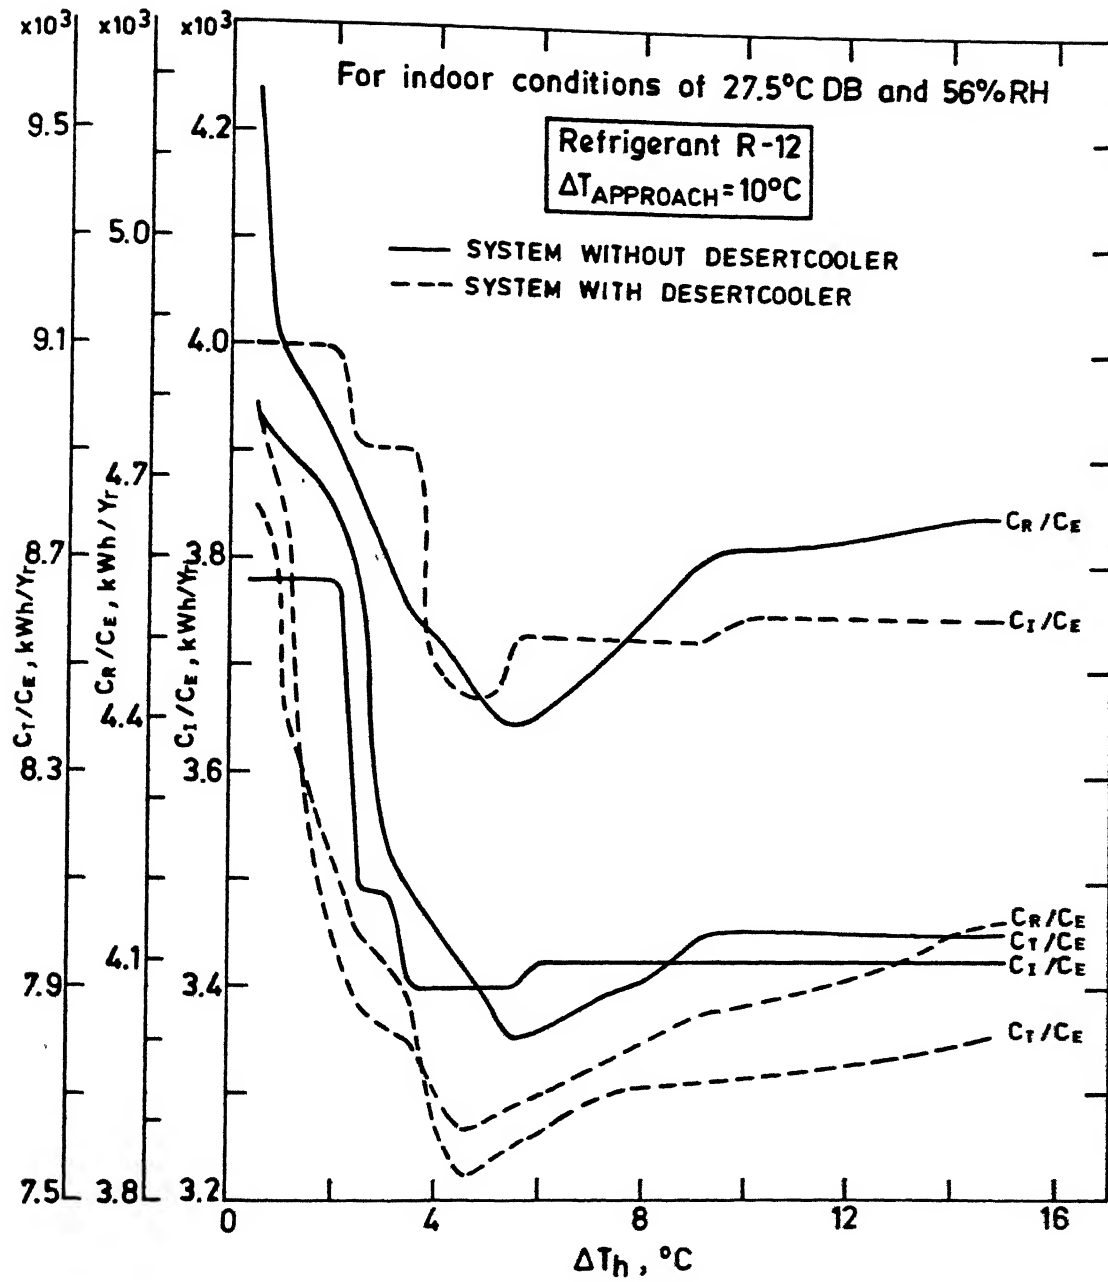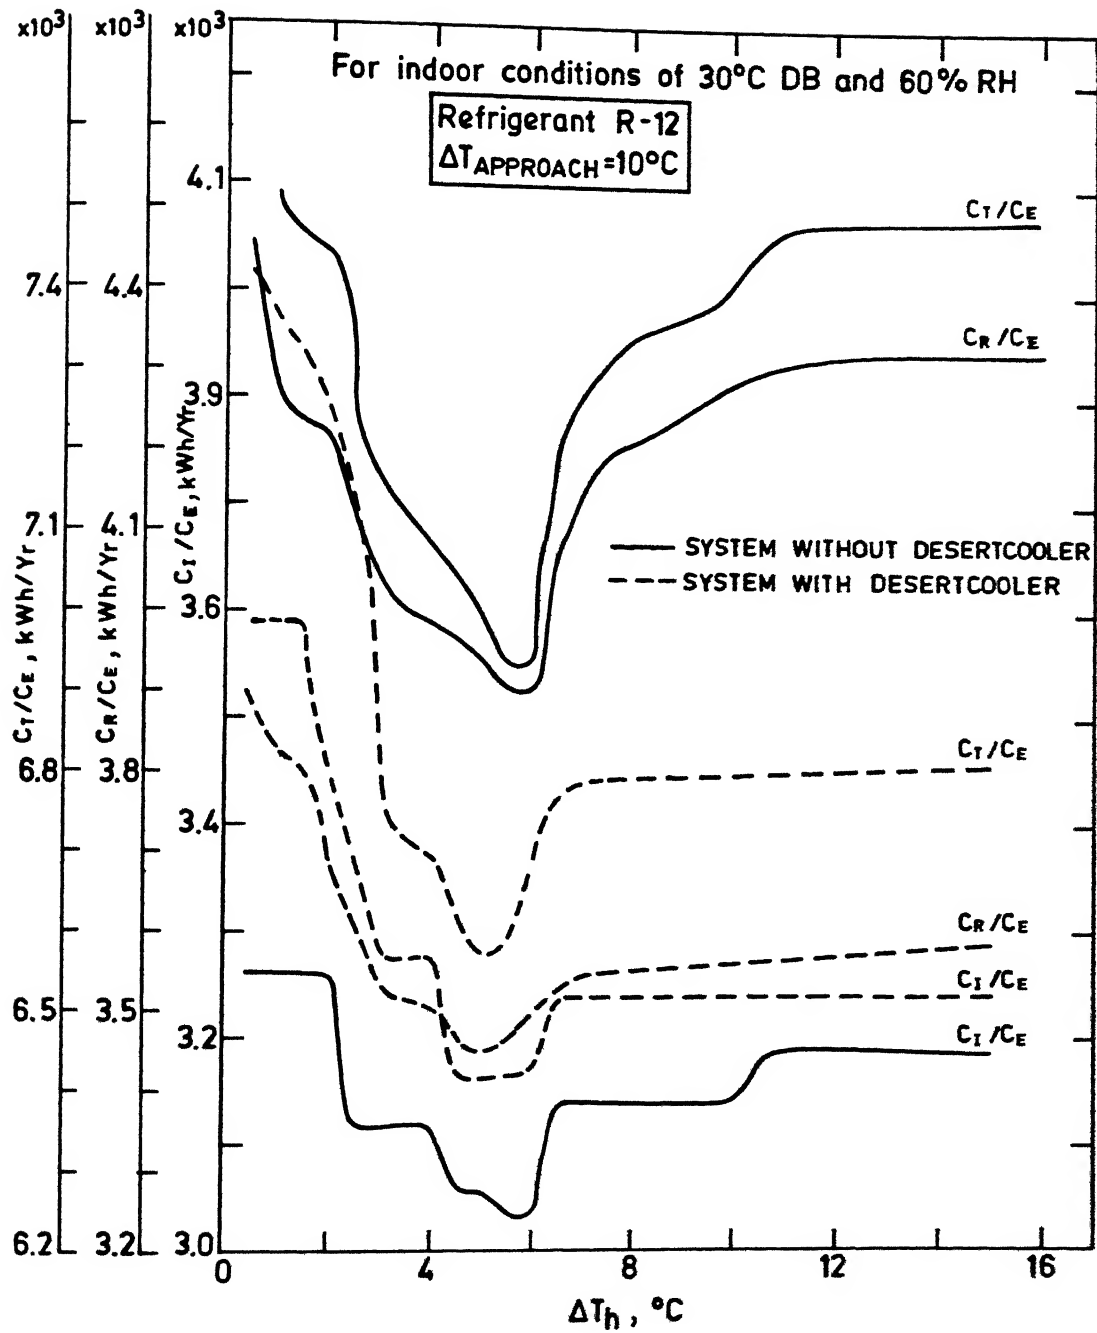
Fig. 4.7 Variation in cost with rise in condensing temperature.
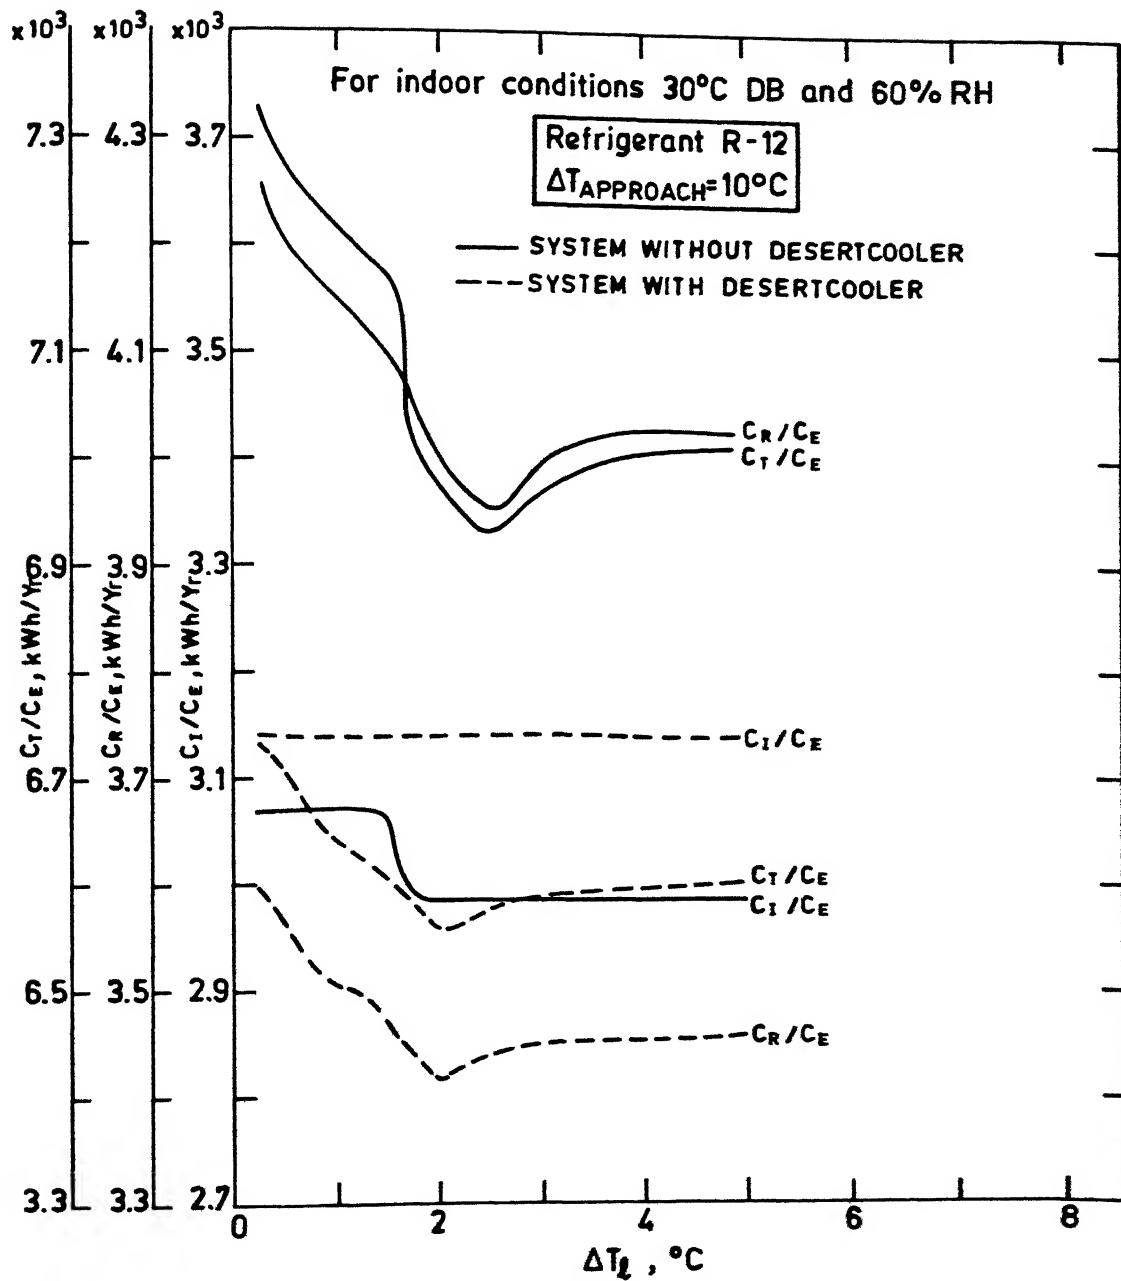
Fig. 4.8 Variation in cost with fall in evaporating temperature.

For indoor conditions 30°C DB and 60%RH

——— SYSTEM WITHOUT DESERT COOLER
– – – – SYSTEM WITH DESERT COOLER

REFRIGERENT R-12
$\Delta T_{APPROACH}$ 10°C

C_R/C_E

C_T/C_E

C_I/C_E
C_I'/C_E

C_T/C_E

C_R/C_E

(a)

$\times 10^3$ $\times 10^3$ $\times 10^3$

C_T/C_E, kWh/Yr. C_R/C_E, kWh/Yr. C_I/C_E, kWh/Yr.

Superheating, °C

C_R/C_E

C_T/C_E

C_I/C_E
C_I'/C_E
C_T/C_E
C_R/C_E

(b)
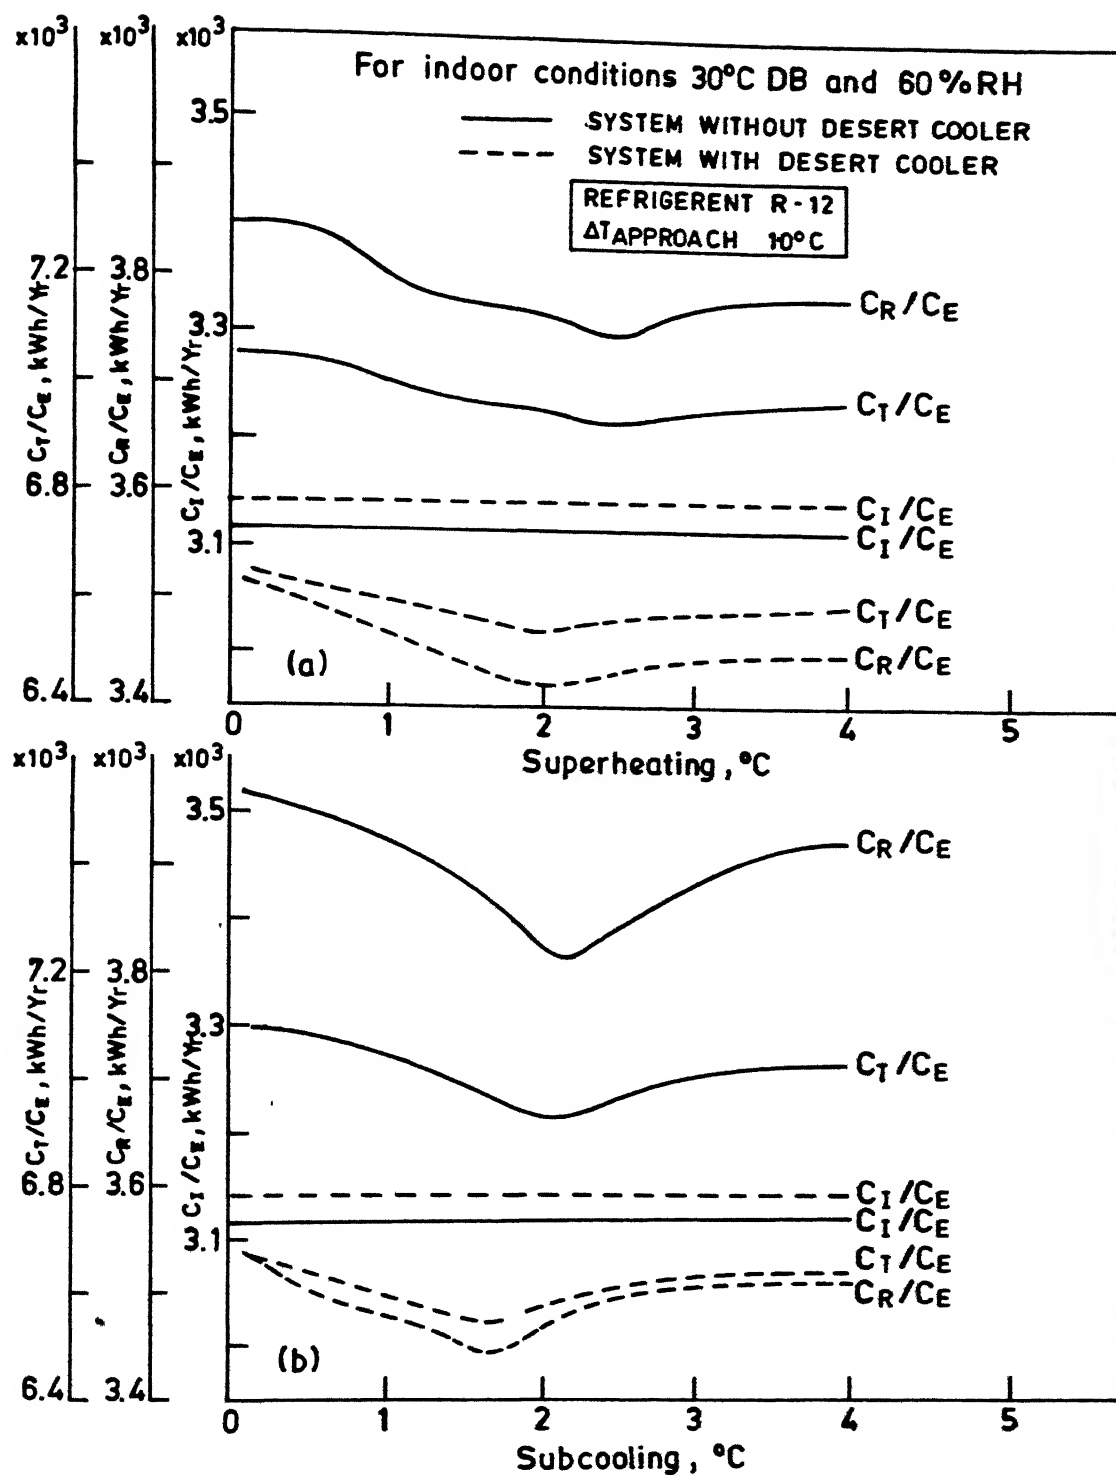
Subcooling, °C

Fig. 4.9 (a) Variation in cost with degree of superheating
(b) Variation in cost with degree of subcooling.
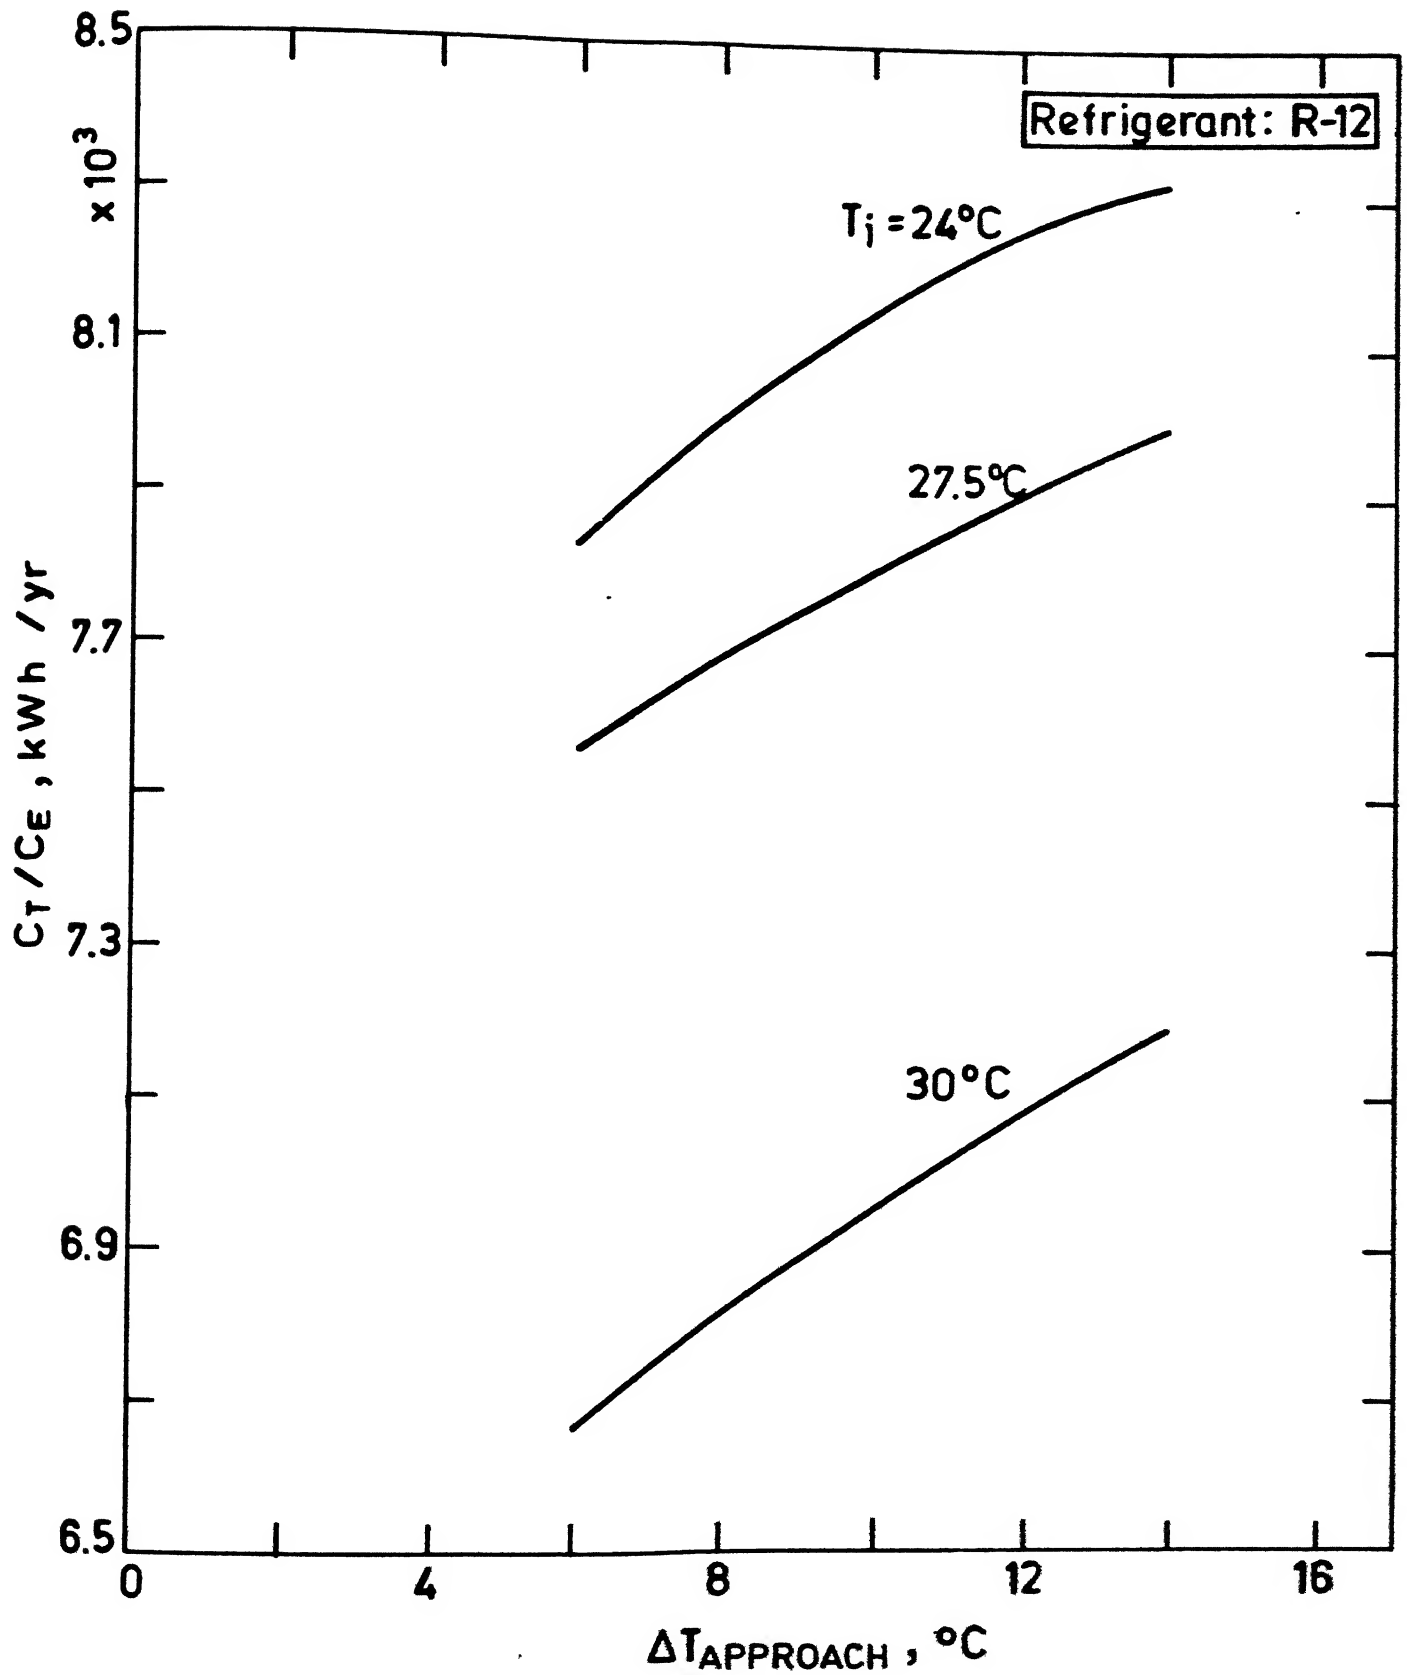
Fig. 4.10 Variation in optimum total cost with approach temperature.

CHAPTER 5

CONCLUSIONS AND SUGGESTIONS

5.1 CONCLUSIONS:

i) A multiplication factor has been found out for the estimation of actual cooling load with the help of maximum and minimum temperatures of a given location.

ii) The heat capacity and timelag factor render the cooling load about 20% less than that of without these factors.

iii) The evaporative cooling system can be substituted for the conventional air-conditioner during the period of April to June in the case of inside design condition of $T_{db} = 30°C$, $\emptyset = 60\%$ and $T_{db} = 275°C$, $\emptyset = 56\%$.

iv) The implementation of the hybrid evaporative cooling and airconditioning system is found to be more economical than the conventional airconditioner, under optimum conditions.

v) For the inside conditions of 27.5°C DB, 56% RH and 30°C DB, 60% RH, the suggested hybrid system yields a gain of 4% and 5.6% over the conventional airconditioning system, respectively.

vi) The optimum total cost of the comfort
airconditioning using R-12 is cheaper than
that of R-22 system by 4.75% for the inside
design conditions of 24°C DB and 65% RH.

vii) The variations in condensing and evaporator
temperatures have more influence on the total
cost of the system than the degrees of sub-
cooling and superheating.

viii) The variation in total cost of the airconditioning
system is almost proportional to the approach
temperature.

5.2 SUGGESTIONS:

i) A combination of evaporative cooling and conven-
tional airconditioner can be fabricated as a
single unit. The overall cost can be estimated
on the basis of actual cost for commercial
venture.

ii) The cost of the building may also be included
in the optimization in order to make the approach
even more general.

iii) This approach can also be extended to the
vapour-absorption system under optimum conditions.

REFERENCES

[1] ALFORD, J.S., RYAN, J.E. and URBAN, F.O.,
Effect of heat storage and variation in outdoor
temperature and solar intensity of heat transfer
through walls, ASHVE Transactions, Vol. 45, 1939,
pp. 393-407.

[2] ARORA, C.P., Refrigeration and Airconditioning,
Tata McGraw-Hill Publishing Co. Ltd., 1981, pp. 477 - 84.

[3] ASHRAE, Handbook of Fundamentals, Published by the
American Society of Heating, Refrigerating and
Airconditioning Engineers, Inc., New York, 1982,
Chaps. 5,6,8,22-27.

[4] Carrier Airconditioning Company, Handbook of
Airconditioning System Design, McGraw-Hill Book Co.,
1965, Chaps. 4,5 and 8.

[5] Energy, Heating and Thermal Comfort, Practical Studies
from the Building Research Establishment, The
Construction Press, Vol. 4, 1978, pp.205-13.

[6] FANGER, P.O., Thermal Comfort - analysis and
application in Environmental Engineering, McGraw-Hill
Book Co., 1970, pp. 19-105.

[7] HUEBNER, K.H., and THORNTON, E.A., The Finite Element
Method for Engineers, John Wiley and Sons, New York,
1982, pp. 406-433.

[8] J.K. Synthetics Ltd., Daily Temperature and Relative
Humidy Data, Kanpur.

[9] KADAMBI, V., and HUTCHINSON, F.W., Refrigeration,
Airconditioning and Environmental Control in India,
Prentice-Hall of India Pvt. Ltd., New Delhi, 1968,
pp. 14-69.

[10] MALHOTRA, M.S., The effect of Thermal Environment
on the Physical Performance of Indian People, All
India Symposium on Refrigeration, Airconditioning and
Environmental Control, IIT, Kanpur, 1967, pp.25-30.

[11] MANI, A., Handbook of Solar radiation for India, Allied
Publishers, 1981, pp. 22-89.

[12] PRASAD, M., Refrigeration and Airconditioning, Wiley
      Eastern Ltd., 1983, pp. 296-366, 393-400, 536-40.

[13] PRASAD, R., Optimum Design of Multistage Vapour Compression
      Refrigeration System, M.Tech. Thesis, Department of
      Mechanical Engineering, I.I.T., Kanpur, December, 1983.

[14] RAJENDRA SINGH AND RAJENDRA PRAKASH, New Thermal
      Comfort Indices, Proceedings of the Second National
      Symposium on Refrigeration and Airconditioning, March,
      1973, pp. 147-157.

[15] RAMAMOORTHI, R., Economic Model of Optimum Operating
      Parameters and Indoor Design Conditions for Comfort
      Airconditioning, M. Tech. Thesis, Department of
      Mechanical Engineering, I.I.T. Kanpur, March, 1985.

[16] RAO, S.S., Optimisation Theory and Application, Wiley
      Eastern Ltd., 1984, Chaps. 5-7.

[17] THRELKELD, J.L., Thermal Environmental Engineering,
      McGraw-Hill Book Co., 1972, pp. 279-380.

[18] WHITNER, L.B., Minimising Space Energy Requirements
      subject to Thermal Comfort Conditions, ASHRAE J.,
      Vol. 18, March, 1976, pp. 32-36.

[19] WOODS, EDUARDO, J.E., MALDONADO, A.B., and REYNOLDS,
      G.L., How Ventilation Influences Energy Consumption
      and Indoor Air Quality, ASHRAE, J. Sept. 1981, pp.40-43.

APPENDIX A

TABLE A-1

TEMPERATURE AND RELATIVE HUMIDITY OF THE OUTSIDE AIR FOR THE YEAR 1982, AT KANPUR

Time in hrs	April		May		June		July		August		September		October	
	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %
1	30	59	33	54	35	41	35	44	32	95	30	90	26	80
2	30	60	33	50	35	44	35	44	32	95	29	95	26	86
3	30	64	34	50	34	44	35	46	32	98	29	100	25	84
4	29	66	35	50	34	42	35	47	32	95	29	95	25	86
5	29	70	34	50	34	42	35	47	31	97	28	90	25	90
6	26	74	35	46	34	44	35	48	31	100	28	90	25	92
7	26	78	38	40	35	40	37	48	32	90	30	88	24	80
8	28	79	40	36	36	40	37	45	33	89	31	76	24	62
9	30	74	40	40	38	50	38	42	34	86	35	68	29	60
10	35	48	41	35	38	46	39	39	35	80	35	60	30	58
11	35	46	42	34	40	38	40	36	36	70	35	64	30	53
12	37	46	43	32	41	36	40	31	37	68	36	58	31	50
13	38	41	44	31	41	33	41	28	38	68	37	58	32	50
14	38	40	44	30	42	29	41	26	38	62	37	56	32	48

APPENDIX A (TABLE A-1) (CONTINUED):

Time in hrs	April		May		June		July		August		September		October	
	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %
15	40	40	44	29	42	23	42	23	36	64	37	53	34	40
16	40	36	45	30	43	16	42	23	38	70	35	60	33	46
17	36	34	45	29	41	18	39	22	38	68	34	66	34	52
18	34	32	44	29	40	20	38	24	36	64	34	72	34	58
19	33	40	41	30	38	25	37	26	35	67	33	76	34	64
20	32	48	38	39	38	29	35	27	34	80	32	85	32	68
21	32	51	38	44	37	31	34	33	33	82	31	80	30	76
22	31	54	36	49	36	34	35	33	33	87	31	92	29	78
23	30	55	36	54	35	37	35	34	33	89	30	90	29	76
24	30	56	35	55	35	39	35	37	32	90	30	90	28	80

APPENDIX A

TABLE A-2

TEMPERATURE AND RELATIVE HUMIDITY OF THE OUTSIDE AIR FOR THE YEAR 1983, AT KANPUR

Time in hrs	April T °C	April Ø %	May T °C	May Ø %	June T °C	June Ø %	July T °C	July Ø %	August T °C	August Ø %	September T °C	September Ø %	October T °C	October Ø %
1	29	64	33	36	36	23	31	56	32	95	34	89	20	78
2	28	68	32	40	35	24	30	62	32	95	34	92	19	84
3	28	72	31	38	34	25	30	66	31	97	34	86	19	86
4	27	76	31	39	34	26	30	67	31	98	33	90	19	84
5	27	80	31	40	33	26	29	71	31	92	33	86	19	84
6	26	82	31	42	32	27	29	72	31	82	35	72	19	84
7	27	78	30	41	32	26	29	72	35	62	36	66	18	85
8	30	66	32	28	34	22	32	78	35	90	35	66	19	85
9	32	58	35	28	37	22	34	64	32	90	36	56	22	78
10	32	54	36	26	40	19	35	62	30	92	37	52	24	66
11	33	48	37	22	41	18	36	57	30	87	37	50	25	62
12	35	45	38	30	41	17	37	52	30	80	37	52	25	64
13	37	42	40	30	42	16	37	46	30	74	37	52	28	48
14	38	39	42	30	40	16	38	40	31	70	37	53	28	38
														33

CONTINUED........

APPENDIX A (TABLE A-2) : CONTINUED:

Time in hrs	April		May		June		July		August		September		October	
	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %	T °C	Ø %
15	38	37	42	29	40	16	38	39	33	72	36	52	30	32
16	39	35	42	28	40	16	38	38	34	70	36	59	32	36
17	38	34	42	29	39	16	36	38	34	76	35	68	32	42
18	36	40	41	30	39	18	36	40	35	90	35	84	27	50
19	35	46	40	33	39	18	35	41	35	88	35	86	26	56
20	33	50	38	34	38	20	34	40	35	91	34	82	25	68
21	32	52	37	34	38	20	33	49	34	92	34	82	25	74
22	31	56	36	36	37	22	32	52	33	95	34	84	22	76
23	31	58	35	36	37	23	32	56	32	92	34	87	22	74
24	30	60	34	36	36	23	31	56	32	92	34	86	22	74

APPENDIX A

TABLE A-3

TEMPERATURE AND RELATIVE HUMIDITY OF THE OUTSIDE AIR FOR THE YEAR 1985, AT KANPUR

Time in hrs	April T °C	April Ø %	May T °C	May Ø %	June T °C	June Ø %	July T °C	July Ø %	August T °C	August Ø %	September T °C	September Ø %	October T °C	October Ø %
1	28	37	32	44	33	42	32	69	30	76	32	68	25	76
2	28	38	30	44	32	39	32	76	30	78	31	72	25	80
3	27	39	29	47	32	38	32	74	30	80	30	71	24	83
4	26	40	29	51	32	37	32	78	30	83	30	72	24	82
5	26	40	28	54	29	36	31	78	31	82	29	76	24	89
6	28	44	28	56	29	39	31	66	31	84	29	78	23	86
7	30	48	29	56	31	36	32	70	33	72	30	75	24	89
8	31	42	32	54	33	33	34	81	34	64	34	68	26	74
9	32	30	36	44	35	27	35	64	36	60	37	56	28	44
10	34	30	41	38	37	24	36	84	37	59	37	52	29	30
11	36	26	43	32	39	22	37	70	38	52	38	48	30	22
12	38	23	43	26	39	20	39	52	39	50	38	45	31	23
13	40	22	44	24	40	18	39	57	38	48	38	43	31	23
14	38	20	45	22	41	15	40	50	36	48	37	43	31	23

APPENDIX A (TABLE A-3) (CONTINUED):

Time in hrs	April T °C	April ∅ %	May T °C	May ∅ %	June T °C	June ∅ %	July T °C	July ∅ %	August T °C	August ∅ %	September T °C	September ∅ %	October T °C	October ∅ %
15	37	20	44	20	40	15	40	46	35	46	38	42	30	20
16	34	20	45	20	40	15	35	48	34	45	37	41	29	25
17	32	20	44	23	39	16	34	52	34	44	35	42	29	29
18	29	22	39	26	39	20	34	61	32	52	34	52	29	42
19	29	24	37	29	38	26	33	66	33	58	33	58	28	50
21	29	25	36	32	38	28	33	70	31	62	33	60	26	60
22	28	27	35	35	37	32	33	72	30	78	32	64	24	64
23	27	33	32	40	34	36	32	72	31	75	32	68	23	70
24	26	35	32	42	32	38	32	70	30	75	32	68	22	72

APPENDIX - B

APPENDIX-B

Table-B

VALUES FOR SOLAR INTENSITY CALCULATIONS

Month.	Equation of time/minutes	Declination of angle degrees	A_1 W/m^2	B_1	C_1
Jan.	-11.2	-20.0	1230	0.142	0.058
Feb.	-13.9	-10.8	1214	0.144	0.060
March	- 7.5	0.0	1185	0.156	0.071
April	1.1	11.6	1135	0.180	0.097
May	3.3	20.0	1103	0.196	0.121
June	-1.4	23.45	1088	0.205	0.134
July	-6.2	20.6	1085	0.207	0.136
August	-2.4	12.3	1107	0.201	0.122
September	7.5	0.0	1151	0.177	0.092
October	15.4	-10.6	1192	0.160	0.073
November	13.8	-19.8	1220	0.149	0.063
December	1.6	-23.45	1233	0.142	0.057

A_1 = Apparant solar irradiation at air mass = 0 , W/m^2

B_1 = Atmospheric extinction coefficient

C_1 = Diffuse radiation factor.

APPENDIX - C

APPENDIX - C

EQUATIONS FOR THE ESTIMATION OF PRIMARY ANGLES

The equation for, LST, local solar time

$$LST = LCT + \text{Equation of time} \qquad (C-1)$$

where,

$$LCT = IST \pm (82.5\text{-Longitude of the location})/15, \text{ hrs} \qquad (c-2)$$

The equations for the hour angle α_h, are given by

$$\alpha_h = (LST - 12.0).15, \text{ for } LST < 12.0$$
$$= (12.0 - LST).15, \text{ for } LST > 12.0 \qquad (C-3)$$

The relationships between the latitude angle l, the hour angle α_h, declination angle d, altitude angle β, and azimuth angle γ are,

$$Sin\,\beta = (Cos\ l.\ Cos\ h.\ Cos\ d + Sin\ l.\ Sin\ d) \qquad (C-4)$$
$$Cos\,\gamma = Sin\ (Cos\ l.\ Sin\,d - Cos\ d.\ Sin\ l.\ Cos\,\alpha_h) \qquad (C-5)$$

For wall solar azimuth angle α,

$$\alpha = |\frac{\pi}{2} - \gamma|, \text{ for east and west facing walls,}$$
$$= \gamma, \text{ for north facing walls,}$$
$$= |(\gamma - \pi)|, \text{ for south facing walls,} \qquad (C-6)$$

The relationship for the incidence angle, Θ, is

$$Cos\Theta = (Cos\beta)(Cos\alpha)(Cos\emptyset_t) + (Sin\ )(Sin\ \emptyset)\ for$$

tilted surfaces, with tilt angle $\emptyset_t$

$$= (Cos\beta)(Cos\alpha),\ for\ vertical\ surfaces$$

$$= Sin\ \beta,-\ for\ horizontal\ surfaces. \qquad (C-7)$$

APPENDIX - D

APPENDIX-D

EQUATIONS FOR THERMAL PROPERTIES OF GLASS

The relationships for the thermal properties of the glass, transmittivity t_r, reflectivity r_g and absorptivity a_g,

$$t_r = (1-r')^2 \cdot a_c/(1 - r^2 \cdot a_c^2) \qquad (D-1)$$

$$r_g = r' + \frac{(1 - r')^2 \cdot a_c^2}{(1 - r'^2 \cdot a_c^2)} \qquad (D-2)$$

$$a_g = 1 - r' - \frac{(1 - r')^2 \cdot a_c}{(1 - r' \cdot a_c)} \qquad (D-3)$$

where,

$$r' = \frac{1}{2} \left[\frac{\sin^2 (\Theta_g - \Theta_g')}{\sin^2 (\Theta_g + \Theta_g')} + \frac{\tan^2 (\Theta_g - \Theta_g')}{\tan^2 (\Theta_g - \Theta_g')} \right]$$

$$a_c = \exp^{-E_c x_g/(1 - \frac{\sin^2 \Theta_g}{n^2})}$$

where Θ_g Angle of incidence

Θ_g' Angle of refracted rays

E_c Extinction coefficient

x_g Thickness of the glass (m)

n Refraction index.

APPENDIX-E

APPENDIX-E

BUILDING PARTICULARS FOR COOLING LOAD CALCULATIONS

Room Size $\qquad$ = 8.4 x 4.0 x 3.8, m^3

Thickness of the wall $\qquad$ = 0.4 m

Thickness of the roof $\qquad$ = 0.2 m

Number of windows:

        On the Northern wall = 2

        On the Southern wall = 2

        On the Eastern wall = 0

        On the Western wall = 0

Area of the windows $\qquad$ = 1.08 m^2

Number of doors:

        On Western walls   = 1

        On the other sides = 0

Number of occupants $\qquad$ = 25

Number of fans inside the room = 4

Number of lights inside the room = 8

Ratings:

        Fans $\qquad$ = 100 watts

        Lights $\qquad$ = 40 watts.

APPENDIX-F

APPENDIX-F

PROPERTIES OF REFRIGERANTS

Refrigerant R-12:

$$c_p(T) = 0.59524 + 0.00181715 \ (T+15)$$

$$s_f(T) = 0.142093 + 0.33747 \ (T/100) - 0.0399606(T/100)^2$$
$$+ 0.019868(T/100)^3 + 0.014023 \ (T/100)^4$$

$$h_g(T) = 188.86 + 0.440278(T) - 7.02007(T/100)^2$$
$$- 5.07651 \ (T/100)^3 - 3.82545 \ (T/100)^4$$

$$h_f(T) = 36.1554 + 0.928108(T) + 6.89916 \ (T/100)^2$$
$$+ 3.73414 \ (T/100)^3 + 5.91673 \ (T/100)^4$$

Refrigrant R-22:

$$c_p(T) = 0.60 + 0.0005246 \ (T+45+0.043686 \ (T+45)^2)),$$
$$\text{for } -60 < T < 10$$

$$= 0.70114 + 0.0029529 \ (T-10+0.010472(T-10)^2)$$
$$\text{for } 10 < T < 50$$

$$s_f(T) = 0.181332 + 0.43667 \ (T/100) - 0.0596756 \ (T/100)^2$$
$$- 0.0234343 \ (T/100)^3 + 0.0638047 \ (T/100)^4$$

$$h_g(T) = 251.06 + 35.4577 \ (T/100) - 19.4993 \ (T/100)^2$$
$$- 7.62005 \ (T/100)^3 - 11.6756 \ (T/100)^4$$

$$h_f(T) = 46.2102 + 1.20394 \ (T) + 6.828 \ (T/100)^2$$
$$- 8.99387 \ (T/100)^3 + 20.0612 \ (T/100)^4$$

where, T in °C, c_p in kJ/kg.°C, s_f in kJ/kg.°K, h_g, h_f in kJ/kg.

APPENDIX - G

```
********************************************************************
*  COMPUTER PROGRAM FOR THE EVALUATION OF SOL-AIR TEMPERATURES,   *
*  DAILY TEMPERATURE VARIATION OF OUTSIDE AIR & COOLING LOADS     *
*            FOR VARIOUS MONTHS IN A YEAR                         *
*----------------------------------------------------------------*
*      SOL-AIR TEMPERATURES & OUTSIDE AIR TEMPERATURES ARE       *
*             GIVEN IN TERMS OF Degree Celcius                   *
*      COOLING LOADS ARE ESTIMATED IN TERMS OF Kilowatts         *
*-----------------------INPUT DATA-------------------------------*
        SOURCE LISTING:
        ALONG     : Longitude of the place, where cooling load is to be
                    calculated.
        ALT       : Latitude of the place, where cooling load is to be
                    calculated.
        N         : Number of weeks per month. Here, it is 4
        N1        : Number of months for which cooling load is to be
                    calculated.
        N2        : Total number of hours per day.
        IST       : Initialisation of Indian Standard Time.
        TO        : Design temperature selected for load calculations.
        TI        : Indoor temperature needed.
        ABST      : Thermal absorptivity of the building material.
        VIN       : Velocity of air inside the room.
        VEL       : Design outside air velocity.
        RH        : Relative humidity of the inside air.
        RHO       : Relative humidity of the outside air at the design
                    temperature.
        P         : Time lag factor.
 NN,NS,NE,NW      : Number of windows on the northern,southern,eastern &
                    western sides of the building,respectively.
        NL,NF     : Number of lights & fans inside the room.
 RATLIT,RATFAN    : Ratings of the light & fan.
 WN,HW,BW         : Size of the windows.
 TX ,TN           : Maximum & minimum temperatures in the months for
                    which the cooling loads are evaluated.
        D         : Declination angle of the sun.(Taken from ASHRAE
                    DATA BOOK.)
        EOT(I,J)  : Equation of time in Minutes & Seconds
        X(I,J)    : Apparent solar irradiation at airmass =0 (Taken from
                    ASHRAE DATA BOOK.)
        Y(I,J)    : Atmospheric extinction coefficient (Taken from
                    ASHRAE DATA BOOK.)
        Z(I)      : Diffuse solar radiation constant (Taken from ASHRAE
                    DATA BOOK.)
 ALONG,BRE,HEIGH  : Length,breadth & height of the building.
********************************************************************
*---------------------------MAIN PROGRAM-------------------------*
********************************************************************
      DIMENSION SOLANE(24),SOLANS(24),SOLANW(24),SOLANW(24),SOLANH(24)
      DIMENSION OSOLAR(24),TOTALS(24),TOTFAC(24),TOUT(24),QINFIL(24)
      DIMENSION VENFIL(24),SEOTO(24),SI(24),SENGIN(24),SENTOT(24)
      DIMENSION EOT(12,4),D(12,4),X(12,4),Y(12,4),Z(12),TX(12),TN(12)
      OPEN(UNIT=1,DEVICE='DSK',FILE='SOL.DAT',ACCESS='SEQIN')
      OPEN(UNIT=2,DEVICE='DSK',FILE='OUT.DAT',ACCESS='SEQOUT')
      OPEN(UNIT=3,DEVICE='DSK',FILE='LAG.DAT',ACCESS='SEQOUT')
      OPEN(UNIT=4,DEVICE='DSK',FILE='ERS.DAT',ACCESS='SEQOUT')
      READ(1,*)ALONG,ALT,N,N1,N2,IST,TO,TI,ABST,VEL,ABS,HEIGH,BRE,ARE
     1,RH
      READ(1,*)(Z(I),I=1,N1),VIN,RHO,RHO,ALPHAO,NN,NE,NN,P,TN,NS
      READ(1,*)(TX(I),I=1,N1),(TN(I),I=1,N1),NL,NF,RATFAN,RATLIT
      READ(1,*)(D(I,J),EOT(I,J),X(I,J),Y(I,J),J=1,N),I=1,N1)
      READ(1,*)IYEAR,WT,RF
      C=22.0/(7.0*180.0)
      ALT=ALT*C
```

```
      DO 58 I=1,81
      QRU58=0.0
      GO TO(58,58,58,1,1,1,1,1,1,1,58,58),I
    1 WRITE(3,2) IYEAR,WT,RT
    2 FORMAT(31X,'COOLING LOADS FOR THE YEAR = ',I4,/,31X,'BUILDING
     1PARTICULARS:',/,31X,'ROOM SIZE=(4.0*3.5*3.5)',2X,'SQ.M',/
     2,31X,'THICKNESS OF THE WALLS=',F4.2,1X,'metre',/,31X,'THICKNESS
     3 OF THE ROOF=',F4.2,1X,'metre')
      GO TO(58,58,58,3,5,7,9,11,13,15,58,58),I
    3 WRITE(2,4)
    4 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'SOL-AIR
     1 TEMPERATURES FOR THE MONTH OF APRIL',2X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 17
    5 WRITE(2,6)
    6 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'SOL-AIR
     1 TEMPERATURES FOR THE MONTH OF MAY',4X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 17
    7 WRITE(2,8)
    8 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'SOL-AIR
     1 TEMPERATURES FOR THE MONTH OF JUNE',3X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 17
    9 WRITE(2,10)
   10 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'SOL-AIR
     1 TEMPERATURES FOR THE MONTH OF JULY',3X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 17
   11 WRITE(2,12)
   12 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'SOL-AIR
     1 TEMPERATURES FOR THE MONTH OF AUGUST',1X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 17
   13 WRITE(2,14)
   14 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'SOL-AIR
     1 TEMPERATURES FOR THE MONTH OF SEPTEMBER',9X,'I',/,31X,72('*'))
      GO TO 17
   15 WRITE(2,16)
   16 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'SOL-AIR
     1 TEMPERATURES FOR THE MONTH OF OCTOBER',1X,'I',9X,'I',/,31X,
     172('*'))
   17 WRITE(2,18)
   18 FORMAT(31X,'I',1X,'IST',1X,'I',2X,'LST',2X,'I',2X,'TO',2X,'I',
     12X,'SOLAR',2X,'I',2X,'SOLAR',2X,'I',2X,'SOLAR',2X,'I',2X,
     1'SOLAR',2X,'I',2X,'SOLAR',2X,'I',/,31X,72('*'))
      GO TO(58,58,58,19,21,23,25,27,29,31,58,58),I
   19 WRITE(3,20)
   20 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'VARIOUS
     1 COOLINGLOADS FOR THE MONTH OF APRIL',2X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 33
   21 WRITE(3,22)
   22 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'VARIOUS
     1 COOLINGLOADS FOR THE MONTH OF MAY',4X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 33
   23 WRITE(3,24)
   24 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'VARIOUS
     1 COOLINGLOADS FOR THE MONTH OF JUNE',4X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 33
   25 WRITE(3,26)
   26 FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'VARIOUS
```

```
      1 COOLINGLOADS FOR THE MONTH OF JULY',3X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 33
 27   WRITE(3,28)
 28   FORMAT(31X,72('*'),/,31X,'I',2X,'I',7X,'I',1X,'VARIOUS
     1 COOLINGLOADS FOR THE MONTH OF AUGUST',1X,'I',9X,'I',/,31X,
     172('*'))
      GO TO 33
 29   WRITE(3,30)
 30   FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'VARIOUS
     1 COOLINGLOADS FOR THE MONTH OF SEPTEMBER',9X,'I',/,31X,72('*'))
      GO TO 33
 31   WRITE(3,32)
 32   FORMAT(31X,72('*'),/,31X,'I',5X,'I',7X,'I',1X,'VARIOUS
     1 COOLINGLOADS FOR THE MONTH OF OCTOBER',' I',9X,'I',/,31X,
     172('*'))
 33   WRITE(3,34)
 34   FORMAT(31X,'I',1X,'IST',1X,'I',2X,'LST',2X,'I','Qsolar','I',
     12X,'Qglass',1X,'I',2X,'Qinfil',1X,'I',2X,'Qvent',2X,'I',4X,
     1'Qequip',1X,'I',2X,'Qtotal',1X,'I',/,31X,72('*'))
C----------------Calculation of the solar intensity----------------
      IST=0.0
      TQSOE=0.0;TQSOC=0.0;TJSON=0.0;TQSOSC=0.0;TQSOH=0.0
      0.0=HCSOT;0.0=SCSOT;0.0=NCSOT;0.0=NCSOT;0.0=SOT
      K=0.0
 35   K=K+1
      IST=IST+1
      AAIN=0.0
      CAL=0.0
      GGAMA=0.0
      RRISE=0.0
      SETS=0.0
      BETAA=0.0
      DO 45 J=1,N
      DEC=O(I,J)*C
      H=-(SIN(ALT)*SIN(DEC))/(COS(ALT)*COS(DEC))
      DEG=ACOS(H)/C
      SET=(180.0+DEG)/15.0
      RISE=12.0-DEG/15.0
      IF(82.5-ALONG)37,36,36
 36   ALCT=IST-(82.5-ALONG)*4.0/60.0
      GO TO 38
 37   ALCT=IST+(82.5-ALONG)*4.0/60.0
 38   ALST=ALCT+EOT(I,J)/60.0
      DIFF=ALST-12.0
      IF(DIFF)39,40,40
 39   AH=((12.0-ALST)*60.0)*C/4.0
      GO TO 41
 40   AH=((ALST-12.0)*60.0)*C/4.0
 41   B=COS(ALT)*(ABS(COS(AH)))*COS(DEC)+SIN(ALT)*SIN(DEC)
      AIN=CX(I,J)/EXP(Y(I,J)/B))/1000.0
      BET=ASIN(B)
      G=(COS(ALT)*SIN(DEC)-COS(DEC)*SIN(ALT)*ABS(COS(AH)))/COS(BET)
      BETA=BET/C
      GAM=ACOS(G)/C
      IF(DIFF)43,42,42
 42   ANEGAM=(180.0-GAM)
      GAMA=ANEGAM
      GO TO 44
 43   GAMA=GAM
 44   AIN=AIN
      GAM=GAMA
      SSET=SET
      RISES=RISE
      BET=BETA
```

```
      AAIN=AINT+AAIN
      CAL=ALST+CAL
      GGAMA=GAM+GGAMA
      RRISE=PISES+RRISE
      SETS=SSET+SETS
      BETAA=BET+BETAA
15    CONTINUE
      AIN=AAIN/4.0
      GAMA=GGAMA/4.0
      RISE=RRISE/4.0
      SET=SETS/4.0
      ALST=CAL/4.0
      BETA=(BETAA/4.0)*CI
      P=Z(I)
      TMAX=TM(I)
      TMIN=TMN(I)
      PHI=ALOG(P)
      ANLST=ALST-PHI
      IF(ANLST.LE.0.0)ANLST=24+ANLST
      AREAW=ALENG*HEIG-HW*BW*NW
      AREAE=ALENG*HEIG-HW*BW*NE
      AREAN=BRE*HEIG-HW*BW*NN
      AREAS=BRE*HEIG-HW*BW*NS
      AREAH=ALENG*BRE
      CALL  TODTSN(TMAX,TMIN,RISE,EST,C,TO)
      CALL  SOLAIR(AIN,BETA,GAMA,RISE,SET,ALST,O,C,VEL,TO,ABST,SOLAE,
     1SOLAW,SOLAN,SOLAS,SOLAH,HD,HDH,ALPS,ALPN,SW,SS,DIXE,DAINN,
     1DAINS)
      WRITE(2,46)IST,ALST,TO,SOLAE,SOLAW,SOLAN,SOLAS,SOLAH
46    FORMAT(31X,'I',1X,I2,2X,'I',1X,F5.2,1X,'I',1X,F5.2,'I',
     15(2X,F5.2,2X,'I'))
      TOSOE=SOLAE-TI+TOSOE
      TOSOW=SOLAW-TI+TOSOW
      TOSON=SOLAN-TI+TOSON
      TOSOS=SOLAS-TI+TOSOS
      TOSOH=SOLAH-TI+TOSOH
      CALL  SOLAIR(AIN,BETA,GAMA,RISE,SET,ANLST,O,C,VEL,TO,ABST,SOLNE,
     1SOLNW,SOLNN,SOLNS,SOLNH,HN,HNR,ALS,ALN,XE,XIX,DIXE,DAXN,DAXS)
      SOLANE(K)=SOLNE;SOLANW(K)=SOLNN;SOLANN(K)=SOLNN;SOLANS(K)=SOLNS
      SOLANH(K)=SOLNH;TOUT(K)=TO;ST(K)=ALST
      IF(IST.LE.23.0)GO TO 48
      EXME=TOSOE/24.0
      EXMW=TOSOW/24.0
      EXMS=TOSOS/24.0
      EXMN=TOSON/24.0
      EXMH=TOSOH/24.0
      DFACT=0.1
      K=0
47    K=K+1
      VROOM=3.4*4.0*3.6
*--*--*--*--Calculation of infiltration & ventilation loads--*--*--*--*
      CALL  MISC(VROOM,TI,TOUT(K),JTV,2VEN,SERINF,SEVVEN)
      CALL  CONTST(TI,TOUT(K),VEL,J)
      CALL  RDHTRF(TI,TOUT(K),VEL,JR)
*--*--*--*--Calculation of the heat transfer through structure--*--*--*
      QSOLAR(K)=U*(EXME+DFACT*(SOLANE(K)-EXME-TI))*AREAE
      QSOLAR(K)=QSOLAR(K)+U*AREAH*(EXMH+DFACT*(SOLANH(K)-EXMH-TI))
      QSOLAR(K)=QSOLAR(K)+U*AREAS*(EXMS+DFACT*(SOLANS(K)-EXMS-TI))
      QSOLAR(K)=QSOLAR(K)+U*AREAN*(EXMN+DFACT*(SOLANN(K)-EXMN-TI))
      QSOLAR(K)=QSOLAR(K)+U*AREAW*(EXMW+DFACT*(SOLANW(K)-EXMW-TI))
      QINFIL(K)=QIN+VENTIL(K)=JVEN*(VOLH(K)*SERINF;SEVVEN(K)=SEVVEN
      QLOSS(K)=U*BW*NW*(QLLSW+QLLSS)
      QEQUIP(K)=NE*SQEFAN*NLWRAD*QT
      IF(K.LE.24.0)GO TO 47
```

```
        GO TO 49
*-*-*-*-*-*-*Calculation of the heat transfer through glass windows*-*-*-*-*-*
   49   CALL PROGLS(C,ON,BETA,ALPN,FSN,THOUN,ALPHAN)
        CALL PROGLS(C,OS,BETA,ALPS,FSS,THOUS,ALPHAS)
        HOUT=(3.98*1.0E-03+9.392*1.0E-04*VEL)
        HIN=(0.237*((V(N/D)**0.5))/360)
        AIRN=RHO*DAINN
        AIRS=RHO*DAINS
        UGL=1/(1/HIN+1/HOUT)
        QGLSN=FSN*THOUN*DAINN+THOUD*DIFE+AIRN*THOUN+(FSN*ALPHAN*DAINN+
       1ALPHAD*DIFE+ALPHAN*AIRN)/(1+HOUT/HIN)+UGL*(TOUT(J)-TI)
        QGLSS=FSS*THOUS*DAINS+THOUD*DIFE+AIRS*THOUS+(FSS*ALPHAS*DAINS+
       1ALPHAD*DIFE+ALPHAS*AIRS)/(1+HOUT/HIN)+UGL*(TOUT(J)-TI)
        QOCCUP=NOCCUP*QACT/3600.0
        IF(TST.LE.23.0)GO TO 35
   49   DO 54 K=1,24
        IF(ST(K).GT.RISE.AND.ST(K).GT.SET)GO TO 50
*-*-*-*-*-*-*Calculation of the total cooling load*-*-*-*-*-*-*-*-*-*-*-*-*
        QSOLAR(K)=0.0; QTOGLS(K)=0.0
   50   QTOTAL(K)=QSOLAR(K)+QTOGLS(K)+QINFIL(K)+VENTIL(K)+QEQUIP(K)
        QTOTAL(K)=1.1*(QTOTAL(K)+QOCCUP)
        IF(K.GE.8.AND.K.LE.17) GO TO 51
        GO TO 52
   51   QRUN=QTOTAL(K)+QRUN
   52   RSH=1.1*(QSOLAR(K)+QTOGLS(K)+SENQIN(K)+SENVET(K)+QOCCUP)
        SRSH=RSH/QTOTAL(K)
        WRITE(3,53)K,ST(K),QSOLAR(K),QTOGLS(K),QINFIL(K),VENTIL(K)
       1,QEQUIP(K),QTOTAL(K)
   53   FORMAT(31X,'I',1X,I2,2X,'I',1X,F5.2,1X,'I',1X,F5.2,'I',5(2X,F5.2
       1,2X,'I'))
   54   CONTINUE
        RH1=RH*100
        TYPE*,RH1
        WRITE(2,55)RISE,SET,TI,RH1
   55   FORMAT(31X,72('*'),/,31X,'I',9X,'SUNRISE=',F5.2,'Hrs',20X,
       1'SUNSET=',F5.2,'Hrs',10X,'I',/,31X,'I',2X,'ROOM TEMPERATURE=',
       2F4.1,1X,'Deg Celsius',4X,'RELATIVE HUMIDITY=',F4.4,'%',8X,
       3'I',/,31X,72('*'))
        WRITE(3,56)RISE,SET,TI,RH1
   56   FORMAT(31X,72('*'),/,31X,'I',9X,'SUNRISE=',F5.2,'Hrs',20X,
       1'SUNSET=',F5.2,'Hrs',10X,'I',/,31X,'I',2X,'ROOM TEMPERATURE=',
       2F4.1,1X,'Deg Celsius',4X,'RELATIVE HUMIDITY=',F4.4,'%',8X,
       3'I',/,31X,72('*'))
        WRITE(3,57)QRUN
   57   FORMAT(31X,'TOTAL COOLING LOAD FOR THE RUNNING HOURS ( From
       18.00 A.M to 5.00 P.M)=',F5.0,1X,'K.W',/)
   58   CONTINUE
        STOP;END
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
*           SUBROUTINE FOR OUTSIDE AIR TEMPERATURE VARIATION           *
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
        SUBROUTINE TODTSN(TMAX,TMIN,R,TI,C,TO)
        B=(TMAX-TMIN)/(1-COS((15*(R-1.0)-15*(R+11.0))*C))
        A=TMAX-B
        O=15*(R+11.0)
        TO=A+B*COS((15*I-O)*C)
        RETURN;END
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
*              SUBROUTINE FOR SOL-AIR TEMPERATURES                     *
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
        SUBROUTINE SOLAIR(A,B,G,S,S,ALST,E,C,VEL,TO,AB,SOLAE,SOLAW,SOLAV
       1,SOLAS,SOLAN,TO,HOU,ALPS,ALPN,DN,DS,DIFE,DAINN,DAINS)
        IF(ALST.GT.R.AND.ALST.GT.S)GO TO 1
        SOLAE=TO;SOLAW=TO;SOLAS=TO;SOLAN=TO;SOLAV=TO
```

```
      GO TO 2
      ALPE=(ABS(90-G))*C
      D=COS(B)*COS(ALPE)
      DAINE=A*D
      DIFE=Z*A*0.5
      IF(ALST.GE.12.0.AND.ALST.GE.6)DAINE=0.0
      TOTINE=DAINE+DIFE
      DAINW=A*D
      IF(ALST.GT.R.AND.ALST.LE.12.0)DAINW=0.0
      TOTINW=DAINW+DIFE
      ALPN=G*C
      DN=COS(B)*COS(ALPN)
      DAINN=A*DN
      IF(ALST.GT.12.0)DAINN=0.0
      TOTINN=DAINN+DIFE
      ALPS=(ABS(G-180.0))*C
      IF(ALST.GT.12.0)ALPS=(ABS(G+180.0))*C
      DAINS=0.0
      IF(ALPS.GT.3.1415925/2.0)DAINS=A*COS(B)*COS(ALPS)
      TOTINS=DAINS+DIFE
      DIFH=Z*A
      TOTINH=A*SIN(B)+DIFH
      HO=(18.423+3.81*VEL)/360)
      HOH=(4.1897*(6.34+1.21*VEL))/3600
      SOLAE=TO+AB*TOTINE/HO
      SOLAW=TO+AB*TOTINW/HO
      SOLAN=TO+AB*TOTINN/HO
      SOLAS=TO+AB*TOTINS/HO
      SOLAH=TO+AB*TOTINH/HOH
    2 DN=COS(B)*COS(ALPN)
      DS=COS(B)*COS(ALPS)
      RETURN;END
*-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-*
*     SUBROUTINE FOR  CONVECTIVE HEAT TRANSFER COEFFICIENT(walls) *
*-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-*
      SUBROUTINE COHTCT(TI,TO,VEL,J)
      HO=(18.423+3.81*VEL)/360)
      X1=0.025;X2=0.15;X3=0.025;
      AK1=0.00072;AK2=0.0013;
      TCOND=X1/AK1+X2/AK2+X3/AK1.
      C1=0.0011805S
      C2=1/HO+TCOND
      DT=10.0
    1 FN=C1*C2*(DT**1.25)+DT-TO+TI
      FDN=1.25*C1*C2*(DT**0.25)+1.0
      VAL=FN/FDN
      DTNEW=ABS(DT-VAL)
      IF(ABS(DTNEW-DT).GT.0.01)GO TO 2
      DT=DTNEW
      GO TO 1
    2 HI=C1*(DT)**0.25
      U=1/(1/HI+TCOND+1/HO)
      RETURN;END
*-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-*
*     SUBROUTINE FOR  CONVECTIVE HEAT TRANSFER COEFFICIENT(roof)  *
*-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-*
      SUBROUTINE COHTRF(TI,TO,VEL,JR)
      HOH=(4.1897*(6.34+1.21*VEL))/3600
      X1=0.015;X2=0.07;X3=0.015
      AK1=0.00072;AK2=0.0013;
      TCOND=X1/AK1+X2/AK2+X3/AK1.
      C1=3.48/3600.0
      C2=1/HOH+TCOND
      DT=10.0
```

```fortran
      FN=C1*C2*(DT**1.25)+DT-TI+TL
      FDR=1.25*C1*C2*(DT**0.25)+1.0
      VALR=FN/FDR
      DTNEW=ABS(DT-VALR)
      IF(ABS(DTNEW-DT).LE.0.01)GO TO 2
      DT=DTNEW
      GO TO 1
    2 HIR=C1*(DT**0.25)
      UR=1/(1/HIR+RCONR+1/HOH)
      RETURN;END
```

```
*-+-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-*
*                 SUBROUTINE FOR PROPERTIES OF GLASS                              *
*-+-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-*
```

```fortran
      SUBROUTINE PROGLS(C,DX,BETA,ALP,FS,THOU,ALPHA)
      H=1.2;B=0.9;D=0.3
      AL=0.0064;AK=0.174/0.0254;AN=1.526
      R1=D/H
      R2=D/B
      AIC=ACOS(DX)
      DELTA=ABS(ATAN(SIN(BETA)/(COS(BETA)*COS(ALP))))
      IF(DELTA.GT.22/14)DELTA=DELTA-22/14
      Y=R1*(ABS(SIN(DELTA)/COS(DELTA)))
      Z=R2*(ABS(SIN(ALP)/COS(ALP)))
      IF(Y.OR.Z.GT.1.0)GO TO 1
      FS=1-Y-Z+Y*Z
      GO TO 2
    1 FS=0.0
    2 X=SQRT(1-SIN(AIC)**2.0/(AN*AN))
      ALN=AL/X
      ABS=EXP(-AK*ALN)
      THETA=ACOS(X)
      ADD=THETA+AIC
      ANEW=AIC-THETA
      REFY=(SIN(ANEW)**2.0/SIN(ADD)**2.0+((SIN(ANEW)**2.0)*(COS(ADD)**
     12.0))/((COS(ANEW)**2.0)*(SIN(ADD)**2.0)))/2.0
      THOU=((1-REFY)**2.0)*ABS/((1-K*REFY*ABS)**2.0)
      ALPHA=1-REFY-((1-REFY)**2.0)*ABS/(1-REFY*ABS)
      RETURN;END
```

```
*-+-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-*
*                 SUBROUTINE FOR THE MISCELLANEOUS LOAD                           *
*-+-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-*
```

```fortran
      SUBROUTINE MISC(VROOM,TI,TO,QI,QV,SQI,SQV)
      RO=0.45;RI=0.65;NOCCUP=25;SPVENT=5.0
      CALL AIRPRO(TI,RI,HIAIR,SVR,W)
      CALL AIRPRO(TO,RO,HOAIR,SVO,W)
      CALL LATENT(TI,TO,RH,HW)
      CALL AIRCNG(VROOM,ANOCNG)
      QI=VROOM*ANOCNG*(HOAIR-HIAIR)/(SVO*24*3600)
      QV=NOCCUP*SPVENT*(HOAIR-HIAIR)/(SVO*24*3600)
      SQI=QI-(VROOM*ANOCNG*(HOAIR-HW)/(SVO*24*3600))
      SQV=QV-(NOCCUP*SPVENT*(HOAIR-HW)/(SVO*24*3600))
      RETURN;END
```

```
*-+-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-*
*                 SUBROUTINE FOR AIR PROPERTIES                                   *
*-+-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-:-*
```

```fortran
      SUBROUTINE AIRPRO(TDB,RH,W,SPVOL,WS)
      CPA=1.004;RA=287.1
      X=1.152E-5*(4.7075-9)*(TDB+273.65)
      Y=(7.2137E-1*(X*(TDB-210.0)**2.0))*(647.31/(TDB+273.15)-1.0)
      PS=(221.228/EXP(Y))
      FS=1.00485-(2.0707E-5)*TDB+(3.0458E-7)*(TDB)**2.0
      WS=0.622*FS*PS/((1.01392-FS*PS)
      H=1.004*TDB+WS*(2501.4+1.03*TDB)
      SPVOL=RA*(TDB+273.15)/((1.01392-RH*PS)*1E+5)
```

```
      RETURN;END
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
*            SUBROUTINE FOR NUMBER OF AIR CHANGES                         *
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
      SUBROUTINE AIRCNG(VROOM,ANCNG)
      DIMENSION VOL(31),AIRCNG(31)
      DATA(AIRCNG(I),I=1,31)/22.6,20.6,19.25,18.25,17.37,16.5,15.91,
     115.29,14.74,14.25,13.80,13.4,13.03,12.7,12.4,12.16,11.67,11.67,
     111.13,10.26,9.22,8.44,8.13,7.85,7.37,6.99,6.42,6.5,6.01,5.8,
     15.55/
      DATA(VOL(I),I=1,31)/5,10,15,20,25,30,35,40,45,50,55,60,65,70,75,
     180,85,90,95,100,120,140,150,160,180,200,240,250,260,300,350/
      I=0.0
    1 I=I+1
      IF(VOL(I)-VROOM)1,2,2
    2 DIFF=VROOM-VOL(I)
      ANCNG=AIRCNG(I)+DIFF*(AIRCNG(I-1)-AIRCNG(I))/(VOL(I)-VOL(I-1))
      RETURN;END
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
*            SUBROUTINE FOR LATENT HEAT                                   *
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
      SUBROUTINE LATENT(TI,TO,RH,HW)
      CALL AIRPRO(TI,RH,H,SPVOL,W)
      HW=1.004*TO+W*(2501.4+1.88*TO)
      RETURN;END
*&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&&*
```

```
                                    DATE: (   )
******************************************************************
*       COMPUTER PROGRAM FOR NON-LINEAR PROGRAMMING OPTIMISATION   *
*              This NLP optimisation is done                       *
*                           by                                     *
*           "INTERIOR PENALTY FUNCTION METHOD"                     *
*                with INEQUALITY CONSTRAINTS                        *
*            Unconstrained minimisation is done by                 *
*           "DAVIDON-FLETCHER-POWELL'S METHOD"                      *
*            One dimensional minimisation is done by               *
*              "CUBIC INTERPOLATION TECHNIQUE"                      *
*------------------- SOURCE LISTING -----------------------------  *
*       N      :Number of design variables.                        *
*       NC     :Number of constraints.                             *
*       NR     :Number of penalty parameter reductions desired.    *
*       ITLIM  :Maximum number of D.F.P. iterations required.      *
*       LIMFIT :Maximum number of cubic refits.                    *
*       RI     :Initial value for the penalty parameter.           *
*       Z      :Multiplication factor for penalty parameter(RI).   *
*       RF     :Reduction factor for penalty parameter(RO).        *
*       EPSS   :Accuracy for the optimum design variables.         *
*       EPC    :Accuracy for the gradients.                        *
*       ZZ     :Initial value for the step length.                 *
*       XX     :Factor for the step length to achieve convergence. *
*   (X(I),I=1,N) : Starting values for the design variables.       *
*   (EPSM(I),I=1,N):Accuracy parameters used in D.F.P. iterations. *
******************************************************************
!---------------------- MAIN PROGRAM ----------------------------!
!----------------------------------------------------------------!
      DIMENSION X(20),GGI(10),EPSM(5)
      COMMON/BLOCK1/EPSS,R,ITER,INI,N,NC,LIMFIT,ZZ,XX,EPC
      OPEN(UNIT=1,FILE='FOR01.DAT',DEVICE='DSK',ACCESS='SEQIN')
      OPEN(UNIT=24,FILE='FOR24.DAT',DEVICE='DSK',ACCESS='SEQIN')
      OPEN(UNIT=25,FILE='MOD.DAT',DEVICE='DSK',ACCESS='SEQOUT')
      READ(1,*)Z,RF,TI,N,NC,NR,ITLIM,LIMFIT,RI,EPSS,(X(I),EPSM(I),
     1I=1,N),ZZ,XX,EPC
      INI=1
      NSTART=90
      II=0
      WRITE(25,1)TI
    1 FORMAT(//,30X,'OPTIMISATION RESULTS FOR INSIDE TEMPERATURE:',F4.
     1,//,50X,'SYSTEM (WITHOUT DESERT COOLER & WITH R22 REFRIGERANT)'
     2,/,30X,72('*'))
      WRITE(25,2)N,NC,NR,ITLIM,LIMFIT
    2 FORMAT(//,30X,'OPTIMISATION PARAMETERS:',/,30X,24('*'),//,50X,
     1'NO.OF DESIGN VARIABLES:',I3,/,50X,'NO.OF CONSTRAINTS:',I3,/,
     1,50X,'NO.OF REDUCTIONS FOR THE PENALTY PARAMETER:',I3,//,
     1 50X,'MAX.NO. OF ITERATIONS FOR D.F.P.:',I3,/,50X,'MAX.NO.OF
     1 CUBIC REFITS:',I3)
C*********** Starting value of penalty parameter.*************
      CALL PENAL(X,N,NC,RI,OBJI,GGI,FBI,SUMI)
      RO=-(Z*OBJI)/SUMI
      WRITE(25,3)RO
    3 FORMAT(//,30X,'STARTING VALUE FOR THE PENALTY PARAMETER (RO):',
     1 E16.8,//,30X,45('*'),//,30X,'STARTING DESIGN VECTOR X(I):',//,
     1 30X,28('*'))
      WRITE(25,4)(X(I),I=1,N)
    4 FORMAT(30X,E16.8,4X,E16.8,4X,E16.8,4X,E16.8,4X,E16.8)
C*********** Beginning of "INTERIOR PENALTY FUNCTION METHOD".*******
      DO 5 IR=1,NR
      TI=TI+1
      IF(TI.GT.5) TI=5
      R=RO
      CALL OPTIM(X,TI,EPSM,ITLIM,NSTART,F,OBJ)
      RO=RF*RO
```

```
5        CONTINUE
         STOP
         END
****************************************************************************
...................SUBROUTINES...............................................
*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*
               SUBROUTINE FOR D.F.P. METHOD
*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*--*
         SUBROUTINE OPTIM(X,II,EPSM,IPLTM,NSTART,F,OBJ)
         REAL NO,MQ
         INTEGER C,V
         DIMENSION G(10),GT(10),X(20),S(20),GRAD(20),XB(20),Q(20),
         THY(20),NO(20,20),MQ(20,20),H(20,20),EPSM(5),GRADP(20),SV(20))
         DIMENSION GRADS(10)
         COMMON/BLOCK1/EPSS,R,ITER,INIT,V,C,LIMFIT,ZZ,XX,EPCI
         TYPE1
1        FORMAT(10X,'ENTERS DFP')
         WRITE(25,2)R
2        FORMAT(///,15X,'VALUE FOR PENALTY PARAMETER (R):',E16.8,/,15X,
         1 32('-'))
         WRITE(25,3)
3        FORMAT(80('*'),/,1X,'ITER.NO',2X,'PENALTY FUNC',3X,'OBJ.FUNC',
         1/,80('*'))
4        FORMAT(1X,'STARTING POINT VIOLATES A CONSTRAINT.',
         1X(I) ARE',/(1X,10E13.6))
         ITER=0
         INIT=1
         IF(II.GE.5) GO TO 5
         IF(II.EQ.1) T=ZZ
         INIT=0
         GO TO 18
5        CALL PENAL(X,C,V,R,OBJ,G,F,SUM2Q)
         INIT=1
         DO 6 I=1,C
         IF(G(I).GE.0.0) GO TO 55
55       CONTINUE
         CALL GRADN(X,V,C,R,G,F,GRAD)
         TYPE*,F,OBJ
         WRITE(25,7)ITER,F,OBJ
7        FORMAT(5X,I3,5X,F8.2,5X,F8.20)
         WRITE(25,8)(X(I),I=1,V)
8        FORMAT(2X,'DESIGN VECTORS:',5(2X,F7.4))
         IF(F.GT.OBJ)GO TO 17
         STOP
9        WRITE(25,10)
10       FORMAT(10X,'ABS(F-OBJ) < 24.0')
11       WRITE(25,12)
12       FORMAT(2X,'FX(I+1) AND FX(I) ARE < EPSILON ')
13       WRITE(25,13)ITER,F,OBJ
         FORMAT(5X,I3,5X,F8.2,5X,F8.20)
14       WRITE(25,14)(X(I),I=1,V)
         FORMAT(2X,'DESIGN VECTORS:',5(2X,F7.4))
         STOP
15       WRITE(25,16)
16       FORMAT(2X,'G(I) > 0.0')
17       GO TO 22
```
```
18       DO 20 I=1,V
         DO 19 J=1,V
19       H(I,J)=0.0
20       CONTINUE
         DO 21 I=1,V
21       H(I,I)=1.0
         ITER2=0
```

```
        IF(INIT.EQ.0) GO TO 5
*............Calculation of direction vector.....................
22      DO 24 I=1,V
        A=0.0
        DO 23 J=1,V
23      A=A+H(I,J)*GRAD(J)
24      S(I)=-A
*...........Normalisation of direction vectors..................
        SNL=0.0
        DO 25 I=1,V
25      SNL=(SNL+S(I)**2.0)
        SNL=SQRT(SNL)
        DO 26 I=1,V
26      SN(I)=S(I)/ABS(SNL)
        DO 27 I=1,V
27      GRADP(I)=GRAD(I)
        ITER=ITER+1
*...........Determination of optimal step length................
        TYPE 28,ITER
28      FORMAT(5X,I2,5X,'ENTERS CUBE')
        IFLAG=0
        CALL INPOL(X,G,F,OBJ,SN,GRAD,IFLAG,T)
        DO 29 I=1,V
29      XB(I)=X(I)-T*SN(I)
        TYPE 30
30      FORMAT(10X,'COMES OUT OF CUBE')
        SUM=0.0
        DO 31 I=1,V
31      SUM=SUM+GRAD(I)**2
        SUM=SQRT(SUM)
        IF(SUM.LT.EPSS)GO TO 49
        SUM=0.0
        NN=1
32      DO 33 I=1,C
        IF(G(I).GT.0.0) T=.9*T
        IF(G(I).GT.0.0) GO TO 36
33      CONTINUE
        TYPE 34
34      FORMAT(15X,'G(I)<0.0')
        DO 35 I=1,V
        IF(ABS(GRAD(I)).GE.1.0)GO TO 39
35      CONTINUE
        GO TO 40
36      DO 37 I=1,V
37      X(I)=XB(I)+T*SN(I)
        TYPE 38
38      FORMAT(5X,'G(I)>0.0')
        CALL PENAL(X,C,V,R,OBJ,G,F,SUM30)
        SUM=SUM+NN
        IF(SUM.GT.25.0)GO TO 15
        GO TO 32
39      WRITE(20,52)(GRAD(I),I=1,V)
40      WRITE(25,7)ITER,F,OBJ
        WRITE(25,8)(X(I),I=1,V)
        IF(F.LT.0.0)GO TO 53
        TYPE 41
41      FORMAT(10X,'F >OBJ')
        IF(ABS(F-OBJ).LE.Z.0)GO TO 7
        IF(ITER.GT.ITLIM) GO TO 13
        ITER2=ITER2+1
        IF(ITER2.EQ.NSTART) GO TO 14
        DO 42 I=1,V
42      YU(I)=GRAD(I)-GRADP(I)
*...............Updating of the unit matrix...................
```

```
      STY=0.0
      DO 33 I=1,V
   33 STY=STY+(SN(I)*YQ(I))
      STY=STY/T
      DO 45 I=1,V
      A=0.0
      DO 44 J=1,V
   44 A=A+H(I,J)*YQ(J)
   45 HY(I)=A
      YHY=0.0
      DO 46 I=1,V
   46 YHY=YHY+HY(I)*YQ(I)
      DO 48 I=1,V
      DO 47 J=1,V
      MQ(I,J)=(SN(I)*SN(J))/STY
      NQ(I,J)=-(HY(I)*HY(J))/YHY
   47 H(I,J)=H(I,J)+MQ(I,J)+NQ(I,J)
   48 CONTINUE
      GO TO 22
   49 CONTINUE
      WRITE(25,50)
   50 FORMAT(//,20X,'VALUES FOR THE CONSTRAINTS:',/,20X,47('-'))
      WRITE(25,51)(G(I),I=1,C)
   51 FORMAT(20X,E15.8,5X,E15.8,5X,E15.8,5X,E16.8,5X,E15.8)
   52 FORMAT(4X,'GRADIENTS ARE:',/,4X,5(2X,E13.6))
      RETURN
   53 WRITE(25,54)
   54 FORMAT(10X,'FUNCTION VALUE & OBJ.VALUE')
      WRITE(25,4)(X(I),I=1,V)
   55 WRITE(25,51)(G(I),I=1,C)
      RETURN
      END
```

```
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
*               SUBROUTINE FOR PENALTY FUNCTION.               *
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
      SUBROUTINE PENAL(X,NC,NDV,RK,OBJ,GG,FB,SUM)
      DIMENSION GG(10),X(20)
      CALL CONS(X,GG)
      CALL OBJT(X,GG,OBJ)
*..............Calculation of the penalty function..............
      SUM=0.0
      DO 1 I=1,NC
      IF(GG(I).GE.0.0) GO TO 1
      SUM=SUM+1./GG(I)
    1 CONTINUE
      FB=OBJ-RK*SUM
      RETURN
      END
```

```
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
*          SUBROUTINE FOR THE OBJECTIVE FUNCTION EVALUATION.    *
*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
    Here, in this program , the objective function is the total cost
          involved in the vapour compression system per year.
              Total cost=Crun+Cinit
    where Crun =(Running cost+Maintenance cost)/year (in Rupees)
          Cinit= Initial cost for equipments/year    (in Rupees)
*-------------------DESIGN VARIABLES----------------------------
    X(1) :  Degree of rise in higher temperature (deg.Celsius)
    X(2) :  Degree of fall in lower temperature  (deg.Celsius)
    X(3) :  Degree of superheat                  (deg.Celsius)
    X(4) :  Degree of subcooling                 (deg.Celsius)
*****************************************************************
    SOURCE LISTING
    TROOM,RHRJOM : Temperature & Relative humidity of the air
```

```
                              inside the room.
    TOUT,RHOUT      :  Temperature & Relative humidity of the air
                              outside the room.
  COMEFF,YETAF,YETAM :  Efficiencies of the compressor,blower fan &
                              Mechanical respectively.
        NMON,NRUN   :  Number of months & hours in which the system
                              runs.
    CDEST,RATDES    :  Cost & Rating of the Desert Cooler.
    EVTHIC,COTHIC   :  Wall thickness of the Condenser & Evaporator
        LIFE,IRATE  :  Life & Rate of interest for the system.
              SF    :  Factor of safety for the system.
           JN,KN    :  Reference index.
                    :  JN=1 (system working with R12 refrigerant)
                    :  JN=2 (system working with R22 refrigerant)
                    :  KN=1 (system working without Desert Cooler)
                    :  KN=2 (system working with Desert Cooler)
           DELTA    :  Approach temperature in the Condenser &
                              Evaporator.
          NOCCUP    :  Number of occupants inside the room.
         TO1(I,J)   :  Outside air temperature variation for the
                              running hours of the system.
         RH1(I,J)   :  Relative humidity of the outside air
       SENVE1(I,J)  :  Ventilation load during the running hours of
                              the system.
       SLOAD1(I,J)  :  Sensible heat load.
       TLOAD1(I,J)  :  Total cooling load.
*********************************************************************
      SUBROUTINE OBJT(X,GG,CTOT)
      REAL MREF,IRATE,MAIR
      DIMENSION X(10),GG(10)
      DIMENSION TO1(6,10),RH1(5,10),SLOAD1(6,10),SENVE1(5,10),TLOAD1
     1(6,10),COMCOS(5),CM1COS(5),COMCAP(10),CM1CAP(10)
     2EVACOS(5),EV1COS(5),EVACAP(5),EV1CAP(5),CONCOS(5),CN1COS(5),
     3CONCAP(5),CN1CAP(5),BLOCAP(5),BLOCOS(5)
      CPA=1.004
      RHO=1.2
    1 FORMAT(4X,'I=',I3,5X,'X(1)=',F7.3)
      READ(24,*)TROOM,RHROOM,COMEFF,SF,YETAF,LIFE,IRATE,EVTHIC,
     1TOUT,RHOUT,NRUN,JN,YETAM,DELTA,VP,NOCCUP,COTHIC,NMON
     2,KN,L,M,CDEST,RATDES
      DO 3 I=1,NMON
      DO 2 J=1,NRUN
      READ(24,*)TO1(I,J),RH1(I,J),SENVE1(I,J),SLOAD1(I,J),TLOAD1(I,J)
    2 CONTINUE
    3 CONTINUE
      ENDFILE 24
      REWIND 24
*............Calculation of initial cost.................
      BIG=0.0
      I=2
      IF(KN.NE.1)I=4
      DO 5 J=1,NRUN
      IF(BIG-TLOAD1(I,J)) 4,5,5
    4 BIG=TLOAD1(I,J)
      KOUNT=J
    5 CONTINUE
      K=KOUNT
      SLOAD=SLOAD1(I,K)
      TLOAD=TLOAD1(I,K)
      SENVE=SENVE1(I,K)
      TO=TO1(I,K)
      RH=RH1(I,K)
      TH=TO+DELTA+X(1)
      TL=TROOM-DELTA-X(2)
```

```
      TI=TL+X(3)
      SUBT=TH-X(4)
      IF(JN.EQ.2)GO TO 6
      CALL R12VAL(TH,TL,TI,SUBT,COMEFF,H1,H2,H3)
      GO TO 7
      CALL R22VAL(TH,TL,TI,SUBT,COMEFF,H1,H2,H3)
      QLOAD=SF*QLOAD
      MREF=QLOAD/(H1-H3)
      PCOMPI=MREF*(H2-H1)/(3.5*YEFAM)
      QCOND=MREF*(H2-H3)/3.5
      EVAPR=QLOAD/3.5
      MAIR=QCOND*3.5/(CPA*X(1))
      VAIR=(MAIR*60.0)/RHO
      CALL COSTIN(JN,PCOMPI,QCOND,EVAPR,VAIR,CTOTAL)
      IF(JN.EQ.1)GO TO 8
      CTOTAL=CTOTAL+CDESI
      CALL ELEC(IRATE,LIFE,CE)
      RUNDES=RAIDES*CE*90
      M=4
      GO TO 9
*...............Calculation of running cost per year...............
   8  RUNDES=0.0
      CALL ELEC(IRATE,LIFE,CE)
   9  CONTINUE
      CR=0.0
      CALL IR(IRATE,LIFE,CS)
      DO 13 I=M,NMON
      RUN=CR
      CRUN=0.0
      DO 12 J=1,NRUN
      TH=TO1(I,J)+DELTA+X(1)
      TL=TROOM-DELTA-X(2)
      TI=TL+X(3)
      SUBT=TH-X(4)
      IF(JN.EQ.2)GO TO 10
      CALL R12VAL(TH,TL,TI,SUBT,COMEFF,H1,H2,H3)
      GO TO 11
  10  CALL R22VAL(TH,TL,TI,SUBT,COMEFF,H1,H2,H3)
  11  MREF=SF*TLOAD1(I,J)/(H1-H3)
      PCOMP=MREF*(H2-H1)/YEFAM
      MAIR=(SLOAD1(I,J)+BF*SENVE1(I,J))/(CPA*(TO1(I,J)-TROOM))
      MAIR=MAIR*1.0
      CMAIR=(MREF*(H2-H3))/(CPA*X(1))
      VOLAIR=CMAIR/RHO
      EVAIR=MAIR/RHO
      PBLOW=(3.429*VOLAIR*VOLAIR+1.143*VOLAIR+37.67)/(1000*YEFAF)
      PPOWER=(3.429*EVAIR*EVAIR+1.143*EVAIR+37.67)/(1000*YEFAF)
      C1=PCOMP*CE
      C2=PPOWER*CE
      C3=PBLOW*CE
      CRUN=CRUN+C1+C2+C3
  12  CONTINUE
      CR=CRUN*30.0+RUN
  13  CONTINUE
*...............Calculation of total cost...............
      CINI=CTOTAL*(1.2)/LIFE
      CRUN=CR+0.4*CINI+CS*RUNDES
      CTOT=(CRUN+CINI)/CE
      RETURN
      END
*-------------------------------------------------------------*
*          SUBROUTINE FOR THE CONSTRAINTS.                    *
*-------------------------------------------------------------*
      SUBROUTINE CONS(X,G)
```

```
      DIMENSION GG(10),X(20)
      GG(1)=1.0-X(1)/4.0
      GG(2)=X(1)/15.0-1.0
      GG(3)=1.0-X(2)/2.0
      GG(4)=X(2)/5.0-1.0
      GG(5)=1.0-X(3)
      GG(6)=X(3)/1.0-3.0
      GG(7)=1.0-X(4)
      GG(8)=X(4)/1.0-1.0
      RETURN
      END
```

+-+
+   SUBROUTINE FOR CUBIC INTERPOLATION   +
+-+

```
      SUBROUTINE IMPOL(X,G,FC,DEL,S,GRAD,IFLAG,T)
      INTEGER C,V,OO
      REAL LTHS,LTRG
      DIMENSION X(20),S(20),GRAD(20),XT(20),GRADT(20),GT(90),G(90)
      COMMON/BLOCK1/EPSS,R,ITER,INI,V,C,LIMITT,ZZ,XX,EPCT
      FORMAT(2X,6(I4,2X,E15.7))
      FORMAT(2X,37H POSSIBILITY OF LOCAL MINIMA DETECTED )
      FORMAT(2X,14H KLMT2 GTR 25 )
      FORMAT(2X,14H  KLMT3 GTR 35)
      FORMAT(2X,14H  KLMT1 GTR 50)
      FORMAT(2X,I5,8E15.7/(5X,8E15.7))
      LOCMIN=0
      IPR2=0
      IPR=0
      IF(IFLAG.NE.0) IPR2=1
      IF(IFLAG.NE.0) IPR=1
      IFLAG=0
      IF(IPR.NE.0) WRITE(22,6),ITER,(S(I),I=1,V)
      IF(IPR.NE.0) WRITE(22,6),ITER,(G(I),I=1,C)
      KLMT1=0
      KLMT2=0
      KLMT3=0
      OO=1
7     D=1.0
      FA=FC
      FAP=0.0
      DO 8 J=1,V
8     FAP=FAP+S(J)*GRAD(J)
      IF(FAP.GE.0.0) GO TO 38
      LTHS=0.0
      DO 9 J=1,V
9     LTHS=LTHS+S(J)*S(J)
      LTHS=SQRT(LTHS)
      TO=ABS(T)
      IF(TO.LT.0.0001) TO=0.0001
      T=TO
      TINC=T
      A=0.0
10    CONTINUE
      IDENT=1
      IF(IPR.NE.0) WRITE(22,6),IDENT,A,FA,FAP,T,TINC
      DO 11 J=1,V
11    XT(J)=X(J)+T*S(J)
      IF(INI.GT.V) GO TO 14
      DO 12 J=INI,V
      IF(XT(J).LT.0.0) GO TO 13
12    CONTINUE
      GO TO 14
13    CONTINUE
      TINC=(T-A)*0.5
```

```
        P=P-FINC
        KLMT2=0
        KLMT3=KLMT3+1
        KLMT1=KLMT1+1
        IF(KLMT1.GE.75) GO TO 34
        GO TO 10
14      CONTINUE
        CALL PENAL(XT,C,V,R,OBJ,GT,FB,SUMT)
        IDENT=2
        IF(IPR.NE.0) WRITE(22,6),IDENT,(G(I),I=1,C)
        DO 15 I=1,C
        IF(G(I).GT.0.0) GO TO 15
        IF(GT(I).GT.0.0) GO TO 13
15      CONTINUE
        KLMT1=0
        KLMT3=KLMT3+1
        KLMT2=KLMT2+1
        CALL SLOPE(XT,GT,S,GRADT,FB,FBP)
        IDENT=3
        IF(IPR.NE.0) WRITE(22,6),IDENT,FB,FBP,FA,FAP
        IF(FBP.GT.0.0) GO TO 21
        IF(KLMT2.GE.50) GO TO 36
        IF(KLMT3.GE.75) GO TO 35
        IF(FB.GT.FA) GO TO 33
        GO TO 20
16      CONTINUE
        DO 18 J=1,V
17      GRAD(J)=GRADT(J)
18      X(J)=XT(J)
        IF(IPR2.NE.0.0) WRITE(22,5),ITER,(GRAD(J),J=1,V)
        IF(IPR2.NE.0.0) WRITE(22,50),ITER,(X(J),J=1,V)
        DO 19 I=1,C
19      G(I)=GT(I)
        RETURN
20      CONTINUE
        FAP=FBP
        FA=FB
        A=T
        T=XX*T
        GO TO 10
21      CONTINUE
        B=T
22      Z=(3.0*(FA-FB))/(B-A)+FAP+FBP
        TSTA=ABS(FAP)+ABS(FBP)+2.0*ABS(Z)
        TSTB=FAP+FBP+2.0*Z
        IF(ABS(TSTB/TSTA).GT.1.0E-07) GO TO 39
        TSTA=1.0-(FAP/Z)*(FBP/Z)
        OZ=ABS(Z)*SQRT(TSTA)
        T=A+((FAP+Z+OZ)*(B-A))/TSTB
23      CONTINUE
24      DO 25 J=1,V
25      XT(J)=X(J)+T*S(J)
        CALL PENAL(XT,C,V,R,OBJ,GT,O,SUMT)
        DO 26 IJK=1,C
        IF(GT(IJK).GE.0.0) T=0.9*T
        IF(GT(IJK).GE.0.0) GO TO 24
26      CONTINUE
        IDENT=4
        IF(IPR.NE.0) WRITE(22,6),IDENT,C,Z,T,O,OBJ
        DO 27 I=1,C
        IF(G(I).GE.0.0) GO TO 27
        IF(GT(I).GE.0.0) GO TO 14
27      CONTINUE
        CALL SLOPE(XT,GT,S,GRADT,O,STB)
```

```
          GIDG=0.0
          DO 28 I=1,V
 28       LTHG=LTHG+GRADT(I)**2
          LTHG=SORT(LTHG)
          TSTA=STG/(LTHS*LTHG)
          IF(IPR2.NE.0) WRITE(22,29) ,TSTA,STG,LTHS,LTHG
 29       FORMAT(11H QUOTIENT =,E12.5,3X,7HSLOPE =,E12.5,2X,5HLTHS =,
         1E12.5,2X,6HLTHG =,E12.5)
          IF(ABS(TSTA).GT.EPSS) GO TO 34
          OO=OO+1
          IF(OO.GT.LIMFIT) GO TO 34
          IF(ABS(STG).LE.EPC)GO TO 30
          A=T
          FA=D
          FAP=STG
          GO TO 22
 30       B=T
          FB=D
          FBP=STG
          GO TO 22
 31       CONTINUE
 32       FB=D
          GO TO 16
 33       IF(LOCMIN.EQ.0) WRITE(20,2)
          LOCMIN=1
          GO TO 13
 34       WRITE(20,5)
          STOP
 35       WRITE(20,4)
          GO TO 37
 36       WRITE(20,3)
 37       WRITE(20,1),(J,XT(J),J=1,V)
          WRITE(20,1),(J,GT(J),J=1,V)
          IFLAG=1
          GO TO 16
 38       WRITE(22,*)FAP,ITER
          STOP
 39       T=A+(B-A)*FAP/(2.0*(Z+FAP))
          OZ=0.0
          GO TO 23
          END
C*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
C*                   SUBROUTINE FOR GRADIENTS.                      *
C*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
          SUBROUTINE GRADN(X,N,NC,R,G,Z,GRAD)
          DIMENSION X(20),G(10),GRAD(20),XP(20),XM(20)
          DO 1 I=1,N
          XP(I)=X(I)
 1        XM(I)=X(I)
          DO 2 I=1,N
          XP(I)=1.01*X(I)
          XM(I)=0.99*X(I)
          CALL PENAL(XP,NC,N,R,OBJ,G,FBP,SUMP)
          CALL PENAL(XM,NC,N,R,OBJ,G,FBM,SUMM)
          XP(I)=X(I)
          XM(I)=X(I)
 2        GRAD(I)=(FBP-FBM)/(0.02*X(I))
          RETURN
          END
C*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
C*                   SUBROUTINE FOR SLOPE.                          *
C*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*-*
          SUBROUTINE SLOPE(G,N,S,GR,X,OBJ)
          DIMENSION G(10),X(20),S(20),GR(20)
```

```
      INTEGER S,V
      COMMON/BLOCK1/EPSS,R,ITER,INT,V,S,LIMFIT
      CALL GRADN(X,V,S,R,S,F,GR)
      FBP=0.0
      DO 1 I=1,V
      FBP=FBP+S(I)*GR(I)
      RETURN
      END
```

```
*-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-*
*-|-|-|-|-|-|-|-|-|       SUBROUTINE FOR AIR PROPERTIES.    -|-|-|-|-|-|-|-*
*-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-*
      SUBROUTINE AIRPRI(TDB,RH,PS,SPVOL,WS,W,H)
      CPA=1.004
      RA=287.2
      X=1.152E-5-(4.787E-9)*(TDB+273.45)
      Y=(7.21379+(X*(TDB-210.0)*(TDB-210.0)))*(647.31/(TDB+273.15)-1.0)
      PS=(221.228/EXP(Y))
      SPVOL=RA*(TDB+273.15)/((1.013952-RH*PS)*1E+5)
      FS=1.004505-(2.0707E-5)*TDB+(9.145E-7)*(TDB)**2
      WS=0.622*FS*PS/(1.013962-FS*PS)
      H=1.004*TDB+WS*(2501.4+1.88*TDB)
      Z=FS*PS/1.013962
      DEGSAT=RH*(1.0-Z)/(1.0-RH*Z)
      W=DEGSAT*WS
      RETURN
      END
```

```
*-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-*
      SUBROUTINE ELEC(R,L,COST)
      DIMENSION CE(20)
      DO 1 I=1,20
      CE(I)=1.293/(0.97986+EXP(-0.09388*I))
    1 CONTINUE
      AL=L
      CEFF=0.0
      DO 2 I=1,L
      CEFF=CEFF+CE(I)/(1.0+R)**(I-1)
    2 CONTINUE
      COST=CEFF/AL
      RETURN
      END
```

```
*-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-*
      SUBROUTINE IR(R,L,CS)
      X1=(1.0+R)**L-1.0
      X2=R*(1.0+R)**(L-1)
      CS=X1/X2
      RETURN
      END
```

```
*-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-*
*-|-|-|-|-|-|-|    CAPACITY AND COST OF R12 & R22 EQUIPMENTS    -|-|-|-|-|-*
*-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-|-*
      SUBROUTINE COSTING(J,PCOMP1,PCOND,EVAPR,VAIR,CMDST)
      DIMENSION COMCAP(5),CONCAP(5),EVACAP(5),COMCOST(5),COMCDS(5),
     1EVACOS(5),BLDCOS(5),BLDCAP(5)
      DIMENSION CMICAP(5),CNICAP(5),EVICAP(5),CMICOSC(5),CNICOS(5),
     1EVICOS(5)
      IF(J.EQ.2)GO TO 9
      DATA(COMCAP(I),I=1,5)/0.5,1.0,1.5,2.0,3.0/
      DATA(COMCOS(I),I=1,5)/4000.0,4800.0,6500.0,8000.0,10000.0/
      DATA(CONCAP(I),I=1,5)/0.5,1.0,1.5,2.0,3.0/
      DATA(CONCOS(I),I=1,5)/1800.0,3300.0,4200.0,4800.0,5500.0/
      DATA(EVACAP(I),I=1,5)/0.5,1.0,1.5,2.0,3.0/
      DATA(EVACOS(I),I=1,5)/2200.0,3400.0,4200.0,4800.0,5800.0/
      DATA(BLDCAP(I),I=1,5)/50.0,75.0,120.0,150.0,200.0/
      DATA(BLDCOS(I),I=1,5)/1100.0,1700.0,2000.0,2500.0,3100.0/
```

```
         J=0
   1     I=I+1
         IF(PCOMP1-COMCAP(I))2,2,1
   2     QCOND=COMCAP(I)
         CPCOST=COMCOS(I)
         I=0
   3     I=I+1
         IF(QCOND-CONCAP(I))4,4,3
   4     QCOND=CONCAP(I)
         CTOTA=CONCOS(I)+CPCOST
         I=0
   5     I=I+1
         IF(EVAPR-EVACAP(I))6,6,5
   6     EVAPR=EVACAP(I)
         CEQP=EVACOS(I)+CTOTA
         I=0
   7     I=I+1
         IF(VAIR-BLOCAP(I))8,8,7
   8     VAIR=BLOCAP(I)
         CCOST=BLOCOS(I)+CEQP
         RETURN
   9     CONTINUE
         DATA(CM1CAP(I),I=1,5)/0.5,1.0,1.6,2.0,3.0/
         DATA(CM1COS(I),I=1,5)/5000.0,6000.0,7000.0,85000.0,11000.0/
         DATA(CN1CAP(I),I=1,5)/0.5,1.0,1.5,2.0,3.0/
         DATA(CN1COS(I),I=1,5)/2200.0,4000.0,5500.0,7000.0,8000.0/
         DATA(EV1CAP(I),I=1,5)/0.5,1.0,1.6,2.0,3.0/
         DATA(EV1COS(I),I=1,5)/2100.0,3500.0,4600.0,5800.0,6900.0/
         DATA(BLOCAP(I),I=1,5)/50.0,35.0,120.0,150.0,200.0/
         DATA(BLOCOS(I),I=1,5)/1150.0,1750.0,2000.0,2500.0,3100.0/
         I=0
  10     I=I+1
         IF(PCOMP1-CM1CAP(I))11,11,10
  11     PCOMP=CM1CAP(I)
         CPCOST=CM1COS(I)
         I=0
  12     I=I+1
         IF(QCOND-CN1CAP(I))13,13,12
  13     QCOND=CN1CAP(I)
         CTOTA=CN1COS(I)+CPCOST
         I=0
  14     I=I+1
         IF(EVAPR-EV1CAP(I))15,15,14
  15     EVAPR=EV1CAP(I)
         CEQP=EV1COS(I)+CTOTA
         I=0
  16     I=I+1
         IF(VAIR-BLOCAP(I))17,17,16
  17     VAIR=BLOCAP(I)
         CCOST=BLOCOS(I)+CEQP
         RETURN
         END
```

```
*-------------------------------------------------------------------*
*         SUBROUTINE FOR PROPERTIES OF R12 REFRIGERANT              *
*-------------------------------------------------------------------*
         SUBROUTINE R12VAL(TH,TL,PL,SUBC,EFF,H1,H2,H3)
         H1=HG(TL)+CP(TL0*(T1-TL)
         S1=(HG(TL)+HC(TL))/(TL+273.15)+SF(TL)+CP(TL)*ALOGC
        1(T1+273.15)/(TL+273.15))
         TH=TH+4.0
         S2D=(HG(TH)+HC(TH))/(TH+273.15)+SF(TH)
         T21=(TH+273.15)*EXP((S1-S2D)/CP(TH))
         T2D=T21+273.15
         H2D=HG(TH)+CP(TH)*(T2D-TH)
```

```
H2=(H2D-H1)/EFF+H1
T100=TH-4.0
H3=HF(SUBT)
RETURN
END
*.................FUNCTION SUBROUTINES.............................
FUNCTION HG(T)
HG=188.86+0.440278*T/100.0*100.0-7.02007*(T/100.0)**2-5.07651
1*(T/100.0)**3-3.82545*(T/100.0)**4
RETURN
END
FUNCTION HF(T)
HF=36.1554+0.928108*T/100.0*100.0+6.89916*T/100.0*T/100.0
1+3.73414*(T/100.0)**3+5.91573*(T/100.0)**4
RETURN
END
FUNCTION CP(T)
CP=0.59524+0.0018175*(T+15)
RETURN
END
FUNCTION SF(T)
SF=0.142093+0.33747*T/100.0-0.0389606*T/100.0*T/100.0
1+0.019869*(T/100.0)**3+0.014323*(T/100.0)**4
RETURN
END
*-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+*
*               SUBROUTINE FOR PROPERTIES OF R22 REFRIGERANT     *
*-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+-+*
      SUBROUTINE R22VAL(TH,TL,T1,SUBT,EFF,H1,H2,H3)
      H1=HG1(TL)+CP1(TL)*(T1-TL)
      S1=(HG1(TL)-HF1(TL))/(TL+273.15)+SF1(TL)+CP1(TL)*ALOG(
     1(T1+273.15)/(TL+273.15))
      TH=TH+4.0
      S2D=(HG1(TH)-HF1(TH))/(TH+273.15)+SF1(TH)
      T21=(TH+273.15)*EXP((S1-S2D)/CP1(TH))
      T2D=T21-273.15
      H2D=HG1(TH)+CP1(TH)*(T2D-TH)
      H2=(H2D-H1)/EFF+H1
      T100=TH-4.0
      H3=HF1(SUBT)
      RETURN
      END
*.................FUNCTION SUBROUTINES.............................
FUNCTION HG1(T)
HG1=251.96+(T/100.0)*(35.4377-(T/100.0)*(19.4993+(T/100.0)*
1(7.62005+1.6756*(T/100.0))))
RETURN
END
FUNCTION HF1(T)
HF1=46.2101+T*(1.20394+(T/100)*(T/100)*(6.828-(T/100)*(8.94387+
1(T/100)*20.0612)))
RETURN
END
FUNCTION CP1(T)
CP1=0.70114+0.0029529*(T-10.0+0.010472*((T-10.0)**4.0))
RETURN
END
FUNCTION SF1(T)
SF1=0.181032+(T/100)*(0.43657-(T/100)*(0.0596755*(T/100)*0.023
1(34)-0.0618007*(T/100)))
RETURN
END
*....................................................................
```

ME-1906-M-SEK-OPT